



FINAL **Hazardous Building** **Materials Assessment**

South Grenville District High
School
1000 Edward Street, Prescott,
Ontario

Prepared for:

**Upper Canada District High
School**

225 Central Avenue West
Brockville, ON K6V 5X1

August 9, 2023

Pinchin File: 302783.041



Hazardous Building Materials Assessment

South Grenville District High School, 1000 Edward Street, Prescott, Ontario
Upper Canada District High School

August 9, 2023
Pinchin File: 302783.041
FINAL

Issued to:	Upper Canada District High School
Issued on:	August 9, 2023
Pinchin File:	302783.041
Issuing Office:	Kingston, ON

Author:	<hr/> Kristen Vanderburgt Project Coordinator 613.541.1013 kvanderburgt@pinchin.com
---------	--

Reviewer:	<hr/> Will Watson, B.Sc. (Env) Project Technologist 613.541.1013 wwatson@pinchin.com
-----------	--

Reviewer:	<hr/> Mark Stroombergen, CET, EMBA Executive Vice President 902.393.4376 mstroombergen@pinchin.com
-----------	--



EXECUTIVE SUMMARY

Upper Canada District High School (Client) retained Pinchin Ltd. (Pinchin) to conduct a hazardous building materials assessment at South Grenville District High School located at 1000 Edward Street, Prescott, Ontario. Pinchin performed the assessment on August 22-24, 2022.

The objective of the assessment was to document the locations of specified hazardous building materials, evaluate their condition and develop corrective action plans as required for the purposes of long-term management. The results of this assessment can be used for construction, renovation, demolition or project tendering purposes conditional that additional intrusive investigations are completed and excluded materials are sampled prior to disturbance, if required.

SUMMARY OF FINDINGS

Asbestos:

- Parging cement insulation
- Aircell insulation
- Acoustic ceiling tiles
- Vinyl sheet flooring
- Vinyl floor tiles and mastic
- Caulking
- Paint present on concrete block walls
- All asbestos-containing materials were observed to be in good condition

Lead:

- Lead is present in paints and coatings
- Batteries of emergency lights and fire alarm control panels contain solid lead
- Caulking on cast iron pipe joints (bell and spigot) contains lead

Silica: Crystalline silica is present in concrete and other materials such as masonry, drywall and plaster.

Mercury: Mercury vapour is present in lamp tubes and liquid mercury is present in instrumentation (pressure gauge).

Polychlorinated Biphenyls (PCBs): PCBs are not present.

Mould and Water Damage: Visible mould growth and water damage was not observed.



SUMMARY OF RECOMMENDATIONS

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations:

1. Assess and/or sample materials listed as excluded or as presumed prior to disturbance.
2. Prepare an Asbestos Management Program (AMP).
3. Perform a re-assessment of ACM on an annual basis.
4. Perform a pre-construction assessment and remove all ACM prior to alteration or maintenance work if ACM may be disturbed by the work.
5. Recycle mercury-containing lamp tubes and instrumentation when removed from service.
6. Follow appropriate safe work procedures when handling or disturbing asbestos, lead and silica.

This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.



TABLE OF CONTENTS

1.0	INTRODUCTION AND SCOPE	1
1.1	Scope of Assessment	1
2.0	METHODOLOGY	2
3.0	BACKGROUND INFORMATION	2
3.1	Building Description	2
3.2	Inaccessible Locations	3
3.3	Existing Reports	3
4.0	FINDINGS	3
4.1	Asbestos	3
4.2	Lead	15
4.3	Silica	17
4.4	Mercury	17
4.5	Polychlorinated Biphenyls	17
4.6	Mould and Water Damage	18
5.0	RECOMMENDATIONS	18
5.1	General	18
5.2	On-going Management and Maintenance	18
6.0	TERMS AND LIMITATIONS	20
7.0	REFERENCES	20

APPENDICES

APPENDIX I	Drawings
APPENDIX II-A	Asbestos Analytical Certificates
APPENDIX II-B	Lead Analytical Certificates
APPENDIX II-C	PCB Analytical Certificates
APPENDIX III	Methodology and Evaluation Criteria
APPENDIX IV	Location Summary Report
APPENDIX V	Hazardous Materials Summary Report / Sample Log
APPENDIX VI	HMIS All Data Report



1.0 INTRODUCTION AND SCOPE

Upper Canada District High School (Client) retained Pinchin Ltd. (Pinchin) to conduct a hazardous building materials assessment at South Grenville District High School located at 1000 Edward Street, Prescott, Ontario.

Pinchin performed the assessment on August 22-24, 2022. The assessor was unaccompanied during the assessment. The assessed area was occupied at the time of the assessment.

The objective of the assessment was to document the locations of specified hazardous building materials, evaluate their condition and develop corrective action plans as required. This assessment is to be used for the purposes of long-term management and routine maintenance. The results of this assessment can be used for construction, renovation, demolition or project tendering purposes conditional that additional intrusive investigations are completed and excluded materials are sampled prior to disturbance, if required.

1.1 Scope of Assessment

The **assessed area** consisted of all interior and exterior areas of the building, excluding the roof.

The assessment was performed to establish the type of specified hazardous building materials, locations and approximate quantities incorporated in the structure(s) and its finishes.

For the purpose of the assessment and this report, hazardous building materials are defined as follows:

- Asbestos
- Lead
- Silica
- Mercury
- Polychlorinated Biphenyls (PCBs)
- Mould

The following Designated Substances are not typically found in building materials in a composition/state that is hazardous and were not included in this assessment:

- Arsenic
- Acrylonitrile
- Benzene
- Coke oven emissions



Hazardous Building Materials Assessment

South Grenville District High School, 1000 Edward Street, Prescott, Ontario
Upper Canada District High School

August 9, 2023
Pinchin File: 302783.041
FINAL

- Ethylene oxide
- Isocyanates
- Vinyl chloride monomer

2.0 METHODOLOGY

Pinchin conducted a room-by-room assessment (rooms, corridors, service areas, exterior, etc.) to identify the hazardous building materials as defined in the scope.

The assessment was limited to non-intrusive testing. Concealed spaces such as those above solid ceilings and within shafts and pipe chases were accessed via existing access panels only. Destructive testing of flooring was not conducted (under carpets or multiple layers of flooring). Demolition of walls, solid ceilings, structural items, interior finishes or exterior building finishes, to determine the presence of concealed materials was not conducted. Sampling of roofing materials was not conducted.

For further details on the methodology including test methods and evaluation criteria, refer to Appendix III.

3.0 BACKGROUND INFORMATION

3.1 Building Description

Description Item	Details
Use	Secondary School.
Number of Floors	The building is two storeys with a partial basement.
Total Area	The total area of the building is 104,553 square feet.
Year of Construction	The building was constructed in 1958 with additions completed in 1962, 1965, 1967 and 1995.
Structure	Structural steel and concrete.
Exterior Cladding	Brick and metal cladding.
HVAC	Boiler with hot water heating to radiators, air handling units, suspended unit heaters and rooftop HVAC.
Roof	Flat (outside of scope).
Flooring	Terrazzo, concrete, vinyl floor tiles, ceramic tiles, vinyl sheet flooring, carpet, hardwood and rubber.
Interior Walls	Plaster, textured plaster, drywall, wood, concrete block, ceramic tiles, brick and metal.
Ceilings	Plaster, acoustic ceiling tiles, drywall, wood, metal and exposed steel and concrete deck.



Hazardous Building Materials Assessment

South Grenville District High School, 1000 Edward Street, Prescott, Ontario
Upper Canada District High School

August 9, 2023
Pinchin File: 302783.041
FINAL

3.2 Inaccessible Locations

The following rooms or areas were not accessible and are therefore not included in the report.

Area or Room	Loc. No.	Reason
Fan Room	1624	Locked, no key

3.3 Existing Reports

Pinchin previously prepared the following reports, which have been reviewed as part of this assessment:

- *"Hazardous Building Materials Assessment, South Grenville District High School, 1000 Edward Street North, Prescott, Ontario"*, prepared by Pinchin Ltd. dated June 21, 2012, File No. 75283.

4.0 FINDINGS


The following section summarizes the findings of the assessment and provides a general description of the hazardous building materials identified. For details on approximate quantities, condition, friability, accessibility, and locations of hazardous building materials; refer to the Hazardous Material Summary / Sample Log and All Data Report in Appendices V and VI.

Any quantities listed in this report or data tables are estimated based on visual approximations only and are subject to variation.

4.1 Asbestos

4.1.1 Spray-Applied Insulation

Spray-applied fireproofing and overspray present on the structure in Locations 1590, 1591, 1770 and 2350 does not contain asbestos (previous Pinchin samples 01A-C and 30A-C).

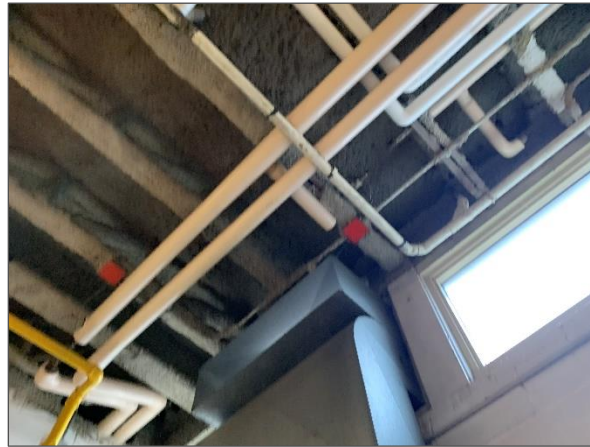

Non-asbestos sprayed fireproofing.

4.1.2 *Pipe Insulation*

Parging cement, containing asbestos, is present on pipe fittings (elbows), on various pipe systems in isolated locations of the original 1958 building (Phase A) and 1962 addition (Phase B) (previous Pinchin samples 17A-D).

A white corrugated paper insulation (trade name Aircell), containing asbestos, is present on straight sections of hot water heating system pipes in Location 1600 (previous Pinchin samples 23A-C).

Remaining pipes in the assessed area are either uninsulated or insulated with non-asbestos fibreglass or other non-asbestos insulation such as mineral fibre or elastomeric foam insulation.

Pipes insulated with asbestos-containing insulations may be present in inaccessible spaces such as above solid ceilings, in chases, in column enclosures and within shafts.



Asbestos-containing parging cement insulation present on pipe elbows.



Asbestos-containing Aircell pipe insulation.

4.1.3 Duct Insulation and Mastic

Ducts are either uninsulated or insulated with non-asbestos fibreglass (foil-faced or canvas jacketing).

4.1.4 Mechanical Equipment Insulation

Mechanical equipment (e.g., air handling units, suspended unit heaters, hot water tanks, boilers) is either uninsulated or insulated with non-asbestos fibreglass.



Non-asbestos insulated boilers.




4.1.5 Vermiculite

Destructive testing of concrete block walls to investigate for loose fill vermiculite was not conducted due to the current building use.

Loose fill vermiculite debris was not observed in the spaces/areas inspected.

4.1.6 Acoustic Ceiling Tiles

The following is a summary of acoustic ceiling tiles sampled, for a complete list of locations, refer to Appendix V.

Description	Sample Location	Sample Number, Date Code or Material Composition	Asbestos	Photo
1'x1', large and medium uniform holes	Locations 1570 and 2190	Previous Pinchin Samples 04A-C	Yes	
1'x1', glued-on, smooth	Location 1480, 1482 and 2401	Previous Pinchin Samples 15A-C	No	
2'x4', lay-in, wide fissures and pinholes	Location 1910	Previous Pinchin Samples 20A-C	No	
2'x4', lay-in, coarse texture	Location 1000	Previous Pinchin Samples 24A-C	No	

Adhesive associated with the 1'x1' ceiling tiles throughout the building does not contain asbestos (previous Pinchin sample 15B-B and samples S0035A-C, S0052A-B).

Remaining ceiling tiles are presumed to be non-asbestos based on the date of manufacture determined from the date stamp applied to the top of the tiles. The tiles were manufactured after asbestos stopped being used in acoustic ceiling tiles.

4.1.7 Plaster and Stucco



Smooth and textured plaster present on walls and ceilings throughout the building does not contain asbestos (previous Pinchin samples 02A-G and samples S0034A-G, S0036A-G, S0051A-E, S0055A-C and S0058A-E).

4.1.8 Drywall Joint Compound

Drywall joint compound present on wall and ceiling finishes throughout the building does not contain asbestos (previous Pinchin samples 06A-G and samples S0038A-G, S0049A-G, S0056A-E and S0059A-E).





4.1.9 Vinyl Sheet Flooring




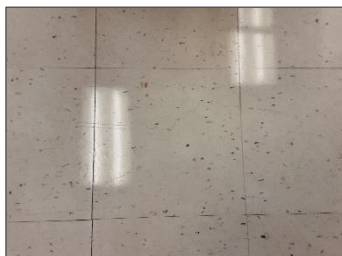

The following is a summary of vinyl sheet flooring sampled, for a complete list of locations, refer to Appendix V.




Description	Sample Location (Loc #)	Sample Number	Asbestos (Backing / Adhesive)	Photo
Beige geometric	Locations, 1130, 1150 and 1170	Previous Pinchin Samples 19A-C and Samples S0039A-C	Yes / No	
Pink geometric	Location 1060	Previous Pinchin Samples 22A-C and Samples S0041A-B	No / No	

4.1.10 Vinyl Floor Tiles, Baseboard, and Stair Flooring

The following is a summary of vinyl floor tiles sampled, for a complete list of locations, refer to Appendix V.

Description	Sample Location (Location #)	Sample Number	Asbestos (Tile / Adhesive)	Photo
9"x9", grey with white and black streaks	Location 1570	Previous Pinchin Samples 03A-C	Yes / No	
12"x12", grey with light grey fleck	Locations 1350 and 2190	Previous Pinchin Samples 05A-C and samples S0043A-B	No / No	
12"x12", blue with white fleck	Location 1352 and 1140	Previous Pinchin Samples 07A-C and Samples S0048A-B	No / No	
12"x12", white with blue fleck	Location 1352 and 1510	Previous Pinchin Samples 08A-C	No / No (Removed prior to 2022)	
12"x12", beige with brown fleck	Location 1550	Previous Pinchin Samples 09A-C	Yes / No	

Description	Sample Location (Location #)	Sample Number	Asbestos (Tile / Adhesive)	Photo
12"x12', white with teal fleck	Location 1290 and 1330	Previous Pinchin Samples 10A-C	Yes / No	
12"x12", beige with white and dark brown fleck	Locations 1270, 2251 and 2292	Previous Pinchin Samples 11A-C	Yes / Yes	
12"x12", beige with brown fleck	Location 2360	Previous Pinchin Samples 12A-C	No / No	
12"x12", white with light and dark grey flecks	Location 1400	Previous Pinchin Samples 13A-C and Samples S0037A	No / No	
9"x9", grey with white streaks	Locations 1440, 2340 and 2580	Previous Pinchin Samples 14A-C	Yes / No	

Description	Sample Location (Location #)	Sample Number	Asbestos (Tile / Adhesive)	Photo
12"x12', light green	Location 1482	Previous Pinchin Samples 16A-C	Yes / No	
12"x12', white with grey and teal flecks	Locations 1070 and 1600	Previous Pinchin Samples 18A-C	No / No	
12"x12", pink with dark pink fleck	Location 1100	Previous Pinchin Samples 21A-C	No / No (Removed prior to 2022)	
12"x12', grey and brown fleck	Location 2195	Previous Pinchin Samples 25A-C	No / No	
12"x12', teal	Locations 2260 and 2390	Previous Pinchin Samples 26A-C	No / No	
9"x9", beige with brown fleck	Location 2370	Previous Pinchin Samples 27A-C	Yes / No	

Description	Sample Location (Location #)	Sample Number	Asbestos (Tile / Adhesive)	Photo
9"x9", green	Locations 2400 and 2440	Previous Pinchin Samples 28A-C	Yes / No	
12"x12", light blue with white fleck	Location 2270	Previous Pinchin Samples 29A-C and Samples S0044A-B	No / Yes*	
12"x12", grey with dark grey fleck	Location 2230	Previous Pinchin Samples 31A-C	Yes (Abated prior to 2022)	
12"x12", peach with blue and grey smears	Locations 2140 and 2160	Samples S0045A-C	No / No	
12"x12", white with blue and grey smears	Locations 2080, 2090 and 2100	Samples S0046A-C	No / No	
12"x12", black with white streaks	Location 2230	Samples S0060A-C	No / No	

*Due to contamination from the asbestos-containing mastic, vinyl floor tiles must be treated as asbestos-containing for handling and disposal purposes.

Mastic, containing asbestos, is present beneath vinyl floor tiles throughout the 1965 addition (Phase C) and the 1967 addition (Phase D) (previous Pinchin samples 32A-C and 33A-C).

Remaining vinyl floor tile mastic present in the original portion of the building does not contain asbestos (samples S0053A-C).

Remaining vinyl floor tiles were presumed to be non-asbestos based on historical knowledge of the date of installation (i.e., post 2000).



4.1.11 Levelling Compound

The levelling compound associated with the 12"x12" white vinyl floor tiles with blue and grey smears and the 12"x12" black vinyl floor tiles with blue and grey smears does not contain asbestos (samples S0046A-C; Layer C and S0060A and S0060B; Layer C).





Levelling compound was analysed for asbestos content where it was present on the tiles, however a comprehensive testing program for mastic was not performed.

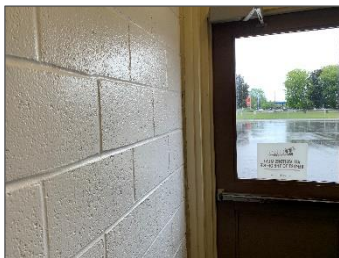4.1.12 Sealants, Caulking, and Putty

The following is a summary of sealants, caulking, and putties sampled, for a complete list of locations, refer to Appendix V.

Material, Description and Application	Sample Location (Location #)	Sample Number	Asbestos	Photo
Caulking, beige, door frames	Locations 24 and 30	S0042A-C	No	
Caulking, beige, window and door frames	Location 53	S0061A-C	No	

Material, Description and Application	Sample Location (Location #)	Sample Number	Asbestos	Photo
Caulking, grey, door frames	Location 54	S0062A-C	Yes	
Caulking, beige, window frames	Location 54	S0063A-C	Yes	
Caulking, white, expansion joints	Location 54	S0064A-C	Yes	
Caulking, grey, expansion joints	Location 55	S0065A-C	Yes	
Caulking, beige, window and door frames	Location 55	S0066A-C	Yes	

Material, Description and Application	Sample Location (Location #)	Sample Number	Asbestos	Photo
Caulking, white, expansion joints	Location 56	S0067A-C	No	
Caulking, white, door frames	Location 56	S0068A-C	Yes	
Caulking, beige, window frames	Location 56	S0069A-C	No	
Caulking, white, door frames	Location 57	S0070A-C	Yes	
Silicone, window frames	Not Sampled	N/A	Non-asbestos composition	

4.1.13 Other Building Materials

Paint present on the concrete block walls throughout the original 1958 portion (Phase A) of the building does not contain asbestos (samples S0040A-G).

Paint, containing asbestos, is present on the concrete block walls throughout the 1962 addition (Phase B) (samples S0050A-G).



Paint, containing asbestos, is present on the concrete block walls throughout the 1965 (Phase C) and 1967 (Phase D) additions (samples S0054A-G and S0057A-G).

4.1.14 Excluded Materials

The following is a list of materials which may contain asbestos and was excluded from the assessment. These materials are presumed to contain asbestos until otherwise proven by sampling and analysis:

- Roofing felts and tar, mastics
- Floor levelling compound
- Ceramic tile setting compound
- Elevator and lift brakes
- Electrical components
- Insulation under metal clad boilers and vessels
- Mechanical packing, ropes, and gaskets
- Vermiculite
- Adhesives and duct mastics
- Fire resistant doors
- Terrazzo
- Ropes and gaskets in cast-iron bell and spigot joints
- Sealants on pipe threads
- Materials concealed or outside of the assessed area

4.2 Lead

4.2.1 Paints and Surface Coatings

Refer to the lab report(s) in Appendix II-B and the Hazardous Material Summary / Sample Log in Appendix V for details on paints sampled and their locations.

The following table summarizes the analytical results for paints sampled contain above 0.009% (90 mg/kg) lead.

Sample Number	Colour, Substrate Description	Sample Location	Lead (%)
L0001	Various colours, plaster (composite)	Locations 1150, 1230 and 1910	0.0598



Sample Number	Colour, Substrate Description	Sample Location	Lead (%)
L0002	Black, steel structure (composite)	Locations 1001, 1910 and 2210	0.0784
L0004	Grey, poured concrete (composite)	Locations 4, 1240 and 1631	0.137
L0007	Various colours, concrete block walls (composite)	Locations 13, 1640, 1690 and 2210	0.0832
L0009	Various colours, concrete block wall (composite)	Locations 1280, 1480 and 2390	0.0121
L0013	Various colours, steel structure (composite)	Locations 1350, 1410 and 2280	0.191
L0018	Various colours, concrete block walls (composite)	Locations 1004, 1771 and 2310	0.0113
L0019	Various colours, plaster (composite)	Locations 40, 1790 and 2330	0.0115
L0020	Grey, poured concrete (composite)	Locations 41, 2350 and 2344	0.0229
L0022	Various colours, concrete block walls (composite)	Locations 51, 2352 and 2353	0.269
L0025	Grey, poured concrete (composite)	Location 1520	0.0417
L0026	Various colours, steel structure	Location 1520	0.0445
L0027	Grey, steel door	Location 54	1.15

Results above 0.1% (1,000 mg/kg) are considered lead-containing, and over 0.5% (5,000 mg/kg) are considered lead-based.

Results less than or equal to 0.1% (1,000 mg/kg), but equal to or greater than 0.009% (90 mg/kg), are considered low-level lead paints or surface coatings in accordance with the EACC guideline.

Paint containing less than 0.009% (90 mg/kg) lead is assumed to be insignificant.

4.2.2 Lead Products and Applications

Lead-containing batteries are present in emergency lighting and fire control panels.

Lead caulking is present in bell and spigot fittings on cast iron pipes.



4.2.3 Excluded Lead Materials

Lead is known to be present in several materials which were not assessed or sampled. The following materials, where found, should be presumed to contain lead:

- Electrical components, including wiring connectors, grounding conductors, and solder
- Solder on pipe connections
- Glazing on ceramic tiles

4.3 Silica

Crystalline silica is assumed to be a component of the following materials where present in the building:

- Concrete
- Masonry and mortar
- Ceramic tiles and grout
- Plaster
- Drywall
- Ceiling tiles
- Terrazzo

4.4 Mercury

4.4.1 Lamps

Mercury vapour is present in fluorescent lamp tubes.

4.4.2 Mercury-Containing Devices

Thermostats inspected did not contain liquid mercury ampules.

Mercury is present as a liquid in manometers.

Mercury is present as a liquid in instrumentation in boiler and mechanical rooms.

4.5 Polychlorinated Biphenyls

4.5.1 Caulking and Sealants

Refer to the Hazardous Material Summary / Sample Log in Appendix V for details on caulking sampled and their locations.

All caulking sampled are considered non-PCB solids based on the threshold (50 mg/kg).



4.5.2 Lighting Ballasts

Based on information from the Client and confirmed by visual observations (e.g., evidence of T-5 or T-8 fixtures with electronic ballasts) the fixtures will not contain PCB ballasts.

4.5.3 Transformers

All transformers in the building are dry type transformers and do not contain PCB-containing dielectric fluids; however, may contain capacitors, which could not be assessed for PCBs as the equipment was in service.

4.5.4 Excluded PCB Materials

PCBs are known to be present in several materials and equipment which were not assessed or sampled. The following materials, where found, should be presumed to contain PCBs until sampling proves otherwise:

- Applications of caulking or sealants on the roof.

4.6 Mould and Water Damage

Visible mould growth and water damage was not found during the assessment.

5.0 RECOMMENDATIONS

5.1 General

Perform an intrusive assessment prior to building renovation or demolition operations. The assessment should include; destructive testing (e.g., coring and/or removal of building finishes and components), and other materials not previously tested (e.g., roofing materials, caulking, mastics). This report does not provide sufficient detail for certain renovations or demolition.

5.2 On-going Management and Maintenance

The following recommendations are made regarding on-going management and maintenance work involving the hazardous materials identified.

5.2.1 Asbestos

Prepare an Asbestos Management Program (AMP). The AMP should address and document: written work practices, worker training, notifications, policies and responsibilities.

Perform a reassessment of asbestos-containing materials (ACM) on an annual basis.



Remove ACM prior to alteration or maintenance work if ACM may be disturbed by the work. Follow appropriate asbestos precautions for the classification of work being performed.

Asbestos-containing materials must be disposed of at a landfill approved to accept asbestos waste.

Update the asbestos inventory upon completion of the abatement and removal of asbestos-containing materials and any other relevant findings.

5.2.2 Lead

For lead-containing or lead-based paints (i.e., greater than the EACC guideline of 0.1% (1,000 mg/kg) for lead-containing paints, and 0.5% (5,000 mg/kg) for lead-based), construction disturbance may result in over-exposure to lead dust or fumes. The need for work procedures, engineering controls and personal protective equipment should be assessed on a site-specific basis to comply with Ministry of Labour, Training and Skills Development regulations, and guidelines.

For paints identified as having low levels of lead (i.e., equal to or above 0.009% (90 mg/kg) but less than or equal to the EACC guideline of 0.1% (1,000 mg/kg) for lead-containing paints) special precautions are not recommended unless aggressive disturbance (grinding, blasting, torching) is planned. Exposure from construction disturbance of paints containing lead less than 0.009% (90 mg/kg) is assumed to be insignificant.

Items painted with paints containing elevated levels of lead may be a hazardous waste. Test lead-painted materials for leachable lead and other metals prior to disposal. Metallic components coated with lead paint do not require leachate testing and can be disposed of as non-hazardous construction and demolition (C&D) waste.

Lead-containing items should be recycled when taken out of service.

5.2.3 Silica

Disturbance of silica-containing products during maintenance activities may result in excessive exposures to airborne silica, especially if performed indoors and dry. Cutting, grinding, drilling or demolition of materials containing silica should be completed only with proper respiratory protection and other worker safety precautions that comply with applicable regulations and guidelines.

5.2.4 Mercury

Do not break lamps or separate liquid mercury from components. Recycle and reclaim mercury from fluorescent lamps and instrumentation when taken out of service. Mercury is classified as a hazardous waste and must be disposed of in accordance with applicable regulations.



6.0 TERMS AND LIMITATIONS

This work was performed subject to the Terms and Limitations presented or referenced in the proposal for this project.

Information provided by Pinchin is intended for Client use only. Pinchin will not provide results or information to any party unless disclosure by Pinchin is required by law. Any use by a third party of reports or documents authored by Pinchin or any reliance by a third party on or decisions made by a third party based on the findings described in said documents, is the sole responsibility of such third parties. Pinchin accepts no responsibility for damages suffered by any third party as a result of decisions made or actions conducted. No other warranties are implied or expressed.

7.0 REFERENCES


The following legislation and documents were referenced in completing the assessment and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.
3. Lead on Construction Projects, Ministry of Labour Guidance Document.
4. The Environmental Abatement Council of Canada (EACC) Lead Guideline for Construction, Renovation, Maintenance or Repair.
5. Ministry of the Environment Regulation, R.R.O. 1990 Reg. 347 as amended.
6. Ministry of the Environment Regulation, R.R.O. 1990 Reg. 362 as amended.
7. Silica on Construction Projects, Ministry of Labour Guidance Document.
8. Alert – Mould in Workplace Buildings, Ontario Ministry of Labour.
9. PCB Regulations, SOR/2008-273, Canadian Environmental Protection Act.
10. Surface Coating Materials Regulations, SOR/2016-193, Canada Consumer Product Safety Act.


\\pinchin.com\kgn\Job\302000s\0302783.000 UCDSB,various,HAZ,Reasmt\0302783.041 UCDSB,SouthGrenvilleDHS,HAZ,ReAsmt\Deliverables\302783.041 HBMA
SouthGrenvilleDHS 1000EdwardStINPrescottON UCDSB.docx

Template: Master Report for Hazardous Materials Assessment Report (Management), HAZ, October 31, 2022





APPENDIX I
Drawings

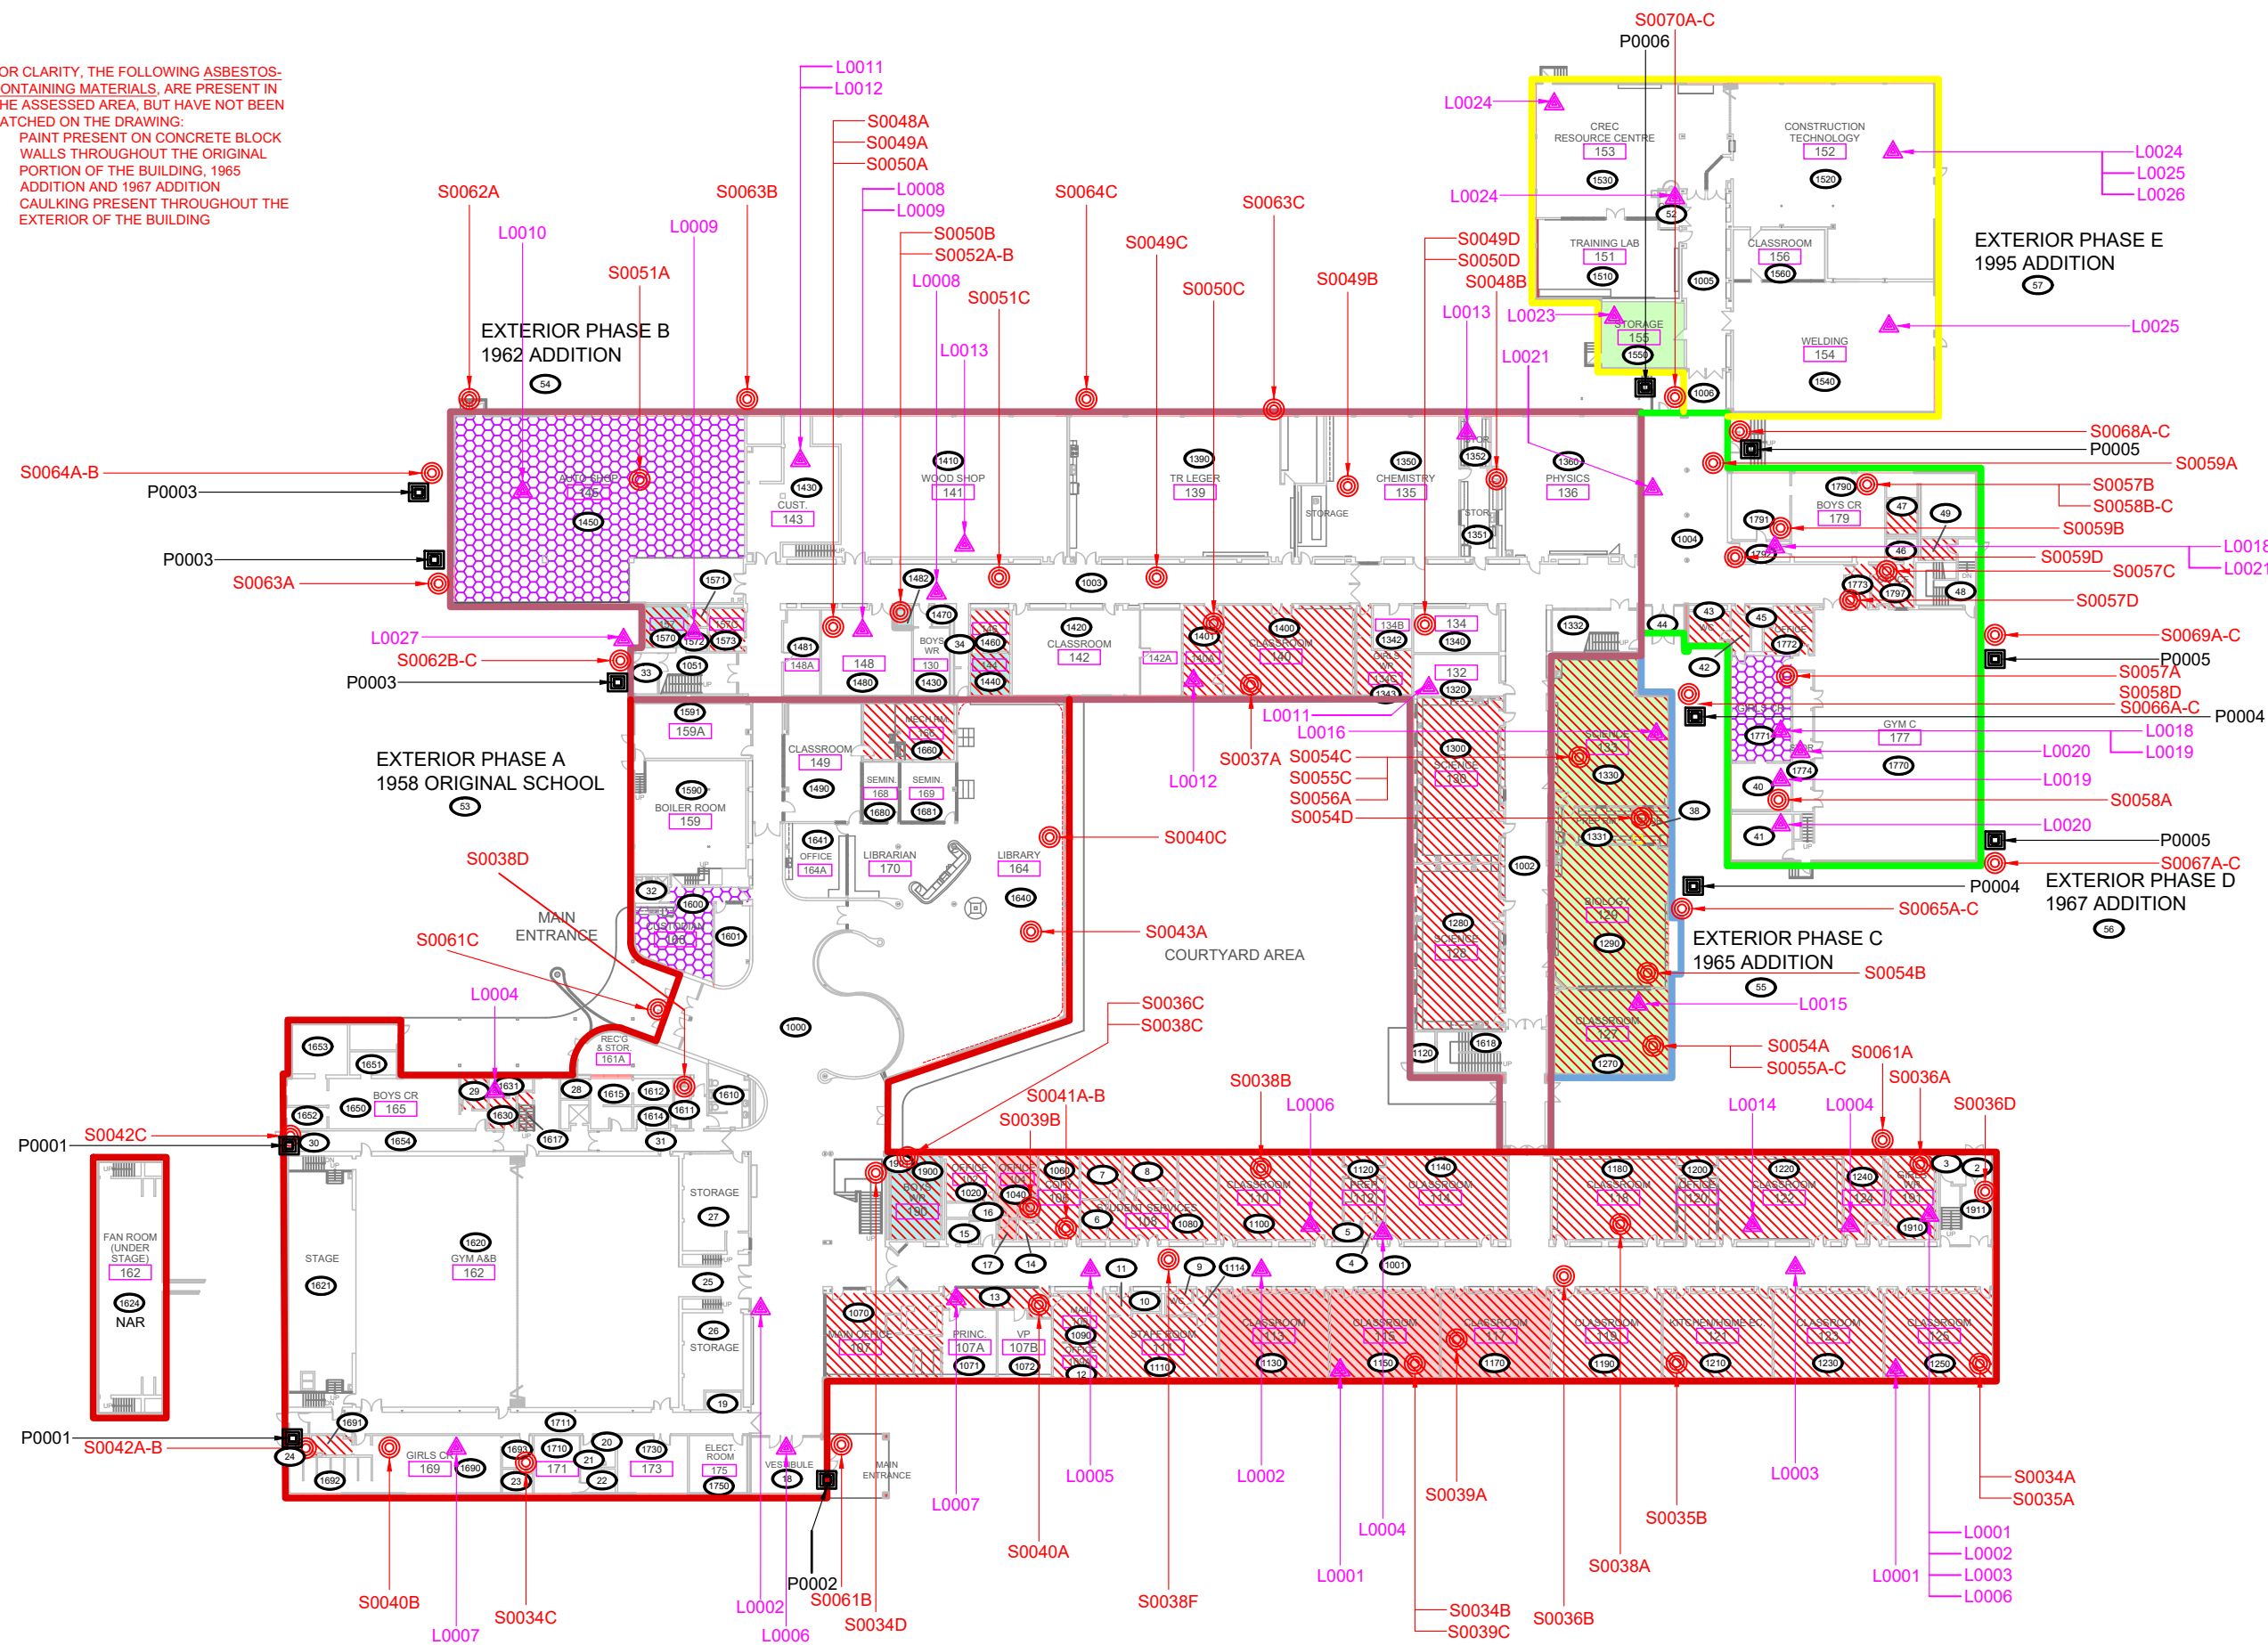

- PAINT PRESENT ON CONCRETE BLOCK WALLS THROUGHOUT THE ORIGINAL PORTION OF THE BUILDING, 1965 ADDITION AND 1967 ADDITION
- CAULKING PRESENT THROUGHOUT THE EXTERIOR OF THE BUILDING








LEGEND

-  ASBESTOS BULK SAMPLE
-  LEAD BULK SAMPLE
-  PCB BULK SAMPLE
-  PINCHIN LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

-  VINYL FLOOR TILES
-  ACOUSTIC TILES
-  VINYL FLOOR TILES & MASTIC
-  THERMAL SYSTEM INSULATION
-  VINYL SHEET FLOORING

- BUILDING PHASE A BOUNDARY (1958)
- BUILDING PHASE B BOUNDARY (1962)
- BUILDING PHASE C BOUNDARY (1965)
- BUILDING PHASE D BOUNDARY (1967)
- BUILDING PHASE E BOUNDARY (1995)

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.



PROJECT NAME:

HAZARDOUS BUILDING MATERIALS ASSESSMENT

CLIENT NAME:

UPPER CANADA
DISTRICT
SCHOOL BOARD

PROJECT LOCATION:

SOUTH GRENVILLE DHS
1000 EDWARD STREET NORTH
PRESCOTT, ONTARIO

FIGURE NAME:

GROUND
FLOOR
PLAN

PROJECT NUMBER:

302783.04

302783.04

NOT TO SCALE

DRAWN BY:

WW

DRAWN BY:

REV

DATE _____



DATE: JULY 202

DATE: _____

1 OF 2

FOR CLARITY, THE FOLLOWING ASBESTOS-CONTAINING MATERIALS, ARE PRESENT IN THE ASSESSED AREA, BUT HAVE NOT BEEN HATCHED ON THE DRAWING:

- PAINT PRESENT ON CONCRETE BLOCK WALLS THROUGHOUT THE ORIGINAL PORTION OF THE BUILDING, 1965 ADDITION AND 1967 ADDITION
- CAULKING PRESENT THROUGHOUT THE EXTERIOR OF THE BUILDING

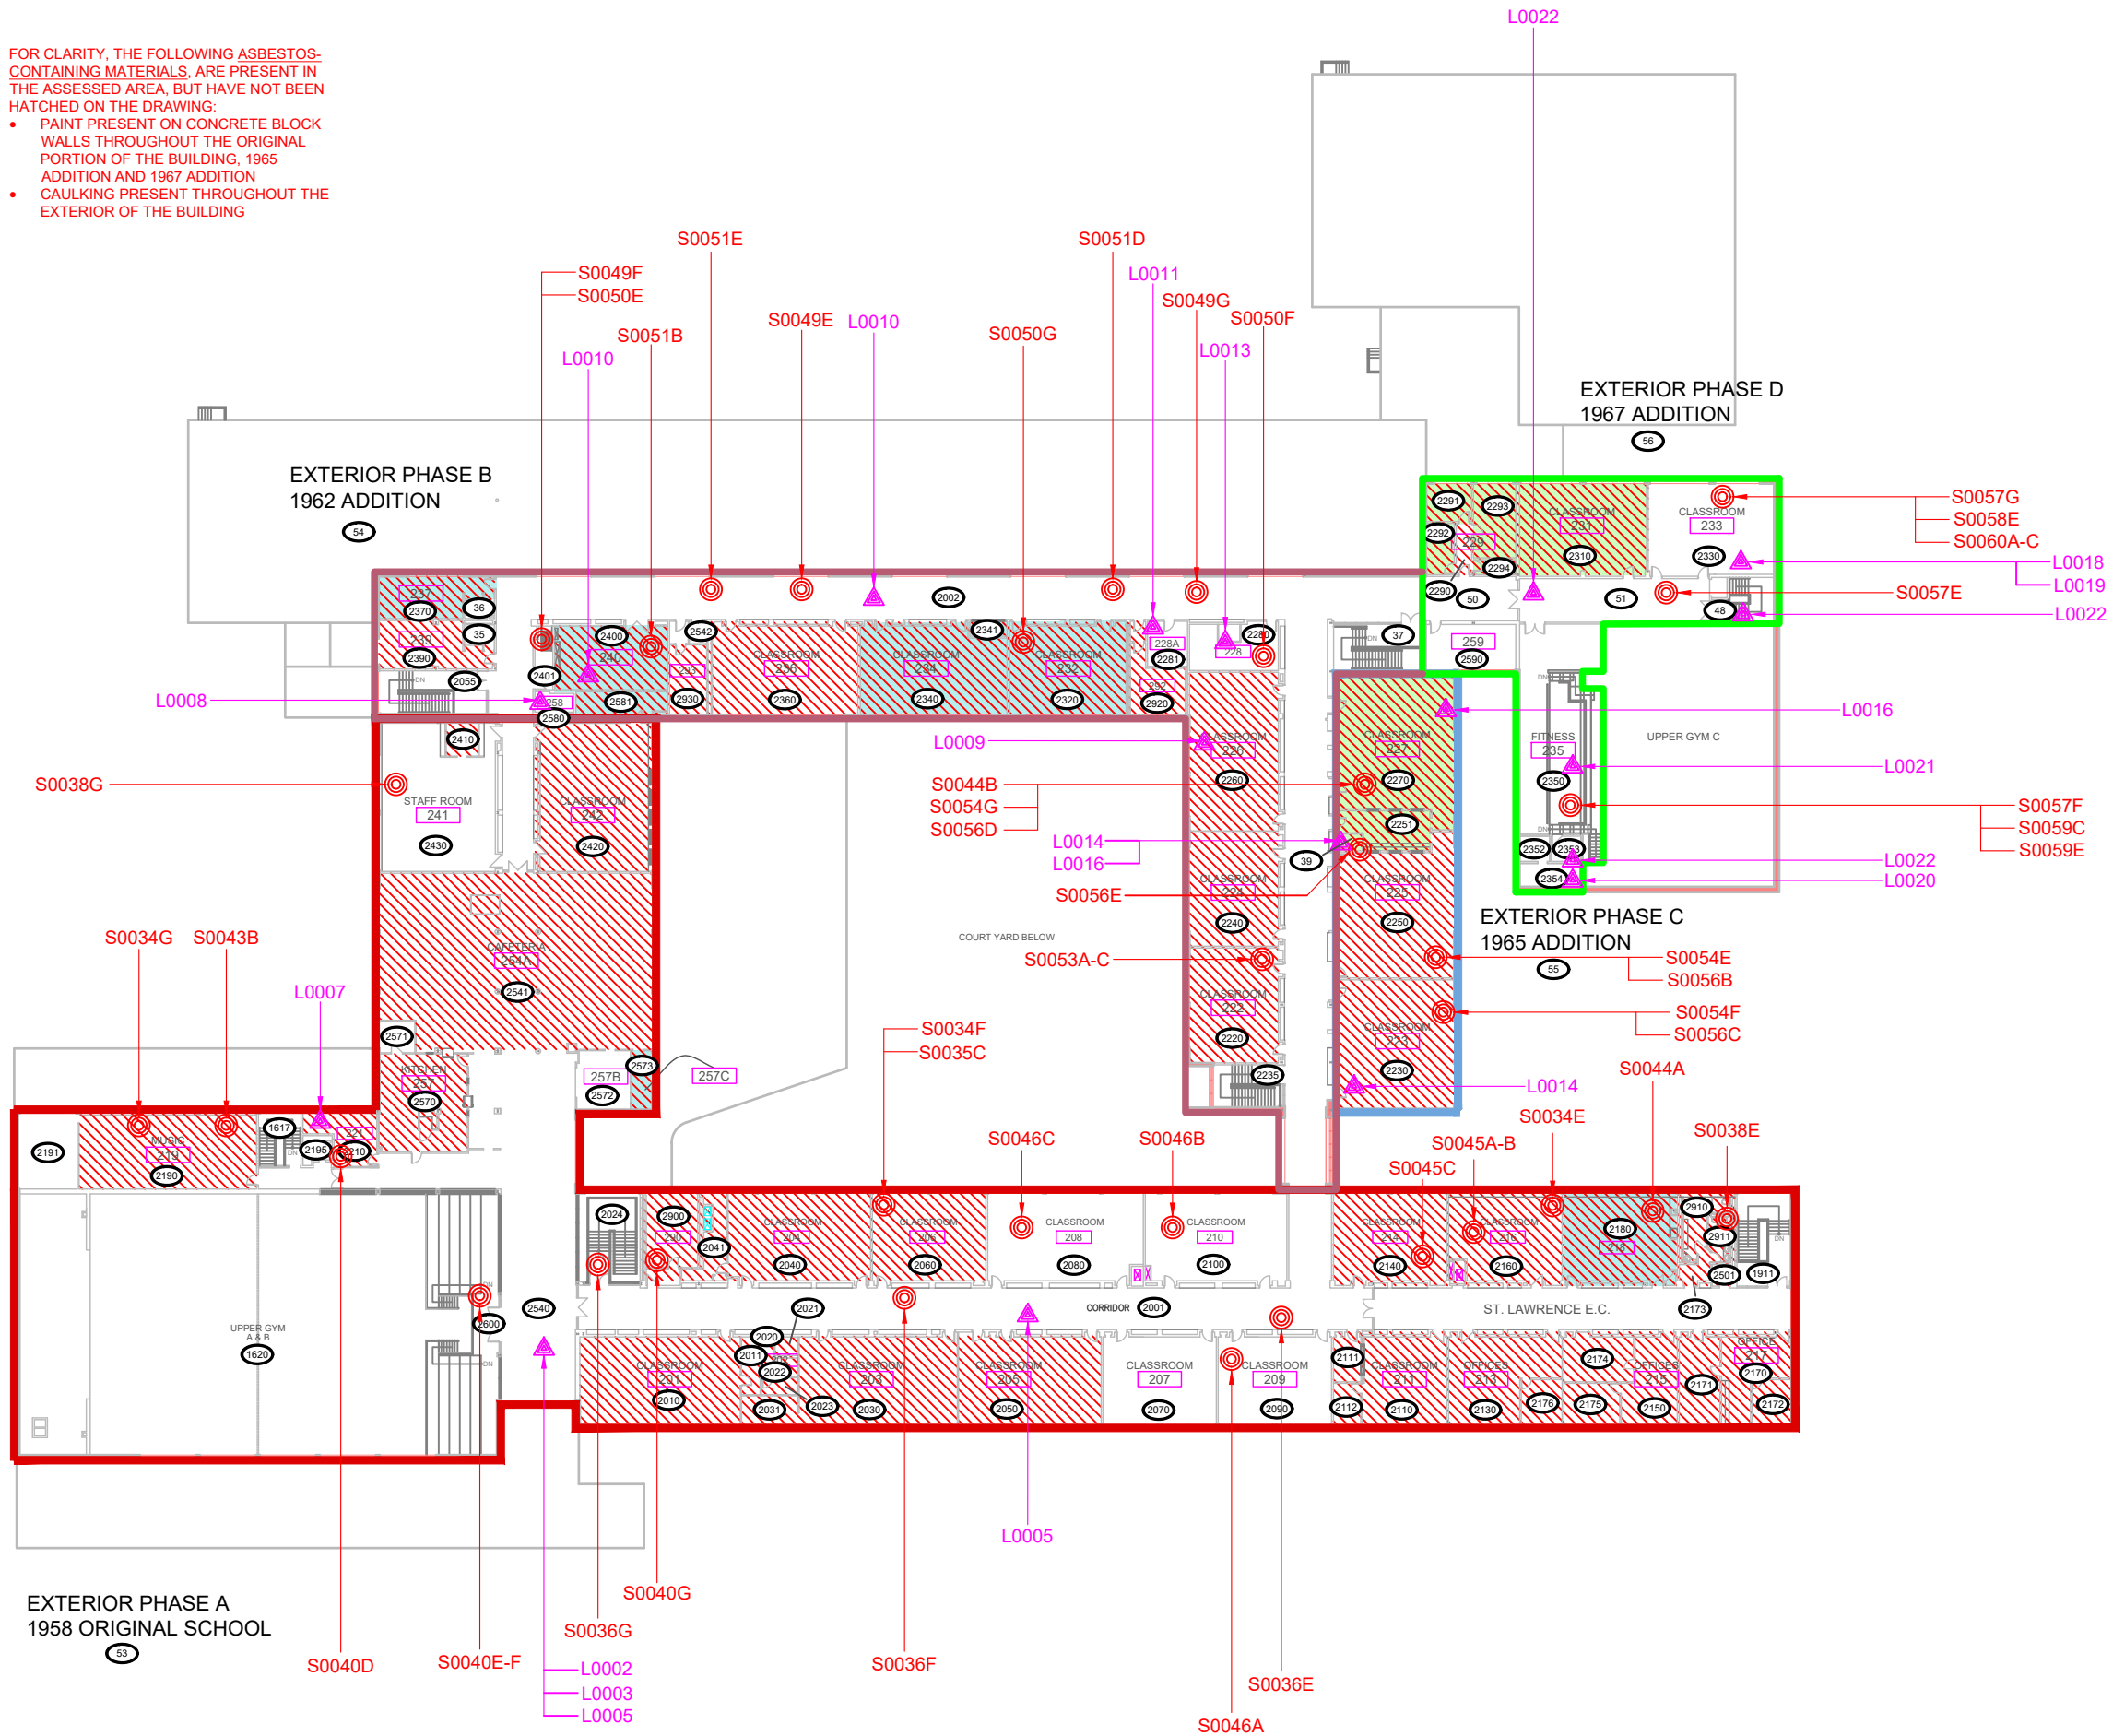

LEGEND

- ASBESTOS BULK SAMPLE
- LEAD BULK SAMPLE
- PCB BULK SAMPLE
- PINCHIN LOCATION NUMBER
- NAR NO ACCESS TO ROOM/AREA
- ASBESTOS-CONTAINING MATERIALS:
 - VINYL FLOOR TILES
 - ACOUSTIC TILES
 - VINYL FLOOR TILES & MASTIC
 - THERMAL SYSTEM INSULATION
 - VINYL SHEET FLOORING
- BUILDING PHASE A BOUNDARY (1958)
- BUILDING PHASE B BOUNDARY (1962)
- BUILDING PHASE C BOUNDARY (1965)
- BUILDING PHASE D BOUNDARY (1967)
- BUILDING PHASE E BOUNDARY (1995)

NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.



PROJECT NAME: HAZARDOUS BUILDING MATERIALS ASSESSMENT	
CLIENT NAME: UPPER CANADA DISTRICT SCHOOL BOARD	
PROJECT LOCATION: SOUTH GRENVILLE DHS 1000 EDWARD STREET NORTH PRESCOTT, ONTARIO	
FIGURE NAME: SECOND FLOOR PLAN	
PROJECT NUMBER: 302783.041	SCALE: NOT TO SCALE
DRAWN BY: WW	REVIEWED BY: MS
DATE: JULY 2023	FIGURE NUMBER: 2 OF 2

TEMPL

APPENDIX II-A
Asbestos Analytical Certificates



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project No.:	0302783.041		
Prepared For:	W. Watson / L. Skoblenick		
Lab Reference No.:	b278892		
Analyst(s):	R. Dacey		
Date Received:	September 15, 2022	Samples Submitted:	25
Date Analyzed:	September 22, 2022	Phases Analyzed:	54

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2017. The Pinchin asbestos laboratory uses the aforementioned methods of analysis.

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

This report relates only to the items tested.

This report relates only to the items tested and is valid only when signed with a protected, authorized, electronic signature. This report may not be reproduced, except in full, without the written approval of Pinchin Ltd. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. Internal verification studies, quality assurance / control data and laboratory documentation on measurement uncertainty are available upon request.



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278892
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0034A Wall, All, Plaster, Loc:1250, Classroom	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
S0034B Wall, All, Plaster, Loc:1150, Classroom	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
S0034C Wall, All, Plaster, Loc:1693, Office	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
S0034D Ceiling, All, Plaster, Loc:1000, Corridor	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
S0034E Wall, All, Plaster, Loc:2160, Classroom	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278892
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0034F Wall, All, Plaster, Loc:2060, Classroom	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
S0034G Wall, All, Plaster, Loc:2190, Music Room	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
S0035A Glue-On Ceiling Tile Mastic, Loc:1250, Classroom	Homogeneous, brown, adhesive material.	None Detected	Talc 0.5-5% Non-Fibrous Material > 75%
Comments:	Cellulose is present on the surface of this sample.		
S0035B Glue-On Ceiling Tile Mastic, Loc:1210, Classroom	Homogeneous, brown, adhesive material.	None Detected	Talc 0.5-5% Non-Fibrous Material > 75%
Comments:	Cellulose is present on the surface of this sample.		
S0035C Glue-On Ceiling Tile Mastic, Loc:2060, Classroom	Homogeneous, brown, adhesive material.	None Detected	Talc 0.5-5% Non-Fibrous Material > 75%
Comments:	Cellulose is present on the surface of this sample.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278892
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0036A Wall, All, Plaster, Textured, Loc:1910, Washroom	3 Phases:		
	a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, clear, adhesive material.	None Detected	Non-Fibrous Material > 75%
S0036B Wall, All, Plaster, Textured, Loc:1001, Corridor	5 Phases:		
	a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, off-white, soft, cementitious material.	None Detected	Non-Fibrous Material > 75%
	d) Homogeneous, grey, soft, cementitious material.	None Detected	Non-Fibrous Material > 75%
	e) Homogeneous, clear, adhesive material.	None Detected	Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278892
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0036C Wall, All, Plaster, Textured, Loc:1901, Vestibule	4 Phases:		
	a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, grey, soft, cementitious material.	None Detected	Non-Fibrous Material > 75%
	d) Homogeneous, clear, adhesive material.	None Detected	Non-Fibrous Material > 75%
S0036D Wall, All, Plaster, Textured, Loc:1911, Stairwell I	4 Phases:		
	a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, grey, soft, cementitious material.	None Detected	Non-Fibrous Material > 75%
	d) Homogeneous, clear, adhesive material.	None Detected	Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278892
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0036E Wall, All, Plaster, Textured, Loc:2001, Corridor	4 Phases:		
	a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, grey, soft, cementitious material.	None Detected	Non-Fibrous Material > 75%
	d) Homogeneous, clear, adhesive material.	None Detected	Non-Fibrous Material > 75%
S0036F Wall, All, Plaster, Textured, Loc:2001, Corridor	4 Phases:		
	a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, grey, soft, cementitious material.	None Detected	Non-Fibrous Material > 75%
	d) Homogeneous, clear, adhesive material.	None Detected	Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278892
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0036G Wall, All, Plaster, Textured, Loc:2024, Stairwell A	4 Phases:		
	a) Homogeneous, beige, hard, cementitious, plaster base coat.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, grey, soft, cementitious material.	None Detected	Non-Fibrous Material > 75%
	d) Homogeneous, clear, adhesive material.	None Detected	Non-Fibrous Material > 75%
S0037A Mastic Under 12x12 VFT Sample 13, Loc:1400, Computer Class	Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0038A Ceiling, All, Drywall And Joint Compound, Loc:1180, Classroom	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0038B Wall, All, Drywall And Joint Compound, Loc:1100, Classroom	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0038C Wall, All, Drywall And Joint Compound, Loc:1901, Vestibule	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278892
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0038D Wall, All, Drywall And Joint Compound, Loc:1611, Handicap w/c	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0038E Ceiling, All, Drywall And Joint Compound, Loc:2911, Womens W/C	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0038F Ceiling, All, Drywall And Joint Compound, Loc:1001, Corridor	2 Phases: a) Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0038G Wall, All, Drywall And Joint Compound, Loc:2430, Kitchen	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		

Reviewed by:

Digitally signed by
Elizabeth DeCurtis
Date: 2022.09.22
16:30:10-04'00'

Reporting Analyst:

Digitally signed by
Elizabeth DeCurtis
Date: 2022.09.22
16:30:30-04'00'

Analyzed by: ROReviewed by: HBReport Sent by: RD

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:		Project Address:	
Portfolio/Building No:		Pinchin File:	302783.041
Submitted by:	Will Watson	Email:	wwatson@pinchin.com
CC Results to:	Laura Skoblenick	CC Email:	lskoblenick@pinchin.com
Date Submitted:	September 14 2022	Required by:	September 21 2022
# of Samples:	441— 25 SPLIT 1/6	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory, Years ONLY):		1958	
Do NOT Stop on Positive (Sample Numbers):		S0034A-G, S0036A-G, S0037A, S0038A-G, S0039A-B, S0040A-G, S0041A-B, S0043A-B, S0044A-B, S0045A-C, S0046A-C, S0048A-B, S0049A-G, S0050A-G, S0051A-E, S0053A-C, S0054A-G, S0055A-C, S0056A-E, S0057A-G, S0058A-E, S0059A-E and S0060A-C	
Pinchin Group Company (Mandatory Field):		Pinchin	
HMIS2 Building Reference #:		109791/202271960841784	
To be Completed by Lab Personnel Only:			
Lab Reference #: <u>6278892 RD</u>		Time:	24 hour clock
Received by: <u>9-15-2022 CH</u>		Date:	Month Day Year
Name(s) of Analyst(s): <u>RO 9.20.22</u>		<u>(54)</u>	
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0034	A	Wall, All, Plaster, Loc: 1250, Classroom <u>also b/m</u>
S	0034	B	Wall, All, Plaster, Loc: 1150, Classroom <u>also b/m</u>
S	0034	C	Wall, All, Plaster, Loc: 1693, Office <u>also b/m</u>
S	0034	D	Ceiling, All, Plaster, Loc: 1000, Corridor <u>also b/m</u>
S	0034	E	Wall, All, Plaster, Loc: 2160, Classroom <u>also b/m</u>
S	0034	F	Wall, All, Plaster, Loc: 2060, Classroom <u>also b/m</u>

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0034	G	Wall, All, Plaster, Loc: 2190, Music Room ND
S	0035	A	Glue-On Ceiling Tile Mastic, Loc: 1250, Classroom (Analyze Mastic Only) ND
S	0035	B	Glue-On Ceiling Tile Mastic, Loc: 1210, Classroom (Analyze Mastic Only) ND
S	0035	C	Glue-On Ceiling Tile Mastic, Loc: 2060, Classroom (Analyze Mastic Only) ND
S	0036	A	Wall, All, Plaster, Textured, Loc: 1910, Washroom ND
S	0036	B	Wall, All, Plaster, Textured, Loc: 1001, Corridor ND
S	0036	C	Wall, All, Plaster, Textured, Loc: 1901, Vestibule ND
S	0036	D	Wall, All, Plaster, Textured, Loc: 1911, Stairwell I ND
S	0036	E	Wall, All, Plaster, Textured, Loc: 2001, Corridor ND
S	0036	F	Wall, All, Plaster, Textured, Loc: 2001, Corridor ND
S	0036	G	Wall, All, Plaster, Textured, Loc: 2024, Stairwell A ND
S	0037	A	Mastic Under 12x12 VFT Sample 13, Loc: 1400, Computer Class (Analyze Mastic Only) ND
S	0038	A	Ceiling, All, Drywall And Joint Compound, Loc: 1180, Classroom ND
S	0038	B	Wall, All, Drywall And Joint Compound, Loc: 1100, Classroom ND
S	0038	C	Wall, All, Drywall And Joint Compound, Loc: 1901, Vestibule ND
S	0038	D	Wall, All, Drywall And Joint Compound, Loc: 1611, Handicap w/c ND

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0038	E	Ceiling, All, Drywall And Joint Compound, Loc: 2911, Womens W/C <i>ND</i>
S	0038	F	Ceiling, All, Drywall And Joint Compound, Loc: 1001, Corridor <i>AND 6/ND</i>
S	0038	G	Wall, All, Drywall And Joint Compound, Loc: 2430, Kitchen <i>ND</i>

4



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project No.:	0302783.041		
Prepared For:	W. Watson / L. Skoblenick		
Lab Reference No.:	b278895		
Analyst(s):	M. Tiggos		
Date Received:	September 15, 2022	Samples Submitted:	27
Date Analyzed:	September 22, 2022	Phases Analyzed:	39

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2017. The Pinchin asbestos laboratory uses the aforementioned methods of analysis.

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

This report relates only to the items tested.

This report relates only to the items tested and is valid only when signed with a protected, authorized, electronic signature. This report may not be reproduced, except in full, without the written approval of Pinchin Ltd. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. Internal verification studies, quality assurance / control data and laboratory documentation on measurement uncertainty are available upon request.



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278895
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0039A Mastic Under VSF Sample 19, Loc: 1170, Classroom (Analyze Mastic Only)	Homogeneous, yellow, adhesive material on the back of vinyl sheet flooring.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0039B Mastic Under VSF Sample 19, Loc: 1040, Health Room (Analyze Mastic Only)	Homogeneous, yellow, adhesive material on the back of vinyl sheet flooring.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0039C Mastic Under VSF Sample 19, Loc: 1150, Classroom (Analyze Mastic Only)	Homogeneous, yellow, adhesive material on the back of vinyl sheet flooring.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0040A Wall, All, Paint, Concrete Block, Loc: 13, Corridor (Analyze Paint Only)	Homogeneous, off-white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0040B Wall, All, Paint, Concrete Block, Loc: 1690, Girls Changeroom (Analyze Paint Only)	Non-homogeneous, off-white and green, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278895
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0040C Wall, All, Paint, Concrete Block, Loc: 1640, Library (Analyze Paint Only)	Homogeneous, off-white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0040D Wall, All, Paint, Concrete Block, Loc: 2210, Staff Room (Analyze Paint Only)	Homogeneous, white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0040E Wall, All, Paint, Concrete Block, Loc: 2600, Bleachers (Analyze Paint Only)	Homogeneous, off-white, coating material.	None Detected	Non-Fibrous Material > 75%
S0040F Wall, All, Paint, Concrete Block, Loc: 2600, Bleachers (Analyze Paint Only)	Homogeneous, off-white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0040G Wall, All, Paint, Concrete Block, Loc: 2900, Girls W/C (Analyze Paint Only)	Homogeneous, off-white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0041A Mastic Under VSF Sample 22, Loc: 1060, Copy	Homogeneous, yellow, adhesive material on the back of vinyl sheet flooring.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278895
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0041B Mastic Under VSF Sample 22, Loc: 1060, Copy	Homogeneous, yellow, adhesive material on the back of vinyl sheet flooring.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0042A Wall, Door, Caulking, Beige, Loc: 24, Vestibule	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0042B Wall, Door, Caulking, Beige, Loc: 24, Vestibule	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0042C Wall, Door, Caulking, Beige, Loc: 30, Vestibule	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0043A Mastic Under 12x12 VFT Sample 5, Loc: 1640, Library	Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0043B Mastic Under 12x12 VFT Sample 5, Loc: 2190, Music Room	Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0044A Mastic Under 12x12 VFT Sample 29, Loc: 2180, Classroom	Non-homogeneous, yellow and black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278895
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0044B Mastic Under 12x12 VFT Sample 29,Loc:2270,Classroom	Non-homogeneous, yellow and black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0045A Floor,All,Vinyl Floor Tile And Mastic,12x12 Peach With Blue And White Smears,Loc:2160,Classroom	2 Phases: a) Homogeneous, peach, consolidated, vinyl floor tile. b) Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected None Detected	Non-Fibrous Material > 75% Tar and other non-fibrous material > 75%
S0045B Floor,All,Vinyl Floor Tile And Mastic,12x12 Peach With Blue And White Smears,Loc:2160,Classroom	2 Phases: a) Homogeneous, peach, consolidated, vinyl floor tile. b) Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected None Detected	Non-Fibrous Material > 75% Tar and other non-fibrous material > 75%
S0045C Floor,All,Vinyl Floor Tile And Mastic,12x12 Peach With Blue And White Smears,Loc:2140,Classroom	3 Phases: a) Homogeneous, peach, consolidated, vinyl floor tile. b) Homogeneous, black, soft, sticky material on the back of vinyl floor tile. c) Homogeneous, brown, soft, sticky material on the back of vinyl floor tile.	None Detected None Detected None Detected	Non-Fibrous Material > 75% Tar and other non-fibrous material > 75% Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278895
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0046A Floor,All,Vinyl Floor Tile And Mastic,12x12 White With Blue And Grey Smears,Loc:2090,Classroom	3 Phases: a) Homogeneous, white, consolidated, vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
	c) Homogeneous, grey, levelling compound.	None Detected	Non-Fibrous Material > 75%
S0046B Floor,All,Vinyl Floor Tile And Mastic,12x12 White With Blue And Grey Smears,Loc:2100,Classroom	3 Phases: a) Homogeneous, white, consolidated, vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
	c) Homogeneous, grey, levelling compound.	None Detected	Non-Fibrous Material > 75%
S0046C Floor,All,Vinyl Floor Tile And Mastic,12x12 White With Blue And Grey Smears,Loc:2080,Classroom	3 Phases: a) Homogeneous, white, consolidated, vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
	c) Homogeneous, grey, levelling compound.	None Detected	Non-Fibrous Material >75%
Comments:	Phase c) is small in size.		



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278895
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0048A Mastic Under 12x12 VFT Sample 7, Loc: 1480, Office	2 Phases: a) Homogeneous, yellow, soft, sticky material on the back of vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested. Phase b) is small in size.		
S0048B Mastic Under 12x12 VFT Sample 7, Loc: 1351, Chemical Office	2 Phases: a) Homogeneous, yellow, soft, sticky material on the back of vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non-fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		

Reviewed by:

Digitally signed by
Elizabeth DeCurtis
Date: 2022.09.22
15:56:35-04'00'

Reporting Analyst:

Digitally signed by
Elizabeth DeCurtis
Date: 2022.09.22
15:56:49-04'00'

Analyzed by: MT 9/22/2022
 Reviewed by: KB
 Report Sent by: XD

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:		Project Address:	
Portfolio/Building No:		Pinchin File: 302783.041	
Submitted by:	Will Watson	Email:	wwatson@pinchin.com
CC Results to:	Laura Skoblenick	CC Email:	lskoblenick@pinchin.com
Date Submitted:	September 14 2022	Required by:	September 21 2022
# of Samples:	141- 27 SPLIT 2/6	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory, Years ONLY):		1958	
Do NOT Stop on Positive (Sample Numbers):		S0034A-G, S0036A-G, S0037A, S0038A-G, S0039A-B, S0040A-G, S0041A-B, S0043A-B, S0044A-B, S0045A-C, S0046A-C, S0048A-B, S0049A-G, S0050A-G, S0051A-E, S0053A-C, S0054A-G, S0055A-C, S0056A-E, S0057A-G, S0058A-E, S0059A-E and S0060A-C	
Pinchin Group Company (Mandatory Field):		Pinchin	
HMIS2 Building Reference #:		109791/202271960841784	
To be Completed by Lab Personnel Only:			
Lab Reference #: <u>6278895 ID</u>		Time:	24 hour clock
Received by:	9-15-2022 CH	Date:	Month Day Year
Name(s) of Analyst(s):		<u>phases — 39</u>	
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0039	A	Mastic Under VSF Sample 19, Loc: 1170, Classroom (Analyze Mastic Only) <u>ND</u>
S	0039	B	Mastic Under VSF Sample 19, Loc: 1040, Health Room (Analyze Mastic Only) <u>ND</u>
S	0039	C	Mastic Under VSF Sample 19, Loc: 1150, Classroom (Analyze Mastic Only) <u>ND</u>
S	0040	A	Wall, All, Paint, Concrete Block, Loc: 13, Corridor (Analyze Paint Only) <u>ND</u>
S	0040	B	Wall, All, Paint, Concrete Block, Loc: 1690, Girls Changeroom (Analyze Paint Only) <u>ND</u>
S	0040	C	Wall, All, Paint, Concrete Block, Loc: 1640, Library (Analyze Paint Only) <u>ND</u>

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0040	D	Wall, All, Paint, Concrete Block, Loc: 2210, Staff Room (Analyze Paint Only) <i>ND</i>
S	0040	E	Wall, All, Paint, Concrete Block, Loc: 2600, Bleachers (Analyze Paint Only) <i>ND</i>
S	0040	F	Wall, All, Paint, Concrete Block, Loc: 2600, Bleachers (Analyze Paint Only) <i>ND</i>
S	0040	G	Wall, All, Paint, Concrete Block, Loc: 2900, Girls W/C (Analyze Paint Only) <i>ND</i>
S	0041	A	Mastic Under VSF Sample 22, Loc: 1060, Copy (Analyze Mastic Only) <i>ND</i>
S	0041	B	Mastic Under VSF Sample 22, Loc: 1060, Copy (Analyze Mastic Only) <i>ND</i>
S	0042	A	Wall, Door, Caulking, Beige, Loc: 24, Vestibule <i>ND</i>
S	0042	B	Wall, Door, Caulking, Beige, Loc: 24, Vestibule <i>ND</i>
S	0042	C	Wall, Door, Caulking, Beige, Loc: 30, Vestibule <i>ND</i>
S	0043	A	Mastic Under 12x12 VFT Sample 5, Loc: 1640, Library (Analyze Mastic Only) <i>ND</i>
S	0043	B	Mastic Under 12x12 VFT Sample 5, Loc: 2190, Music Room (Analyze Mastic Only) <i>ND</i>
S	0044	A	Mastic Under 12x12 VFT Sample 29, Loc: 2180, Classroom (Analyze Mastic Only) <i>ND</i>
S	0044	B	Mastic Under 12x12 VFT Sample 29, Loc: 2270, Classroom (Analyze Mastic Only) <i>ND</i>
S	0045	A	Floor, All, Vinyl Floor Tile And Mastic, 12x12 Peach With Blue And White Smears, Loc: 2160, Classroom (Analyze Mastic Too) <i>a/ND 1/ND</i>
S	0045	B	Floor, All, Vinyl Floor Tile And Mastic, 12x12 Peach With Blue And White Smears, Loc: 2160, Classroom (Analyze Mastic Too) <i>a/ND 1/ND</i>
S	0045	C	Floor, All, Vinyl Floor Tile And Mastic, 12x12 Peach With Blue And White Smears, Loc: 2140, Classroom (Analyze Mastic Too) <i>a/ND 1/ND</i>

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0046	A	Floor, All, Vinyl Floor Tile And Mastic, 12x12 White With Blue And Grey Smears, Loc:2090, Classroom (Analyze Mastic Too) a/nog b/nog c/nog
S	0046	B	Floor, All, Vinyl Floor Tile And Mastic, 12x12 White With Blue And Grey Smears, Loc:2100, Classroom (Analyze Mastic Too) a/nog b/nog c/nog
S	0046	C	Floor, All, Vinyl Floor Tile And Mastic, 12x12 White With Blue And Grey Smears, Loc:2080, Classroom (Analyze Mastic Too) a/nog b/nog c/nog
S	0048	A	Mastic Under 12x12 VFT Sample 7, Loc:1480, Office (Analyze Mastic Only) a/nog b/nog
S	0048	B	Mastic Under 12x12 VFT Sample 7, Loc:1351, Chemical Office (Analyze Mastic Only) a/nog b/nog

13
 20
 6
 39



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project No.:	0302783.041		
Prepared For:	W. Watson / L. Skoblenick		
Lab Reference No.:	b278896		
Analyst(s):	T. Tran		
Date Received:	September 15, 2022	Samples Submitted:	24
Date Analyzed:	September 22, 2022	Phases Analyzed:	29

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2017. The Pinchin asbestos laboratory uses the aforementioned methods of analysis.

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

This report relates only to the items tested.

This report relates only to the items tested and is valid only when signed with a protected, authorized, electronic signature. This report may not be reproduced, except in full, without the written approval of Pinchin Ltd. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. Internal verification studies, quality assurance / control data and laboratory documentation on measurement uncertainty are available upon request.



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278896
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0049A Wall, All, Drywall And Joint Compound, Loc: 1480, Office	Homogeneous, white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0049B Wall, All, Drywall And Joint Compound, Loc: 1350, Chemical Lab	Homogeneous, white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0049C Ceiling, All, Drywall And Joint Compound, Loc: 1003, Corridor	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0049D Ceiling, All, Drywall And Joint Compound, Loc: 1340, Storage/Mech	Homogeneous, white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0049E Ceiling, All, Drywall And Joint Compound, Loc: 2002, Corridor	Homogeneous, white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278896
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0049F Wall, All, Drywall And Joint Compound, Loc: 2401, Storage Roof-Hatch	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0049G Ceiling, All, Drywall And Joint Compound, Loc: 2002, Corridor	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0050A Wall, All, Paint, Loc: 1480, Office	Homogeneous, white and green, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0050B Wall, All, Paint, Loc: 1482, Woodworking Storage	Homogeneous, white and green, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0050C Wall, All, Paint, Loc: 1401, Office	Homogeneous, beige and off-white, caulking material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0050D Wall, All, Paint, Loc: 1340, Storage/Mech	Homogeneous, beige and green, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278896
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0050E Wall, All, Paint, Loc: 2401, Storage Roof-Hatch	Homogeneous, beige and green, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0050F Wall, All, Paint, Loc: 2280, Fan Room	Homogeneous, beige and green, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0050G Wall, All, Paint, Loc: 2320, Classroom	Homogeneous, beige and green, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0051A Ceiling, All, Plaster, Loc: 1450, Autoshop	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Cellulose < 0.5% Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0051B Ceiling, All, Plaster, Loc: 2400, Storage	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278896
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0051C Wall, All, Plastic, Loc: 1003, Corridor	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0051D Ceiling, All, Plaster, Loc: 2002, Corridor	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0051E Wall, All, Plaster, Loc: 2002, Corridor	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0052A Glue-On Ceiling Tile Mastic For Sample 15, Loc: 1482, Woodworking Storage	Homogeneous, brown, hard, adhesive material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested. Cellulose is present on the surface of this sample.		



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278896
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0052B Glue-On Ceiling Tile Mastic For Sample 15, Loc: 1482, Woodworking Storage	Homogeneous, brown, hard, adhesive material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed, as requested. Cellulose is present on the surface of this sample.		
S0053A Mastic Under 12x12 VFT Sample 31, Loc: 2220, Classroom	Non-homogeneous, black and pale yellow, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non- fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0053B Mastic Under 12x12 VFT Sample 31, Loc: 2220, Classroom	Homogeneous, black, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non- fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		
S0053C Mastic Under 12x12 VFT Sample 31, Loc: 2220, Classroom	Non-homogeneous, black and yellow, soft, sticky material on the back of vinyl floor tile.	None Detected	Tar and other non- fibrous material > 75%
Comments:	Another phase is present but was not analyzed, as requested.		

Reviewed by:

Digitally signed by
Elizabeth DeCurtis
Date: 2022.09.22
16:25:52-04'00'

Reporting Analyst:

Digitally signed by
Elizabeth DeCurtis
Date: 2022.09.22
16:25:33-04'00'

Analyzed by:

Reviewed by:

Report Sent by:

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:		Project Address:	
Portfolio/Building No:		Pinchin File:	302783.041
Submitted by:	Will Watson	Email:	wwatson@pinchin.com
CC Results to:	Laura Skoblenick	CC Email:	lskoblenick@pinchin.com
Date Submitted:	September 14 2022	Required by:	September 21 2022
# of Samples:	441 24 SPLIT File 3/6	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory, Years ONLY):		1958	
Do NOT Stop on Positive (Sample Numbers):		S0034A-G, S0036A-G, S0037A, S0038A-G, S0039A-B, S0040A-G, S0041A-B, S0043A-B, S0044A-B, S0045A-C, S0046A-C, S0048A-B, S0049A-G, S0050A-G, S0051A-E, S0053A-C, S0054A-G, S0055A-C, S0056A-E, S0057A-G, S0058A-E, S0059A-E and S0060A-C	
Pinchin Group Company (Mandatory Field):		Pinchin	
HMIS2 Building Reference #:		109791/202271960841784	
To be Completed by Lab Personnel Only:			
Lab Reference #: 6278896		Time:	24 hour clock
Received by: 9-15-2022 CH		Date:	Month Day Year
Name(s) of Analyst(s): Mian		Sept 22/22	
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0049	A	Wall, All, Drywall And Joint Compound, Loc: 1480, Office ND
S	0049	B	Wall, All, Drywall And Joint Compound, Loc: 1350, Chemical Lab ND
S	0049	C	Ceiling, All, Drywall And Joint Compound, Loc: 1003, Corridor ND
S	0049	D	Ceiling, All, Drywall And Joint Compound, Loc: 1340, Storage/Mech ND
S	0049	E	Ceiling, All, Drywall And Joint Compound, Loc: 2002, Corridor ND
S	0049	F	Wall, All, Drywall And Joint Compound, Loc: 2401, Storage Roof-Hatch ND

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0049	G	Ceiling, All, Drywall And Joint Compound, Loc: 2002, Corridor ND
S	0050	A	Wall, All, Paint, Loc: 1480, Office (Analyze Paint Only) ND
S	0050	B	Wall, All, Paint, Loc: 1482, Woodworking Storage (Analyze Paint Only) ND
S	0050	C	Wall, All, Paint, Loc: 1401, Office (Analyze Paint Only) CH.O.S.S
S	0050	D	Wall, All, Paint, Loc: 1340, Storage/Mech (Analyze Paint Only) ND
S	0050	E	Wall, All, Paint, Loc: 2401, Storage Roof-Hatch (Analyze Paint Only) ND
S	0050	F	Wall, All, Paint, Loc: 2280, Fan Room (Analyze Paint Only) ND
S	0050	G	Wall, All, Paint, Loc: 2320, Classroom (Analyze Paint Only) ND
S	0051	A	Ceiling, All, Plaster, Loc: 1450, Autoshop A) ND B) ND
S	0051	B	Ceiling, All, Plaster, Loc: 2400, Storage A) ND B) ND
S	0051	C	Wall, All, Plastic, Loc: 1003, Corridor A) ND B) ND
S	0051	D	Ceiling, All, Plaster, Loc: 2002, Corridor A) ND B) ND
S	0051	E	Wall, All, Plaster, Loc: 2002, Corridor A) ND B) ND
S	0052	A	Glue-On Ceiling Tile Mastic For Sample 15, Loc: 1482, Woodworking Storage (Analyze Mastic Only) ND
S	0052	B	Glue-On Ceiling Tile Mastic For Sample 15, Loc: 1482, Woodworking Storage (Analyze Mastic Only) ND
S	0053	A	Mastic Under 12x12 VFT Sample 31, Loc: 2220, Classroom (Analyze Mastic Only) ND

(21)

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0053	B	Mastic Under 12x12 VFT Sample 31, Loc:2220, Classroom (Analyze Mastic Only) ND
S	0053	C	Mastic Under 12x12 VFT Sample 31, Loc:2220, Classroom (Analyze Mastic Only) ND

②



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project No.:	0302783.041		
Prepared For:	W. Watson / L. Skoblenick		
Lab Reference No.:	b278898		
Analyst(s):	A. Di Giulio / M. Tipgos / A. Williams / J. Raisch-Berkoff		
Date Received:	September 15, 2022	Samples Submitted:	27
Date Analyzed:	September 22, 2022	Phases Analyzed:	35

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2017. The Pinchin asbestos laboratory uses the aforementioned methods of analysis.

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

This report relates only to the items tested.

This report relates only to the items tested and is valid only when signed with a protected, authorized, electronic signature. This report may not be reproduced, except in full, without the written approval of Pinchin Ltd. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. Internal verification studies, quality assurance / control data and laboratory documentation on measurement uncertainty are available upon request.



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278898
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0054A Wall, All, Paint, Loc:1270, Staff Room (Analyze Paint Only)	Non-homogeneous, off- white, coating material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0054B Wall, All, Paint, Loc:1290, Classroom (Analyze Paint Only)	Non-homogeneous, off- white, coating material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0054C Wall, All, Paint, Loc:1330, Classroom (Analyze Paint Only)	Non-homogeneous, off- white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0054D Wall, All, Paint, Loc:38, Storage (Analyze Paint Only)	Non-homogeneous, off- white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0054E Wall, All, Paint, Loc:2250, Classroom (Analyze Paint Only)	Non-homogeneous, off- white, coating material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0054F Wall, All, Paint, Loc:2230, Classroom (Analyze Paint Only)	Non-homogeneous, off- white, coating material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278898
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0054G Wall, All, Paint, Loc:2270, Classroom (Analyze Paint Only)	Non-homogeneous, off-white, coating material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0055A Ceiling, All, Plaster, Loc:1270, Staff Room	2 Phases: a) Homogeneous, grey, hard, cementitious material. b) Homogeneous, white, hard, cementitious material.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0055B Ceiling, All, Plaster, Loc:1270, Staff Room	2 Phases: a) Homogeneous, grey, hard, cementitious material. b) Homogeneous, white, hard, cementitious material.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0055C Ceiling, All, Plaster, Loc:1270, Staff Room	2 Phases: a) Homogeneous, grey, hard, cementitious material. b) Homogeneous, white, hard, cementitious material.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0056A Wall, All, Drywall And Joint Compound, Loc:1330, Classroom	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278898
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0056B Ceiling, All, Drywall And Joint Compound, Loc:2250, Classroom	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0056C Ceiling, All, Plaster, Loc:2230, Classroom	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0056D Ceiling, All, Drywall And Joint Compound, Loc:2270, Classroom	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0056E Wall, All, Drywall And Joint Compound, Loc:39, Server Room	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0057A Wall, All, Paint, Loc:1771, Girls Changeroom (Analyze Paint Only)	Non-homogeneous, green and off-white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0057B Wall, All, Paint, Loc:1790, Boy's Changeroom (Analyze Paint Only)	Non-homogeneous, green and off-white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0057C Wall, All, Paint, Loc:1797, Office (Analyze Paint Only)	Homogeneous, off-white, coating material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278898
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0057D Wall, All, Paint, Loc:1773, Storage (Analyze Paint Only)	Homogeneous, beige, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0057E Wall, All, Paint, Loc:51, Corridor (Analyze Paint Only)	Homogeneous, off-white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0057F Wall, All, Paint, Loc:2350, Weight Room (Analyze Paint Only)	Homogeneous, off-white, coating material.	None Detected	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0057G Wall, All, Paint, Loc:2330, Drama Class (Analyze Paint Only)	Homogeneous, off-white, coating material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
Comments:	Another phase is present but was not analyzed as requested.		
S0058A Ceiling, All, Plaster, Loc:40, Girl's Shower	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	Chrysotile < 0.5% None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0058B Ceiling, All, Plaster, Loc:1790, Boy's Changeroom	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278898
Date Analyzed: September 22, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0058C Ceiling, All, Plaster, Loc:1790, Boy's Changeroom	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0058D Ceiling, All, Plaster, Loc:1771, Girls Changeroom	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%
S0058E Ceiling, All, Plaster, Loc:2330, Drama Class	2 Phases: a) Homogeneous, beige, hard, cementitious, plaster base coat. b) Homogeneous, white, hard, cementitious, plaster top coat.	None Detected None Detected	Perlite 10-25% Other Non-Fibrous > 75% Non-Fibrous Material > 75%

Reviewed by:

Digitally signed by John
Raisch-Berkoff
Date: 2022-09-22 18:00:51

Reporting Analyst:

Digitally signed by
John Raisch-Berkoff
Date: 2022-09-22
18:01:13

Analyzed by: MT 9/22/2022
 Reviewed by: JRB
 Report Sent by: JRB

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:		Project Address:	
Portfolio/Building No:		Pinchin File: 302783.041	
Submitted by:	Will Watson	Email:	wwatson@pinchin.com
CC Results to:	Laura Skoblenick	CC Email:	lskoblenick@pinchin.com
Date Submitted:	September 14 2022	Required by:	September 21 2022
# of Samples:	141 27 SPLIT 4/6	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory, Years ONLY):		1958	
Do NOT Stop on Positive (Sample Numbers):		S0034A-G, S0036A-G, S0037A, S0038A-G, S0039A-B, S0040A-G, S0041A-B, S0043A-B, S0044A-B, S0045A-C, S0046A-C, S0048A-B, S0049A-G, S0050A-G, S0051A-E, S0053A-C, S0054A-G, S0055A-C, S0056A-E, S0057A-G, S0058A-E, S0059A-E and S0060A-C	
Pinchin Group Company (Mandatory Field):		Pinchin	
HMIS2 Building Reference #:		109791/202271960841784	
To be Completed by Lab Personnel Only: (do not stop all)			
Lab Reference #: 6278898 JD		Time: 24 hour clock	
Received by:		Date: Month Day Year	
Name(s) of Analyst(s): AD/AZW/MT/JRB		phases -35	
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0054	A	Wall, All, Paint, Loc: 1270, Staff Room (Analyze Paint Only) CH0551
S	0054	B	Wall, All, Paint, Loc: 1290, Classroom (Analyze Paint Only) CH0551
S	0054	C	Wall, All, Paint, Loc: 1330, Classroom (Analyze Paint Only) ND
S	0054	D	Wall, All, Paint, Loc: 38, Storage (Analyze Paint Only) ND
S	0054	E	Wall, All, Paint, Loc: 2250, Classroom (Analyze Paint Only) CH0551
S	0054	F	Wall, All, Paint, Loc: 2230, Classroom (Analyze Paint Only) CH0551

6

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0054	G	Wall, All, Paint, Loc: 2270, Classroom (Analyze Paint Only) CH 0.5-5%
S	0055	A	Ceiling, All, Plaster, Loc: 1270, Staff Room AND BND
S	0055	B	Ceiling, All, Plaster, Loc: 1270, Staff Room AND BND
S	0055	C	Ceiling, All, Plaster, Loc: 1270, Staff Room AND BND
S	0056	A	Wall, All, Drywall And Joint Compound, Loc: 1330, Classroom ND
S	0056	B	Ceiling, All, Drywall And Joint Compound, Loc: 2250, Classroom ND
S	0056	C	Ceiling, All, Plaster, Loc: 2230, Classroom ND
S	0056	D	Ceiling, All, Drywall And Joint Compound, Loc: 2270, Classroom ND
S	0056	E	Wall, All, Drywall And Joint Compound, Loc: 39, Server Room ND
S	0057	A	Wall, All, Paint, Loc: 1771, Girls Changeroom (Analyze Paint Only) ND
S	0057	B	Wall, All, Paint, Loc: 1790, Boy's Changeroom (Analyze Paint Only) ND
S	0057	C	Wall, All, Paint, Loc: 1797, Office (Analyze Paint Only) CH 0.5-5% CH 2.0-5%
S	0057	D	Wall, All, Paint, Loc: 1773, Storage (Analyze Paint Only) ND
S	0057	E	Wall, All, Paint, Loc: 51, Corridor (Analyze Paint Only) ND
S	0057	F	Wall, All, Paint, Loc: 2350, Weight Room (Analyze Paint Only) ND
S	0057	G	Wall, All, Paint, Loc: 2330, Drama Class (Analyze Paint Only) CH 0.5-5%

19

A2W [JRB]

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0058	A	Ceiling, All, Plaster, Loc: 40, Girl's Shower CHC 0.5% a) ND b) ND
S	0058	B	Ceiling, All, Plaster, Loc: 1790, Boy's Changeroom a) ND b) ND
S	0058	C	Ceiling, All, Plaster, Loc: 1790, Boy's Changeroom a) ND b) ND
S	0058	D	Ceiling, All, Plaster, Loc: 1771, Girls Changeroom a) ND b) ND
S	0058	E	Ceiling, All, Plaster, Loc: 2330, Drama Class a) ND b) ND

1
10
19
6
35



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project No.:	0302783.041		
Prepared For:	W. Watson / L. Skoblenick		
Lab Reference No.:	b278900		
Analyst(s):	E. Cianni / K. Cockburn		
Date Received:	September 15, 2022	Samples Submitted:	17
Date Analyzed:	September 21, 2022	Phases Analyzed:	25

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2017. The Pinchin asbestos laboratory uses the aforementioned methods of analysis.

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

This report relates only to the items tested.

This report relates only to the items tested and is valid only when signed with a protected, authorized, electronic signature. This report may not be reproduced, except in full, without the written approval of Pinchin Ltd. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. Internal verification studies, quality assurance / control data and laboratory documentation on measurement uncertainty are available upon request.



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278900
Date Analyzed: September 21, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0059A Ceiling, All, Drywall And Joint Compound, Loc: 1004, Corridor	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0059B Wall, All, Drywall And Joint Compound, Loc: 1791, Storage	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0059C Ceiling, All, Drywall And Joint Compound, Loc: 2350, Weight Room	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0059D Wall, All, Drywall And Joint Compound, Loc: 1792, Storage	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		
S0059E Ceiling, All, Drywall And Joint Compound, Loc: 2350, Weight Room	Homogeneous, off-white, drywall joint compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Drywall is present on the surface of this sample.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278900
Date Analyzed: September 21, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0060A Vinyl Floor Tile And Mastic, 12x12 Black With White Streaks, Loc: 2330, Drama Class (Analyze Mastic Too)	Phase a)		
	a) Homogeneous, off-white, consolidated, vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, yellow, hard, sticky material on the back of vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, grey, levelling compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Phase c) is small in size. For more reliable results, a larger sample is required.		
S0060B Vinyl Floor Tile And Mastic, 12x12 Black With White Streaks, Loc: 2330, Drama Class (Analyze Mastic Too)	2 Phases:		
	a) Homogeneous, black, consolidated, vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, yellow, hard, sticky material on the back of vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
S0060C Vinyl Floor Tile And Mastic, 12x12 Black With White Streaks, Loc: 2330, Drama Class (Analyze Mastic Too)	3 Phases:		
	a) Homogeneous, black, consolidated, vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, yellow, hard, sticky material on the back of vinyl floor tile.	None Detected	Non-Fibrous Material > 75%
	c) Homogeneous, grey, levelling compound.	None Detected	Non-Fibrous Material > 75%
Comments:	Phase c) is small in size. For more reliable results, a larger sample is required.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278900
Date Analyzed: September 21, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0061A Wall, Window, Caulking, Beige, Loc: 53, Exterior Phase A	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0061B Wall, Door, Caulking, Beige, Loc: 53, Exterior Phase A	2 Phases: a) Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, grey, caulking material.	None Detected	Non-Fibrous Material > 75%
S0061C Wall, Window, Caulking, Beige, Loc: 53, Exterior Phase A	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0062A Wall, Door, Caulking, Grey, Loc: 54, Exterior Phase B	2 Phases: a) Homogeneous, brown, rubbery, caulking material.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, grey, soft, caulking material.	Chrysotile 5-10%	Non-Fibrous Material > 75%
S0062B Wall, Door, Caulking, Grey, Loc: 54, Exterior Phase B	Homogeneous, brown, rubbery, caulking material.	None Detected	Non-Fibrous Material > 75%
S0062C Wall, Door, Caulking, Grey, Loc: 54, Exterior Phase B	Homogeneous, brown, rubbery, caulking material.	None Detected	Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278900
Date Analyzed: September 21, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0063A Wall, Window, Caulking, Beige, Loc: 54, Exterior Phase B	2 Phases a) Homogeneous, off-white, caulking material.	None Detected	Non-Fibrous Material > 75%
	b) Homogeneous, white, caulking material.	Chrysotile 0.5-5%	Synthetic Fibres 0.5-5% Non-Fibrous Material > 75%
Comments:	Cellulose is present on the surface of phase b).		
S0063B Wall, Window, Caulking, Beige, Loc: 54, Exterior Phase B	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0063C Wall, Window, Caulking, Beige, Loc: 54, Exterior Phase B	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%

Reviewed by:

Digitally signed by
Elizabeth DeCurtis
Date: 2022.09.22
15:39:02-04'00'

Reporting Analyst:

Digitally signed by
Elizabeth DeCurtis
Date: 2022.09.22
15:38:37-04'00'

6278900

Analyzed by: EC
 Reviewed by: LD
 Report Sent by: _____

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:		Project Address:	
Portfolio/Building No:		Pinchin File: 302783.041	
Submitted by:	Will Watson	Email:	wwatson@pinchin.com
CC Results to:	Laura Skoblenick	CC Email:	lskoblenick@pinchin.com
Date Submitted:	September 14 2022	Required by:	September 21 2022
# of Samples:	441 17 SPLIT 5/6	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory, Years ONLY):		1958	
Do NOT Stop on Positive (Sample Numbers):		S0034A-G, S0036A-G, S0037A, S0038A-G, S0039A-B, S0040A-G, S0041A-B, S0043A-B, S0044A-B, S0045A-C, S0046A-C, S0048A-B, S0049A-G, S0050A-G, S0051A-E, S0053A-C, S0054A-G, S0055A-C, S0056A-E, S0057A-G, S0058A-E, S0059A-E and S0060A-C	
Pinchin Group Company (Mandatory Field):		Pinchin	
HMIS2 Building Reference #:		109791/202271960841784	
To be Completed by Lab Personnel Only:			
Lab Reference #:		Time: 24 hour clock	
Received by:		Date: Sept 21, 2022	
Name(s) of Analyst(s):		Month Day Year	
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0059	A	Ceiling, All, Drywall And Joint Compound, Loc: 1004, Corridor ND
S	0059	B	Wall, All, Drywall And Joint Compound, Loc: 1791, Storage ND
S	0059	C	Ceiling, All, Drywall And Joint Compound, Loc: 2350, Weight Room ND
S	0059	D	Wall, All, Drywall And Joint Compound, Loc: 1792, Storage ND
S	0059	E	Ceiling, All, Drywall And Joint Compound, Loc: 2350, Weight Room ND
S	0060	A	Vinyl Floor Tile And Mastic, 12x12 Black With White Streaks, Loc: 2330, Drama Class (Analyze Mastic Too) a) ND b) ND c) ND

COP 8F2d

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0060	B	Vinyl Floor Tile And Mastic, 12x12 Black With White Streaks, Loc:2330, Drama Class (Analyze Mastic Too) a) ND b) ND
S	0060	C	Vinyl Floor Tile And Mastic, 12x12 Black With White Streaks, Loc:2330, Drama Class (Analyze Mastic Too) a) ND b) ND c) ND
S	0061	A	Wall, Window, Caulking, Beige, Loc:53, Exterior Phase A ND
S	0061	B	Wall, Door, Caulking, Beige, Loc:53, Exterior Phase A a) ND b) ND
S	0061	C	Wall, Window, Caulking, Beige, Loc:53, Exterior Phase A ND
S	0062	A	Wall, Door, Caulking, Grey, Loc:54, Exterior Phase B a) ND b) CH 5-10
S	0062	B	Wall, Door, Caulking, Grey, Loc:54, Exterior Phase B ND
S	0062	C	Wall, Door, Caulking, Grey, Loc:54, Exterior Phase B ND
S	0063	A	Wall, Window, Caulking, Beige, Loc:54, Exterior Phase B a) ND b) CH 0.55
S	0063	B	Wall, Window, Caulking, Beige, Loc:54, Exterior Phase B ND
S	0063	C	Wall, Window, Caulking, Beige, Loc:54, Exterior Phase B ND



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project No.:	0302783.041		
Prepared For:	W. Watson / L. Skoblenick		
Lab Reference No.:	b278902		
Analyst(s):	A. Wells		
Date Received:	September 15, 2022	Samples Submitted:	21
Date Analyzed:	September 21, 2022	Phases Analyzed:	16

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2017. The Pinchin asbestos laboratory uses the aforementioned methods of analysis.

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

This report relates only to the items tested.

This report relates only to the items tested and is valid only when signed with a protected, authorized, electronic signature. This report may not be reproduced, except in full, without the written approval of Pinchin Ltd. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. Internal verification studies, quality assurance / control data and laboratory documentation on measurement uncertainty are available upon request.



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278902
Date Analyzed: September 21, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0064A Wall, Expansion Joint, Caulking, White, Loc: 54, Exterior Phase B	Homogeneous, beige, caulking material.	Chrysotile 10-25%	Non-Fibrous Material > 75%
Comments:	Man-made vitreous fibres are present on the surface of this sample.		
S0064B Wall, Expansion Joint, Caulking, White, Loc: 54, Exterior Phase B			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0064C Wall, Expansion Joint, Caulking, White, Loc: 54, Exterior Phase B			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0065A Wall, Expansion Joint, Caulking, Grey, Loc: 55, Exterior Phase C	Homogeneous, off-white, caulking material.	Chrysotile 0.5-5%	Talc 5-10% Non-Fibrous Material > 75%
S0065B Wall, Expansion Joint, Caulking, Grey, Loc: 55, Exterior Phase C			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0065C Wall, Expansion Joint, Caulking, Grey, Loc: 55, Exterior Phase C			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0066A Wall, Window, Caulking, Beige, Loc: 55, Exterior Phase C	2 Phases: a) Homogeneous, grey, caulking material. b) Homogeneous, white, caulking material.	Chrysotile 0.5-5% None Detected	Non-Fibrous Material > 75% Non-Fibrous Material > 75%



Pinchin Ltd. Asbestos Laboratory

Certificate of Analysis

Project No.: 0302783.041
 Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278902
 Date Analyzed: September 21, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0066B Wall, Door, Caulking, Beige, Loc:55, Exterior Phase C	2 Phases: a) Homogeneous, grey, caulking material. b) Homogeneous, white, caulking material.	None Detected	Not Analyzed Non-Fibrous Material > 75%
Comments:	Analysis of phase a) was stopped due to a previous positive result.		
S0066C Wall, Window, Caulking, Beige, Loc:55, Exterior Phase C	Homogeneous, white, caulking material.	None Detected	Non-Fibrous Material > 75%
S0067A Wall, Expansion Joint, Caulking, White, Loc:56, Exterior Phase D	2 Phases: a) Homogeneous, white, caulking material. b) Homogeneous, dark grey, caulking material.	None Detected None Detected	Non-Fibrous Material > 75% Non-Fibrous Material > 75%
Comments:	Foam is present on the surface of this sample.		
S0067B Wall, Expansion Joint, Caulking, White, Loc:56, Exterior Phase D	2 Phases: a) Homogeneous, white, caulking material. b) Homogeneous, dark grey, caulking material.	None Detected None Detected	Non-Fibrous Material > 75% Non-Fibrous Material > 75%
Comments:	Foam is present on the surface of this sample.		
S0067C Wall, Expansion Joint, Caulking, White, Loc:56, Exterior Phase D	Homogeneous, white, caulking material.	None Detected	Non-Fibrous Material > 75%
Comments:	Foam is present on the surface of this sample.		



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278902
Date Analyzed: September 21, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0068A Wall,Door,Caulking,White, Loc:56,Exterior Phase D	Homogeneous, green, caulking material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
Comments:	Another phase is present but there was insufficient material submitted to analyze.		
S0068B Wall,Door,Caulking,White, Loc:56,Exterior Phase D			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0068C Wall,Door,Caulking,White, Loc:56,Exterior Phase D			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0069A Wall,Window,Caulking,Bei ge,Loc:56,Exterior Phase D	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0069B Wall,Window,Caulking,Bei ge,Loc:56,Exterior Phase D	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0069C Wall,Window,Caulking,Bei ge,Loc:56,Exterior Phase D	Homogeneous, beige, caulking material.	None Detected	Non-Fibrous Material > 75%
S0070A Wall,Door,Caulking,White, Loc:57,Exterior Phase E	Homogeneous, grey, caulking material.	Chrysotile 0.5-5%	Non-Fibrous Material > 75%
S0070B Wall,Door,Caulking,White, Loc:57,Exterior Phase E			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project No.: 0302783.041
Prepared For: W. Watson / L. Skoblenick

Lab Reference No.: b278902
Date Analyzed: September 21, 2022

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0070C Wall, Door, Caulking, White, Loc: 57, Exterior Phase E			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		

Reviewed by:

Digitally signed by
Cheryl Hendsbee
Date: 2022.09.22
10:52:27-04'00'

Page 5 of 5

Reporting Analyst:

Digitally signed by
Cheryl Hendsbee
Date: 2022.09.22
10:52:10-04'00'

Analyzed by: SW
 Reviewed by: KB
 Report Sent by: Q

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:		Project Address:	
Portfolio/Building No:		Pinchin File:	302783.041
Submitted by:	Will Watson	Email:	wwatson@pinchin.com
CC Results to:	Laura Skoblenick	CC Email:	lskoblenick@pinchin.com
Date Submitted:	September 14 2022	Required by:	September 21 2022
# of Samples:	141 21 SPLIT 6/6	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory, Years ONLY):		1958	
		S0034A-G, S0036A-G, S0037A, S0038A-G, S0039A-B, S0040A-G, S0041A-B, S0043A-B, S0044A-B, S0045A-C, S0046A-C, S0048A-B, S0049A-G, S0050A-G, S0051A-E, S0053A-C, S0054A-G, S0055A-C, S0056A-E, S0057A-G, S0058A-E, S0059A-E and S0060A-C	
Do NOT Stop on Positive (Sample Numbers):			
Pinchin Group Company (Mandatory Field):		Pinchin	
HMIS2 Building Reference #:		109791/202271960841784	
To be Completed by Lab Personnel Only:			
Lab Reference #:		Time:	24 hour clock
6278902 RD		Date:	Month Day Year
Received by:		9-15-2022 CH	
Name(s) of Analyst(s):		SW 220921	
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0064	A	Wall, Expansion Joint, Caulking, White, Loc: 54, Exterior Phase B <i>CH 10-25%</i>
S	0064	B	Wall, Expansion Joint, Caulking, White, Loc: 54, Exterior Phase B <i>na</i>
S	0064	C	Wall, Expansion Joint, Caulking, White, Loc: 54, Exterior Phase B <i>na</i>
S	0065	A	Wall, Expansion Joint, Caulking, Grey, Loc: 55, Exterior Phase C <i>CH 0.5-5%</i>
S	0065	B	Wall, Expansion Joint, Caulking, Grey, Loc: 55, Exterior Phase C <i>na</i>
S	0065	C	Wall, Expansion Joint, Caulking, Grey, Loc: 55, Exterior Phase C <i>na</i>

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
S	0066	A	Wall, Window, Caulking, Beige, Loc: 55, Exterior Phase C <i>CHUS-S-1. D M</i>
S	0066	B	Wall, Door, Caulking, Beige, Loc: 55, Exterior Phase C <i>CHUS-S-1. D M</i>
S	0066	C	Wall, Window, Caulking, Beige, Loc: 55, Exterior Phase C <i>MD</i>
S	0067	A	Wall, Expansion Joint, Caulking, White, Loc: 56, Exterior Phase D <i>CHUS-S-1. D M</i>
S	0067	B	Wall, Expansion Joint, Caulking, White, Loc: 56, Exterior Phase D <i>CHUS-S-1. D M</i>
S	0067	C	Wall, Expansion Joint, Caulking, White, Loc: 56, Exterior Phase D <i>MD</i>
S	0068	A	Wall, Door, Caulking, White, Loc: 56, Exterior Phase D <i>CHUS-S-1</i>
S	0068	B	Wall, Door, Caulking, White, Loc: 56, Exterior Phase D <i>na</i>
S	0068	C	Wall, Door, Caulking, White, Loc: 56, Exterior Phase D <i>na</i>
S	0069	A	Wall, Window, Caulking, Beige, Loc: 56, Exterior Phase D <i>MD</i>
S	0069	B	Wall, Window, Caulking, Beige, Loc: 56, Exterior Phase D <i>MD</i>
S	0069	C	Wall, Window, Caulking, Beige, Loc: 56, Exterior Phase D <i>MD</i>
S	0070	A	Wall, Door, Caulking, White, Loc: 57, Exterior Phase E <i>CHUS-S-1</i>
S	0070	B	Wall, Door, Caulking, White, Loc: 57, Exterior Phase E <i>na</i>
S	0070	C	Wall, Door, Caulking, White, Loc: 57, Exterior Phase E <i>na</i>

14

APPENDIX II-B
Lead Analytical Certificates

Certificate of Analysis

Pinchin Ltd. (Kingston)

1456 Centennial Drive, Suite 2
Kingston, ON K7P 0K4
Attn: William Watson

Client PO:
Project: 302783.041
Custody:

Report Date: 20-Sep-2022
Order Date: 15-Sep-2022

Order #: 2238346

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

Parcel ID	Client ID
2238346-01	L0001 - Various colours on plaster (Ph. A), Composite
2238346-02	L0002 - Black on steel structure (Ph. A), Composite
2238346-03	L0003 - Various colours on textured plaster (Ph. A), Comp.
2238346-04	L0004 - Grey on poured concrete floor (Ph. A), Composite
2238346-05	L0005 - White/beige on wood trim (Ph. A), Composite
2238346-06	L0006 - Various colours on drywall (Ph. A), Composite
2238346-07	L0007 - Various colours on concrete block (Ph. A), Composite
2238346-08	L0008 - Various colours on drywall (Ph. B), Composite
2238346-09	L0009 - Various colours on concrete block wall (Ph. B), Comp.
2238346-10	L0010 - Various colours on plaster (Ph. B), Composite
2238346-11	L011 - Grey on poured concrete floor (Ph. B), Composite
2238346-12	L0012 - White on wood trim (Ph. B), Composite
2238346-13	L0013 - Various colours on steel structure (Ph. B), Comp.
2238346-14	L0014 - Various colours on concrete block wall (Ph. C), Comp.
2238346-15	L0015 - Various colours on plaster (Ph. C), Loc. 1270
2238346-16	L0016 - Various colours on drywall (Ph. C), Composite
2238346-17	L0018 - Various colours on concrete block (Ph. D), Comp.
2238346-18	L0019 - Various colours on plaster (Ph. D), Composite
2238346-19	L0020 - Grey on poured concrete floor (Ph. D), Composite
2238346-20	L0021 - Various colours on drywall (Ph. D), Composite
2238346-21	L0022 - Various colours on steel structure (Ph. D), Comp.
2238346-22	L0023 - Various colours on concrete block (Ph. E), Comp.
2238346-23	L0024 - White on drywall (Ph. E), Composite
2238346-24	L0025 - Grey on poured concrete floor (Ph. E), Composite
2238346-25	L0026 - Various colours on steel structure (Ph. E), Loc. 1520
2238346-26	L0027 - Grey paint on steel door (Ph. E), Loc. 54

Approved By:



Mark Foto, M.Sc.
Lab Supervisor

Any use of these results implies your agreement that our total liability in connection with this work, however arising shall be limited to the amount paid by you for this work, and that our employees or agents shall not under circumstances be liable to you in connection with this work

Certificate of Analysis

Client: Pinchin Ltd. (Kingston)

Client PO:

Report Date: 20-Sep-2022

Order Date: 15-Sep-2022

Project Description: 302783.041

Analysis Summary Table

Analysis	Method Reference/Description	Extraction Date	Analysis Date
Metals, ICP-MS	EPA 6020 - Digestion - ICP-MS	20-Sep-22	20-Sep-22

Qualifier Notes:*Sample Qualifiers :*

- 1 : Complete separation of paint from substrate not possible for this sample and a small amount of substrate has been included in the paint digestion.

Sample Data Revisions

None

Work Order Revisions/Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

Certificate of Analysis

Report Date: 20-Sep-2022

Client: Pinchin Ltd. (Kingston)

Order Date: 15-Sep-2022

Client PO:

Project Description: 302783.041

Sample Results

Lead					Matrix: Paint
Paracel ID	Client ID	Sample Date	Units	MDL	Result
2238346-01	L0001 - Various colours on plaster (Ph. A), Composite	24-Aug-22	% by Wt.	0.0005	0.0598
2238346-02	L0002 - Black on steel structure (Ph. A), Composite	24-Aug-22	% by Wt.	0.0005	0.0784
2238346-03	L0003 - Various colours on textured plaster (Ph. A), Composite	24-Aug-22	% by Wt.	0.0005	0.0014 [1]
2238346-04	L0004 - Grey on poured concrete floor (Ph. A), Composite	24-Aug-22	% by Wt.	0.0005	0.137
2238346-05	L0005 - White/beige on wood trim (Ph. A), Composite	24-Aug-22	% by Wt.	0.0005	0.0032
2238346-06	L0006 - Various colours on drywall (Ph. A), Composite	24-Aug-22	% by Wt.	0.0005	0.0005
2238346-07	L0007 - Various colours on concrete block (Ph. A), Composite	24-Aug-22	% by Wt.	0.0005	0.0832 [1]
2238346-08	L0008 - Various colours on drywall (Ph. B), Composite	24-Aug-22	% by Wt.	0.0005	<0.0005
2238346-09	L0009 - Various colours on concrete block wall (Ph. B), Composite	24-Aug-22	% by Wt.	0.0005	0.0121 [1]
2238346-10	L0010 - Various colours on plaster (Ph. B), Composite	24-Aug-22	% by Wt.	0.0005	0.0050
2238346-11	L011 - Grey on poured concrete floor (Ph. B), Composite	24-Aug-22	% by Wt.	0.0005	0.0051
2238346-12	L0012 - White on wood trim (Ph. B), Composite	24-Aug-22	% by Wt.	0.0005	<0.0005
2238346-13	L0013 - Various colours on steel structure (Ph. B), Composite	24-Aug-22	% by Wt.	0.0005	0.191
2238346-14	L0014 - Various colours on concrete block wall (Ph. C), Composite	24-Aug-22	% by Wt.	0.0005	0.0014 [1]
2238346-15	L0015 - Various colours on plaster (Ph. C), Loc. 1270	24-Aug-22	% by Wt.	0.0005	0.0025
2238346-16	L0016 - Various colours on drywall (Ph. C), Composite	24-Aug-22	% by Wt.	0.0005	<0.0005
2238346-17	L0018 - Various colours on concrete block (Ph. D), Composite	24-Aug-22	% by Wt.	0.0005	0.0113
2238346-18	L0019 - Various colours on plaster (Ph. D), Composite	24-Aug-22	% by Wt.	0.0005	0.0115 [1]
2238346-19	L0020 - Grey on poured concrete floor (Ph. D), Composite	24-Aug-22	% by Wt.	0.0005	0.0229
2238346-20	L0021 - Various colours on drywall (Ph. D), Composite	24-Aug-22	% by Wt.	0.0005	<0.0005
2238346-21	L0022 - Various colours on steel structure (Ph. D), Composite	24-Aug-22	% by Wt.	0.0005	0.269
2238346-22	L0023 - Various colours on concrete block (Ph. E), Composite	24-Aug-22	% by Wt.	0.0005	0.0013
2238346-23	L0024 - White on drywall (Ph. E), Composite	24-Aug-22	% by Wt.	0.0005	<0.0005
2238346-24	L0025 - Grey on poured concrete floor (Ph. E), Composite	24-Aug-22	% by Wt.	0.0005	0.0417
2238346-25	L0026 - Various colours on steel structure (Ph. E), Loc. 54	24-Aug-22	% by Wt.	0.0005	0.0445
2238346-26	L0027 - Grey paint on steel door (Ph. E), Loc. 54	24-Aug-22	% by Wt.	0.0005	1.15

Laboratory Internal QA/QC

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
Matrix Blank									
Lead	ND	0.0005	% by Wt.						
Matrix Duplicate									
Lead	0.0390	0.0005	% by Wt.	0.0598			42.00	50	
Matrix Spike									
Lead	64.1	5.00	% by Wt.	23.9	80.4	70-130			

APPENDIX II-C
PCB Analytical Certificates

Certificate of Analysis

Pinchin Ltd. (Kingston)

1456 Centennial Drive, Suite 2
Kingston, ON K7P 0K4
Attn: William Watson

Client PO:
Project: 302783.041
Custody:

Report Date: 20-Sep-2022
Order Date: 15-Sep-2022

Order #: 2238351

This Certificate of Analysis contains analytical data applicable to the following samples as submitted :

Paracel ID	Client ID
2238351-01	P0001 - Beige door caulking, Loc. 24, 30
2238351-02	P0002 - Beige window/door caulking (Ph. A), Loc. 53
2238351-03	P0003 - Window/door caulking (Ph. B), Loc. 54
2238351-04	P0004 - Beige window/door caulking (Ph. C), Loc. 55
2238351-05	P0005 - Door/window caulking (Ph. D), Loc. 56
2238351-06	P0006 - White door caulking (Ph. E), Loc. 57
2238351-07	P0007 - Expansion joint caulking, composite

Approved By:

Mark Foto

Mark Foto, M.Sc.
Lab Supervisor

Certificate of Analysis

Report Date: 20-Sep-2022

Client: Pinchin Ltd. (Kingston)

Order Date: 15-Sep-2022

Client PO:

Project Description: 302783.041

Analysis Summary Table

Analysis	Method Reference/Description	Extraction Date	Analysis Date
PCBs, total	SW846 8082A - GC-ECD	15-Sep-22	20-Sep-22

Certificate of Analysis

Report Date: 20-Sep-2022

Client: Pinchin Ltd. (Kingston)

Order Date: 15-Sep-2022

Client PO:

Project Description: 302783.041

Client ID:	P0001 - Beige door caulking, Loc. 24, 30	P0002 - Beige window/door caulking (Ph. A), Loc. 53	P0003 - Window/door caulking (Ph. B), Loc. 54	P0004 - Beige window/door caulking (Ph. C), Loc. 55
Sample Date:	24-Aug-22 00:00	24-Aug-22 00:00	24-Aug-22 00:00	24-Aug-22 00:00
Sample ID:	2238351-01	2238351-02	2238351-03	2238351-04
MDL/Units	Other	Other	Other	Other

PCBs

PCBs, total	5 ppm	<5	<5	<5	<5
Decachlorobiphenyl	Surrogate	124%	123%	113%	114%

Client ID:	P0005 - Door/window caulking (Ph. D), Loc. 56	P0006 - White door caulking (Ph. E), Loc. 57	P0007 - Expansion joint caulking, composite	-
Sample Date:	24-Aug-22 00:00	24-Aug-22 00:00	24-Aug-22 00:00	-
Sample ID:	2238351-05	2238351-06	2238351-07	-
MDL/Units	Other	Other	Other	-

PCBs

PCBs, total	5 ppm	<5	<5	<5	-
Decachlorobiphenyl	Surrogate	118%	122%	122%	-

Certificate of Analysis

Report Date: 20-Sep-2022

Client: Pinchin Ltd. (Kingston)

Order Date: 15-Sep-2022

Client PO:

Project Description: 302783.041

Method Quality Control: Blank

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
PCBs									
PCBs, total	ND	5	ppm						
Surrogate: Decachlorobiphenyl	5.91		ppm		118	60-140			

Certificate of Analysis

Report Date: 20-Sep-2022

Client: Pinchin Ltd. (Kingston)

Order Date: 15-Sep-2022

Client PO:

Project Description: 302783.041

Method Quality Control: Duplicate

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
PCBs									
PCBs, total	ND	5	ppm	ND			NC	40	
Surrogate: Decachlorobiphenyl	6.55		ppm		131	60-140			

Certificate of Analysis

Report Date: 20-Sep-2022

Client: Pinchin Ltd. (Kingston)

Order Date: 15-Sep-2022

Client PO:

Project Description: 302783.041

Method Quality Control: Spike

Analyte	Result	Reporting Limit	Units	Source Result	%REC	%REC Limit	RPD	RPD Limit	Notes
PCBs									
PCBs, total	25	5	ppm	ND	124	60-140			
Surrogate: Decachlorobiphenyl	6.64		ppm		133	60-140			

Certificate of Analysis

Report Date: 20-Sep-2022

Client: Pinchin Ltd. (Kingston)

Order Date: 15-Sep-2022

Client PO:

Project Description: 302783.041

Qualifier Notes:

Login Qualifiers :

Container and COC sample IDs don't match - Sample labelled as P0004 - Beige window/door caulking Loc. 54, chain of custody reads P0004 - Beige window/door caulking (Ph. C), Loc. 55

Applies to samples: P0004 - Beige window/door caulking (Ph. C), Loc. 55

Sample Data Revisions

None

Work Order Revisions / Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated



2238351

Client Name: Pinchin Ltd.
Contact Name: Will Watson
Address: 1456 Centennial Drive, Suite 2, Kingston, ON
Telephone: 613.541.1013

Project Ref:
Quote #: Standing Offer
PO #: 302783.041
E-mail: wwatson@pinchin.com

Page 1 of 1
Turnaround Time
☐ 1 day ☐ 3 day
☐ 2 day ☒ Regular
Date Required: September 21 2022

☐ REG 153/04 ☐ REG 406/19
☐ Table 1 ☐ Res/Park ☐ Med/Fine
☐ Table 2 ☐ Ind/Comm ☐ Coarse
☐ Table 3 ☐ Agri/Other
☐ Table _____
For RSC: ☐ Yes ☐ No

Other Regulation
☐ REG 558 ☐ PWQO
☐ CCME ☐ MISA
☐ SU - Sani ☐ SU - Storm
Mun: _____
☐ Other: _____

Matrix Type: S (Soil/Sed.) GW (Ground Water)
SW (Surface Water) SS (Storm/Sanitary Sewer)
P (Paint) A (Air) O (Other)

Required Analysis

Sample ID/Location Name		Matrix	Air Volume	# of Containers	Sample Taken		PCB												
					Date	Time													
1	P0001 - Beige door caulking, Loc. 24, 30	0		1	August 24 2022	AM	✓												
2	P0002 - Beige window/door caulking (Ph. A), Loc. 53	0		1	August 24 2022	AM	✓												
3	P0003 - Window/door caulking (Ph. B), Loc. 54	0		1	August 24 2022	AM	✓												
4	P0004 - Beige window/door caulking (Ph. C), Loc. 55	0		1	August 24 2022	AM	✓												
5	P0005 - Door/window caulking (Ph. D), Loc. 56	0		1	August 24 2022	AM	✓												
6	P0006 - White door caulking (Ph. E), Loc. 57	0		1	August 24 2022	AM	✓												
7	P0007 - Expansion joint caulking, composite	0		1	August 24 2022	AM	✓												
8																			
9																			
10																			

Comments: Please cc: Iskobenick@pinchin.com with results.

Method of Delivery:

Parabolis

Relinquished By (Sign):	Received By Driver/Depot:	Received At Lab:	Verified By:
Relinquished By (Print): Will Watson	Date/Time:	Date/Time: Sep 15 2022	Date/Time: Sep 15 2022
Date/Time: 09/14/2022	Temperature: °C	Temperature:	pH Verified: <input type="checkbox"/> By:

APPENDIX III
Methodology and Evaluation Criteria



1.0 GENERAL

An inspection was conducted to identify the type of Hazardous Building Materials incorporated in the structure and its finishes.

Information regarding the location and condition of hazardous building materials encountered and visually estimated quantities were recorded. The locations of any samples collected were recorded on small-scale plans. As-built drawings and previous reports were referenced where provided.

Sample collection was conducted in accordance with our Standard Operating Procedures.

1.1 Asbestos

The inspection for asbestos included friable and non-friable asbestos-containing materials (ACM). A friable material is a material that when dry can be crumbled, pulverized or powdered by hand pressure.

A separate set of samples was collected of each type of homogenous material suspected to contain asbestos. A homogenous material is defined by the US EPA as material that is uniform in texture and appearance, was installed at one time, and is unlikely to consist of more than one type or formulation of material. The homogeneous materials were determined by visual examination and available information on the phases of construction and prior renovations.

Samples were collected at a rate that is in compliance with the requirements of local regulations and guidelines. The sampling strategy was also based on known ban dates and phase out dates of the use of asbestos; sampling of certain building materials is not conducted after specific construction dates. In addition, to be conservative, several years past these dates are added to account for some uncertainty in the exact start / finish date of construction and associated usage of ACM. In some cases, manufactured products such as asbestos cement pipe were visually identified without sample confirmation.

The asbestos analysis was completed using a stop-positive approach. Only one result meeting the regulated criteria was required to determine that a material is asbestos containing, but all samples must be analyzed to conclusively determine that a material is non-asbestos. The laboratory stopped analyzing samples from a homogeneous material once a result equal to or greater than the regulated criteria is detected in any of the samples of that material. All samples of a homogeneous material were analyzed if no asbestos is detected. In some cases, all samples were analyzed in the sample set regardless of result.

The analysis was performed in accordance with Test Method EPA/600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials, July 1993.

Analytical results were compared to the following criteria.

Jurisdiction	Friable	Non-Friable
Ontario	0.5%	0.5%

Where building materials are described in the report as “non-asbestos” or “does not contain asbestos”, this means that either no asbestos was detected by the analytical method utilized in any of the multiple samples or, if detected, it is below the lower limit of an asbestos-containing material in the applicable regulation. Additionally, these terms are used for materials which historically are known to not include asbestos in their manufacturing.

Asbestos materials were evaluated in order to make recommendations regarding any remedial work. The priority for remedial action was based on several factors:

- Friability (friable or non-friable).
- Condition (good, fair, poor, debris).
- Accessibility (ranking from accessible to all building users to inaccessible).
- Visibility (whether the material is obscured by other building components).
- Efficiency of the work (for example, if damaged ACM is being removed in an area, it may be most practical to remove all ACM in the area even if it is in good condition).

For a complete description of the Evaluation Criteria and Basis of Recommendations, refer to Annex A.

1.2 Lead

Samples of distinctive paint finishes, and surface coatings present in more than a limited application, where removal of the paint is possible was collected. The samples were collected by scraping the painted finish to include base and covering applications.

Analysis for lead in paints or surface coatings was performed in accordance with EPA Method No. 3050B/Method No. 7420; flame atomic absorption, or equivalent.

Analytical results were compared to the following criteria.

Jurisdiction	Units (%)	Units (ppm) / (mg/kg)
Ontario	0.1	1000

Other lead building products (e.g. batteries, lead sheeting, flashing) were identified by visual observation only.

1.3 Silica

Building materials known to contain crystalline silica (e.g. concrete, cement, tile, brick, masonry, mortar) were identified by visual inspection only. Pinchin did not perform sampling of these materials for laboratory analysis of crystalline silica content.

1.4 Mercury

Building materials, products or equipment (e.g. thermostats, barometers, pressure gauges, lamp tubes), suspected to contain mercury was identified by visually inspection only. Dismantling of equipment suspected of containing mercury was not performed. Sampling of these materials for laboratory analysis of mercury content was not performed.

1.5 Polychlorinated Biphenyls

The potential for light ballast and oil filled transformers to contain PCBs was based on the age of the building, a review of maintenance records and examination of labels or nameplates on equipment, where present and accessible. The information was compared to known ban dates of PCBs and Environment Canada publications.

Dry type transformers were presumed to be free of dielectric fluids and hence non-PCB.

Fluids (mineral oil, hydraulic, Aroclor or Askarel) in transformers or other equipment were not sampled for PCB content.

Caulking, sealants, or paints were sampled and submitted for PCB analysis following EPA 3550C/8082A.

Sample results are compared to the criteria of 50 mg/kg for solids as stated in the PCB Regulation, SOR/2008-273.

1.6 Visible Mould

The presence of mould or water damage was determined by visual inspection of exposed building surfaces. If any mould growth or water damage was concealed within building cavities it was not addressed in this assessment.

Template: Methodology for Hazardous Building Materials Assessment, HAZ, November 23, 2021

METHODOLOGY ANNEX A EVALUATION CRITERIA

1.0 EVALUATION CRITERIA AND BASIS OF RECOMMENDATIONS

The detailed asbestos assessment provides information regarding the location, condition, accessibility and friability of the asbestos-containing materials (ACM). In order to make recommendations for compliance with current regulations, Pinchin developed the following criteria.

2.0 EVALUATION OF CONDITION

2.1 Friable Sprayed or Trowelled Fireproofing, Thermal Insulation and Texture Finishes (Surfacing Materials)

To evaluate the condition of ACM sprayed or trowelled on fireproofing, sprayed or trowelled thermal insulation (non-mechanical), or texture, decorative or acoustic finishes, the following criteria are applied.

Good	Surface of material shows no significant signs of damage, deterioration or delamination. Good condition includes unencapsulated or unpainted fireproofing or texture finishes, where no or limited delamination or damage is observed, or encapsulated fireproofing or texture finishes where the encapsulant or paint has been applied after the damage or fallout occurred.
Poor	A sprayed material that shows signs of significant damage or is significantly delaminating or deteriorating. This may be limited to surface delamination, or some portion of the substrate may be exposed.

In Locations where damage exists in isolated areas, both good and poor condition may be applicable.

The extent of each condition will be recorded. Fair condition is not utilized in the evaluation of ACM sprayed or trowelled fireproofing, sprayed or trowelled thermal insulation (non-mechanical), or texture, decorative or acoustic finishes.

The evaluation of the above products above ceilings may be limited by the number of observations and by building components such as ducts or full height walls that obstruct the above ceiling observations.

2.2 Friable Mechanical or Thermal System Insulation (TSI)

To evaluate the condition of mechanical insulation on vessels, boilers, breeching, ducts, pipes, fan units, equipment etc. the following criteria are applied.

Good	Insulation is completely covered in jacketing and exhibits no evidence of damage or deterioration. No insulation is exposed. Includes conditions where the jacketing has minor damage (i.e. scuffs or stains), but the jacketing is not penetrated.
Fair	Minor penetrating damage to jacketed insulation (cuts, tears, nicks, deterioration or delamination) or undamaged insulation that has never been jacketed. Insulation is exposed but not showing surface disintegration. The extent of missing insulation ranges from minor to none. Damage can be repaired.

Poor	Original insulation jacket is missing, damaged, deteriorated or delaminated. Insulation is exposed and significant areas have been dislodged. Damage cannot be readily repaired. Includes components where insulation may have been removed incompletely.
-------------	---

The evaluation of mechanical insulation may be limited by the number of observations made and building components such as ducts or full height walls that obstruct observations. It is often not possible to observe each foot of mechanical insulation from all angles.

2.3 Potentially Friable Materials and Miscellaneous Friable Materials

Potentially friable ACM are products that are basically non-friable while in place but have the potential to generate friable dust upon removal or if significantly disturbed without appropriate procedures. These products may become friable if damaged. Potentially friable materials include materials such as acoustic ceiling tiles and plaster. To evaluate the condition of potentially friable materials, the following criteria are applied.

Good	No significant damage or deterioration. Still serving its intended use as a building material or finish.
Fair	Showing signs of some cracking or breakage, but is not deteriorating (e.g. cracked plaster, broken but in place ceiling tile, missing tile or section of plaster etc.). The condition is such that it is still serving its intended use as a building material or finish but may require repair for mainly cosmetic purposes.
Poor	Significant deterioration or breaking apart of the material. Material has deteriorated to the point it is not serving its intended use as building material or finish. Material has deteriorated to a point it has become friable. Normally potentially friable ACM in Poor condition is not repairable and requires at least localized removal and replacement.

2.4 Non-Friable Materials

Non-friable ACM cover a wide range of products with a wide variation in their tendency to release dust or asbestos fibres to the air. Many of these materials, (particularly where the matrix is an unweathered bitumen, asphalt or tar material) do not release fibres except in very unusual circumstances or during significant disturbance (e.g. use of abrasive power tools). Others with a cementitious matrix (asbestos-cement products) can more readily release dust due to abrasion, demolition, weathering, etc. The potential for asbestos release from non-friable ACM is always lower than from friable ACM. To evaluate the condition of non-friable Materials, the following criteria are applied.

Good	No significant damage or deterioration. Still serving its intended use as a building material or finish.
-------------	--

Fair	Showing signs of some cracking or breakage but is not deteriorating (e.g. cracked vinyl floor tile, missing piece of tile or transite, etc.). The condition is such that it is still serving its intended use as a building material or finish but may require repair for mainly cosmetic purposes.
Poor	Significant deterioration or breaking apart of the material to the point at which it cannot be repaired, and it will require at least local removal. Material has deteriorated to the point it is not serving its intended use as building material or finish. Material may have deteriorated to a point where traffic or disturbance may cause it to become friable.

2.5 Evaluation of ACM Debris

The identification of the exact location or presence of debris on the top of ceiling tiles is limited by the number of observations made and the presence of building components such as ducts or full height walls that obstruct observations.

The presence of fallen or dislodged ACM is noted separately from the ACM source and is referred to as Debris. Debris may be friable if from a friable ACM source or a badly deteriorated non-friable ACM source. Debris may also be non-friable (such as fallen pieces of transite sheet or mastic fittings, or broken, dislodged floor tiles).

Debris	Debris may be friable or non-friable but is always identified as debris.
---------------	--

2.6 Evaluation of Presumed Asbestos-Containing Material (PACM)

Presumed asbestos-containing materials (PACM), are building materials that may contain asbestos but were not sampled or analyzed due to inaccessibility or the need to perform destructive testing to obtain a reasonable sample set. Evaluation of these materials is based on the assumption that these PACM are asbestos containing.

A list of PACM is provided in the report and they are generally not included in the detailed room by room reports. Typically, they are excluded because they are inaccessible or present in very small quantities. If PACM are evaluated, Pinchin uses the criteria that correspond with the type (and friability) of the material listed above.

3.0 EVALUATION OF ACCESSIBILITY

The accessibility of building materials known or suspected of being ACM is rated according to the following criteria:

Access (A)	Common areas of the building within reach of all building users (approximately 8' - 9' from floor or standard ceiling height). Includes other areas where occupant activities may result in disturbance of material that is not normally within reach from floor level, but may be disturbed by common activities (e.g. gymnasiums, workshops, warehouses).
Access (B)	Areas of the building accessed primarily by Maintenance/Caretaking/Janitorial Staff and within reach without use of a ladder. Includes areas within reach in Boiler Rooms, Electrical Rooms, Janitors Closets, Elevator Rooms, Mechanical Rooms, etc. Includes materials within reach from fixed ladders or catwalks, mezzanines, and accessible pipe chases.
Access (C) and Visible	Areas of the building above 8' - 9' where use of a ladder or scaffold is required to reach the ACM. Only includes ACM that are visible to view without the removal or opening of other building components such as ceiling tiles or service access panels. Visible column on HMIS sheets will say YES.
Access (C) and not Visible	Areas of the building above 8' - 9' where use of a ladder or scaffold is required to reach the ACM. Includes ACM that are not visible to view and require the removal of a building component to see, such as ceilings tiles or access panels to view and access. Includes rarely entered crawl spaces, attic spaces, etc. Observations will be limited to the extent visible from the access points. Visible column on HMIS sheets will say NO.
Access (D)	Areas of the building behind inaccessible solid ceiling systems, walls or equipment etc. where demolition of the ceiling, wall or equipment etc. is required to reach the ACM. Material inaccessible due to height or location or is only accessed under unusual situations. Evaluation of condition and extent of ACM is limited or impossible, depending on the surveyor's ability to visually examine materials in Access D.

4.0 ACTION MATRIX AND DEFINITIONS

Pinchin's evaluation of the viability of a specific asbestos control option is based on the consideration of the friability, condition, accessibility and visibility of a material. The logic used is that damaged ACM located in an area frequently accessed by all building occupants is of a higher priority than damaged ACM located in an infrequently accessed service area. The action matrix considers the potential for fibre release (primarily from friable ACM) and the possible concerns from regulatory bodies and many building occupants to all damaged ACM (including non-friable).

In any building with asbestos, many current regulations require an Asbestos Management Program be implemented. Depending on the condition and the accessibility, more active measures such as repair or removal may be recommended. The following matrix provides guidance for recommended Actions in the absence of renovation or demolition. In the event of construction or maintenance activity which will disturb ACM more aggressive control or removal will be required.

4.1 Action Matrix

The following tables outline the action decisions based on the relationship of assessed factors. Table I applies to friable ACM. Table II applies to non-friable ACM.

Table I Decision Matrix for Friable ACM

Access	Condition			Debris
	Good	Fair	Poor	
(A)	Action 5 ¹	Action 5 ²	Action 3	Action 1
(B)	Action 7	Action 6 ³	Action 3	Action 1
(C) Visible	Action 7	Action 6	Action 3	Action 2
(C) Not Visible	Action 7	Action 7	Action 4	Action 2
(D)	Action 7	Action 7	Action 7	Action 7

Table II Decision Matrix for Potentially Friable and Non-Friable ACM

Access	Condition			Debris
	Good	Fair	Poor	
(A)	Action 7	Action 7 ⁴	Action 3	Action 1
(B)	Action 7	Action 7	Action 3	Action 1
(C) Visible	Action 7	Action 7	Action 4	Action 2
(C) Not Visible	Action 7	Action 7	Action 4	Action 2
(D)	Action 7	Action 7	Action 7	Action 7

4.2 Action Definitions

The following are the definitions in the Action Matrix Table presented above.

Action Definitions

Action 1	Clean-Up of ACM Debris Restrict access that is likely to cause a disturbance of the ACM Debris and clean up ACM Debris. Utilize appropriate asbestos precautions.
-----------------	--

¹ If friable ACM in access (A)/Good condition is not proactively removed Action 7 (Manage) is recommended.

² If friable ACM in access (A)/Fair condition is not proactively removed repair is recommended.

³ If friable ACM in access (B)/Fair condition is likely to be disturbed after repair proactive removal is recommended.

⁴ Action 7 is recommended for all non-friable ACM in Fair condition however some clients may wish to repair or take some action primarily for cosmetic reasons

Action Definitions

Action 2	<p>Precautions for Access Which may Disturb ACM Debris</p> <p>Use appropriate means to isolate the debris or to limit entry to the area which may disturb the material. At locations where ACM Debris can remain in place in lieu of removal or clean-up (e.g. Debris on top of ceiling tiles or behind lockable door), Utilize appropriate asbestos precautions to enter the area if this will disturb debris. The precautions will be required until the ACM Debris has been cleaned up.</p>
Action 3	<p>ACM Removal</p> <p>Remove ACM. Utilize asbestos procedures appropriate to the scope of the removal work. Until it is removed, restrict access to the material so it is not disturbed.</p>
Action 4	<p>Precautions for Work Which may Disturb ACM in Poor Condition</p> <p>Utilize appropriate asbestos precautions if ACM may be disturbed by work on or near ACM. This does not require restricting access to the area, only control of work which may contact or disturb the ACM. Removal is the only viable option if work will disturb ACM.</p>
Action 5	<p>Proactive ACM Removal</p> <p>Remove friable ACM where the presence of friable asbestos in Good condition is not desirable. If friable ACM in Fair condition is not removed, then Repair friable ACM.</p>
Action 6	<p>ACM Repair</p> <p>Repair friable ACM in Fair condition which is not likely to be damaged again or disturbed by normal use of the area or room. Pinchin recommends proactive removal if friable ACM is likely to be damaged or disturbed during normal use of the area or room.</p>
Action 7	<p>Asbestos Management Program with Routine Surveillance</p> <p>Implement an Asbestos Management Program, including routine surveillance of ACM. Reassess materials regularly (typically once per year).</p>

Master Template: Methodology Annex A to Appendix I Evaluation Criteria, HAZ, January 10, 2020

APPENDIX IV
Location Summary Report

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Survey Date:

Last Re-Assessment: 2022-08-31

Building Phases: A: 1958 , B: 1962 , C: 1965 , D: 1967 , E: 1995

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
1	Crawlspace at 1660	4000	NA	A	
2	Vestibule	75	1	A	
3	Closet	55	1	A	
4	Vestibule	50	1	A	
5	Storage	40	1	A	
6	Files, room no. 108A	40	1	A	
7	Office, room no. 108B	100	1	A	
8	Office, room no. 108C	100	1	A	
9	Men's Washroom	55	1	A	
10	Women's Washroom	55	1	A	
11	Vestibule	100	1	A	
12	Office, room no. 109A	150	1	A	
13	Corridor	150	1	A	
14	Women's Washroom	40	1	A	
15	Storage	50	1	A	
16	Vestibule	60	1	A	
17	Washroom	50	1	A	
18	Vestibule	175	1	A	
19	Meter Room	60	1	A	
20	Vestibule, room no. 171	50	1	A	
21	Washroom, room no. 171C	40	1	A	
22	Shower, room no. 171A	70	1	A	
23	Washroom, room no. 169C	40	1	A	
24	Vestibule	50	1	A	
25	Vestibule	150	1	A	
26	Storage, room no. 162B	175	1	A	
27	Storage, room no. 162D	175	1	A	
28	Elevator Machine Room, room no. 161G	40	1	A	
29	Washroom	60	1	A	
30	Vestibule	50	1	A	
31	Corridor	1000	1	A	
32	Custodian Washroom, room no. 160B	40	1	A	
33	Vestibule	50	1	B	
34	Corridor	150	1	B	
35	Washroom, room no. 239A	50	2	B	
36	Washroom, room no. 237A	50	2	B	
37	Stairwell	200	2	B	
38	Storage, room no. 131A	100	1	C	
39	Server Room, room no. 225A	75	2	C	
40	Girl's Shower	200	1	D	
41	Mechanical Room	150	1	D	
42	Vestibule, room no. 177G	50	1	D	
43	Washroom, room no. 177H	100	1	D	
44	Vestibule	50	1	D	
45	Washroom	80	1	D	
46	Washroom, room no. 179F	120	1	D	
47	Washroom	60	1	D	
48	Stairwell	200	1	D	
49	Storage	100	1	D	
50	Corridor	200	2	D	
51	Corridor	700	2	D	
53	Exterior Phase A	0	1	A	
54	Exterior Phase B	0	1	B	
55	Exterior Phase C	0	1	C	
56	Exterior Phase D	0	1	D	
57	Exterior Phase E	0	1	E	
1000	Corridor, room no. 100	2000	1	A	
1001	Corridor, room no. 1001	3000	1	A	
1002	Corridor	3000	1	B	
1003	Corridor	3000	1	B	

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
1004	Corridor	2000	1	D	
1005	Corridor	600	1	E	
1006	Corridor, room no. 1006	1000	1	E	
1020	Mechanical Room, room no. 102	200	1	A	
1040	Health Room, room no. 104	150	1	A	
1051	Stair C	200	1	B	
1060	Copy, room no. 106	310	1	A	
1070	Office Reception, room no. 107	300	1	A	
1071	Principal Office, room no. 107	100	1	A	
1072	Office, room no. 107E	200	1	A	
1080	Student Services, room no. 108	600	1	A	
1090	Office, room no. 109	356	1	A	
1100	Classroom, room no. 110	814	1	A	
1110	Staff Room, room no. 111	724	1	A	
1114	Vestibule	100	1	A	
1120	Office, room no. 112	267	1	A	
1130	Classroom, room no. 113	726	1	A	
1140	Classroom, room no. 114	805	1	A	
1150	Classroom, room no. 115	726	1	A	
1170	Classroom, room no. 117	726	1	A	
1180	Classroom, room no. 118	820	1	A	
1190	Classroom, room no. 119	726	1	A	
1200	Work Room, room no. 120	259	1	A	
1210	Classroom, room no. 121	726	1	A	
1220	Classroom, room no. 122	820	1	A	
1230	Classroom, room no. 123	726	1	A	
1240	Mechanical Room, room no. 124	238	1	A	
1250	Classroom, room no. 125	720	1	A	
1270	Staff Room, room no. 127	761	1	C	
1280	Classroom, room no. 128	1117	1	B	
1290	Classroom, room no. 129	1290	1	C	
1300	Classroom, room no. 130	1111	1	B	
1320	Storage, room no. 132	200	1	B	
1330	Classroom, room no. 133	1210	1	C	
1331	Prep Room, room no. 133	319	1	C	
1332	Stair D	200	1	B	
1340	Storage/Mech, room no. 134	200	1	B	
1342	CUST, room no. 134B	100	1	B	
1343	Womans W/C, room no. 134C	300	1	B	
1350	Chemical Lab, room no. 135	1628	1	B	
1351	Chemical Office, room no. 135A	200	1	B	
1352	Chemical Storage	150	1	B	
1360	Physics, room no. 136	1500	1	B	
1390	Exercise Room, room no. 139	2643	1	B	
1400	Computer Class, room no. 140	1185	1	B	
1401	Office, room no. 1401	200	1	B	
1410	Woodworking Shop, room no. 141	4000	1	B	
1420	Classroom, room no. 142	1137	1	B	Includes 142A
1430	Custodian, room no. 143	200	1	B	
1440	Office	150	1	B	
1450	Autoshop, room no. 145	4204	1	B	
1460	Office, room no. 146	100	1	B	
1470	Cust, room no. 147	50	1	B	
1480	Office, room no. 148	608	1	B	
1481	Office/Lunchroom, room no. 148D	200	1	B	
1482	Woodworking Storage, room no. 148	50	1	B	
1490	Resource Room, room no. 149	200	1	A	
1510	Training, room no. 151	500	1	E	
1520	Storage Room, room no. 152	2730	1	E	
1530	Storage, room no. 153	1808	1	E	
1540	Welding, room no. 154	2000	1	E	
1550	Storage, room no. 155	200	1	E	

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
1560	Classroom, room no. 156	250	1	E	
1570	Staff Room	100	1	B	
1571	W/C, room no. 157A	20	1	B	
1572	Closet, room no. 157B	20	1	B	
1573	Washroom, room no. 157C	100	1	B	
1590	Boiler Room	600	1	A	
1591	Mechanical Room, room no. 159A	300	1	A	
1600	Cust Office	1000	1	A	
1601	Office, room no. 1601	100	1	A	
1610	Women's W/C, room no. 161	150	1	A	
1611	Handicap w/c	100	1	A	
1612	Receiving, room no. 161B	200	1	A	
1614	Mens W/C, room no. 161	50	1	A	
1615	Change Room, room no. 161E	400	1	A	
1617	Stair, room no. Stair B	100	1	A	
1618	Stair E	250	1	B	
1620	Gym A & B, room no. 162	3500	1	A	
1621	Stage, room no. 1621	1000	1	A	
1624	Under Stage, room no. 162D	500	1	A	NO ACCESS
1630	Storage/WC, room no. 163	100	1	A	
1631	Storage Under Stairs, room no. 163A	20	1	A	
1640	Library, room no. 164	2500	1	A	
1641	Office @ Library, room no. 164A	200	1	A	
1650	Change Room, room no. 165	1097	1	A	
1651	Change in Storage, room no. 165	50	1	A	
1652	Change Room Storage, room no. 1652	50	1	A	
1653	Shower	200	1	A	
1654	Corridor	500	1	A	
1660	Mechanical Room, room no. 166	200	1	A	
1680	Seminar 1, room no. 168	100	1	A	
1681	Seminar 2, room no. 168A	200	1	A	
1690	Girls Changeroom, room no. 169	500	1	A	
1691	Girls W/C	50	1	A	
1692	Girls Shower, room no. 1692	200	1	A	
1693	Office, room no. 169B	150	1	A	
1710	Office, room no. 171	200	1	A	
1711	Corridor	1000	1	A	
1730	Storage, room no. 173	200	1	A	
1750	Electrical Room, room no. 175	100	1	A	
1770	Gym C, room no. 177	5000	1	D	
1771	Girls Changeroom, room no. 177	400	1	D	
1772	Gym C Storage, room no. 1772	300	1	D	
1773	Storage, room no. 177H	200	1	D	
1774	Under Bleachers, room no. 1774	200	1	D	
1790	Boy's Changeroom, room no. 179	400	1	D	
1791	Storage, room no. 179A	200	1	D	
1792	Storage, room no. 179B	50	1	D	
1797	Office, room no. 179G	150	1	D	
1900	Mens Washroom	300	1	A	
1901	Vestibule	50	1	A	
1910	Washroom, room no. 191	200	1	A	
1911	Stairwell I, room no. Stair I	100	1	A	
2001	Corridor, room no. 2	3000	2	A	
2002	Corridor	5000	2	B	
2010	Classroom, room no. 201	1098	2	A	
2011	Storage, room no. 201A	50	2	A	
2020	Vestibule, room no. 202	150	2	A	
2021	Washroom, room no. 202A	40	2	A	

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
2022	Washroom, room no. 202B	40	2	A	
2023	Custodian, room no. 202C	50	2	A	
2024	Stairwell A	200	2	A	
2030	Art Class, room no. 203	1123	2	A	
2031	Storage, room no. 203A	100	2	A	
2040	Classroom, room no. 204	1056	2	A	
2041	Closet, room no. 204A	100	2	A	
2050	Classroom, room no. 205	918	2	A	
2055	Stairs C, room no. Stair C	300	2	B	
2060	Classroom, room no. 206	723	2	A	
2070	Classroom, room no. 207	726	2	A	
2080	Classroom, room no. 208	974	2	A	
2090	Classroom, room no. 209	726	2	A	
2100	Classroom, room no. 210	898	2	A	
2110	Classroom, room no. 211	726	2	A	
2111	Storage, room no. 211A	100	2	A	
2112	Storage, room no. 211B	60	2	A	
2130	Office, room no. 213	726	2	A	
2140	Classroom, room no. 214	728	2	A	
2150	Office, room no. 215	726	2	A	
2160	Classroom, room no. 216	694	2	A	
2170	Vacant Office, room no. 217	720	2	A	
2171	Office, room no. 217A	200	2	A	
2172	Office, room no. 217B	80	2	A	
2173	Vestibule	50	2	A	
2174	Storage, room no. 215B	180	2	A	
2175	Office, room no. 215A	150	2	A	
2176	Office, room no. 213A	80	2	A	
2180	Classroom, room no. 218	727	2	A	
2190	Music Room, room no. 219	300	2	A	
2191	Music Storage, room no. 219A	100	2	A	
2195	Elevator, room no. Elev	20	2	A	
2210	Staff Room, room no. 221	200	2	A	
2220	Classroom, room no. 222	750	2	B	
2230	Classroom, room no. 223	1195	2	C	
2235	Stairs E, room no. Stairs E	200	2	B	
2240	Classroom, room no. 224	740	2	B	
2250	Classroom, room no. 225	1098	2	C	
2251	Storage	271	2	C	
2260	Classroom, room no. 226	1019	2	B	
2270	Classroom, room no. 227	1165	2	C	
2280	Fan Room, room no. 228	225	2	B	
2281	Storage, room no. 228A	50	2	B	
2290	Vestibule	80	2	D	
2291	Office, room no. 229A	100	2	D	
2292	Office, room no. 229B	100	2	D	
2293	Office, room no. 229C	100	2	D	
2294	Storage, room no. 229D	100	2	D	
2310	Classroom, room no. 231	844	2	D	
2320	Classroom, room no. 232	761	2	B	
2330	Drama Class, room no. 233	829	2	D	
2340	Classroom, room no. 234	966	2	B	
2341	234 Closet, room no. 234	50	2	B	
2350	Weight Room, room no. 235	400	2	D	
2352	Fan Room, room no. 235B	50	2	D	
2353	Fan Room, room no. 235C	20	2	D	
2354	Fan Room, room no. 235D	50	2	D	
2360	Staff Room/Kitchen, room no. 236	943	2	B	
2370	Office, room no. 237	150	2	B	
2390	Office, room no. 239	150	2	B	
2400	Storage, room no. 240	526	2	B	
2401	Storage Roof-Hatch, room no. 240A	50	2	B	
2410	Kitchen Office, room no. 241	1249	2	A	
2420	Classroom, room no. 242	1208	2	A	
2430	Kitchen, room no. 241	800	2	A	

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
2501	Cust, room no. 250A	25	2	A	
2540	Lobby, room no. 254	400	2	A	
2541	Cafeteria, room no. 254A	4800	2	A	
2542	Cust, room no. 254B	125	2	B	
2570	Kitchen, room no. 257	500	2	A	
2571	Kitchen Storage	100	2	A	
2572	Storage, room no. 257B	100	2	A	
2573	Storage, room no. 257C	80	2	A	
2580	Washroom, room no. 258	50	2	B	
2581	Classroom Storage, room no. 242B	100	2	B	
2590	Office, room no. 259	200	2	D	
2600	Bleachers	500	2	A	
2900	Girls W/C, room no. 290	320	2	A	
2910	Mens W/C, room no. 291	100	2	A	
2911	Womens W/C, room no. 291A	100	2	A	
2920	Mens W/C, room no. 292	200	2	B	
2930	Girls W/C, room no. 293	200	2	B	

APPENDIX V

Hazardous Materials Summary Report / Sample Log

HAZARDOUS MATERIALS SUMMARY / SAMPLE LOG

Client:Upper Canada District School Board **Site:** 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Survey Date:

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	S0001 ABC	Structure Fireproofing Fireproofing (fibrous)	1590,1591	A	0	910	0	0	None Detected	No	
Asbestos	S0002 ABCDEFG	Ceiling, Wall, Ceiling, Wall All Plaster	2,3,4,5,9,10,11,14,15,16,17,1020,1040,1051 1060,1100,1110,1114,1120,1130,1140,1180,1190 1200,1210,1220,1230,1240,1250,1332,1410,1450 1482,1615,1618,1630,1650,1653,1692,1693,1791 1900,1911,2020,2024,2030,2031,2040,2041,2050 2060,2070,2080,2090,2100,2110,2111,2112,2130 2140,2150,2160,2170,2171,2172,2173,2175,2176 2180,2191,2210,2400,2570,2571,2573,2900,2910 2911	A,B,D	0	3722	0	98	None Detected	No	
Asbestos	S0003 ABC	Floor All Vinyl Floor Tile And Mastic 9"x9", Grey With White And Black Streaks	1570	B	0	100	0	0	Chrysotile	Yes	NF
Asbestos	S0004 ABC	Ceiling, Wall All Ceiling Tiles (glue-on) 1'x1', Large And Medium Uniform Holes	[2070],4,6,7,8,9,11,12,13,14,17,29,38,39,42 43,47,49,1020,1040,1060,1070,1080,1090,1100 1110,1114,1120,1130,1140,1150,1170,1180,1190 1200,1210,1220,1230,1240,1250,1270,1280,1290 1300,1330,1331,1343,1400,1401,1440,1460,1570 1571,1573,1617,1630,1660,1691,1772,1773,1797 1900,1901,1910,2010,2011,2020,2021,2022,2023 2030,2031,2040,2041,2050,2060,2110,2111,2112 2130,2140,2150,2160,2170,2171,2172,2173,2174 2175,2176,2180,2190,2210,2220,2230,2240,2250 2251,2260,2290,2291,2292,2293,2294,2310,2320 2340,2360,2370,2390,2400,2410,2420,2501,2541 2570,2573,2581,2590,2900,2910,2911,2920,2930	A,B,C,D	0	57232	0	727	Amosite	Yes	PF
Asbestos	S0005 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Grey With Light Grey Fleck	[2191],1350,1420,1640,1641,1680,1681,2010	A,B,D	0	8564	0	0	None Detected	No	
Asbestos	S0006 ABCDEFG	Wall, Ceiling, Wall All Drywall And Joint Compound	13,35,36,39,1001,1002,1003,1004,1005,1006,1070 1071,1090,1280,1300,1320,1330,1340,1342,1350 1351,1360,1390,1401,1420,1440,1480,1481,1482 1490,1601,1610,1611,1640,1660,1791,1792,2002 2020,2030,2031,2040,2041,2050,2060,2070,2080 2090,2100,2110,2111,2112,2130,2140,2150,2160 2170,2171,2172,2175,2176,2220,2251,2280,2281 2350,2400,2401,2410,2430,2541,2542,2572,2580 2910,2911	A,B,C,D,E	0	10565	0	99	None Detected	No	
Asbestos	S0007 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Blue With White Fleck	[1140],1351,1480,1481,1482	A,B	0	2588	0	0	None Detected	No	
Asbestos	S0008 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", White With Blue Fleck	[1510]	B,E	0	2050	0	0	None Detected	No	
Asbestos	S0009 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Beige With Brown Fleck	1550	E	0	200	0	0	Chrysotile	Yes	NF

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	S0010 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", White With Teal Fleck	38,1290,1330,1331	C	0	2919	0	0	Chrysotile	Yes	NF
Asbestos	S0011 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Beige With White And Dark Brown Fleck	39,1270,2251,2291,2292,2293,2294,2310	C,D	0	2351	0	0	Chrysotile	Yes	NF
Asbestos	S0012 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Beige With Brown Fleck	[2360],1190,1210,1230,1250,1280,1300,2230	A,B,C	0	7264	0	0	None Detected	No	
Asbestos	S0013 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", White With Light And Dark Flecks	1120,1140,1180,1200,1220,1400,1401,1490,1611 1640	A,B	0	6556	0	0	None Detected	No	
Asbestos	S0014 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Grey With White Streaks	[2580],1440,2320,2340,2573,2581	A,B	0	2077	0	0	Chrysotile	Yes	NF
Asbestos	S0015 ABC	Ceiling, Wall, Ceiling, Wall All Ceiling Tiles (glue-on) 1'x1', Smooth	33,1280,1300,1420,1480,1481,1482,2400,2401	B	0	4463	0	0	None Detected	No	
Asbestos	S0016 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Light Green	1482	B	0	50	0	0	Chrysotile	Yes	NF
Asbestos	S0017 ABCD	Piping All Parging Cement	1,1450,1600,1771	A,B,D	0	0	17	0	Chrysotile	Yes	F
Asbestos	S0018 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", White With Grey And Teal Flecks	12,13,32,1070,1071,1072,1090,1600,1601,2420	A	0	3704	0	0	None Detected	No	
Asbestos	S0019 ABC	Floor All Vinyl Sheet Flooring Beige Geometric	[2060],1040,1130,1150,1170	A	0	3051	0	0	Chrysotile	Yes	PF
Asbestos	S0020 ABC	Ceiling All Ceiling Tiles (lay-in) 2'x4', Wide Fissures And Pinholes	4,15,16,24,30,31,50,51,1000,1001,1004,1005 1040,1060,1120,1140,1180,1200,1220,1490,1600 1601,1641,1680,1681,1711,1900,1910,1911,2001 2024,2540	A,D,E	0	13257	0	0	None Detected	No	
Asbestos	S0021 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Pink With Dark Pink Fleck	[1100]	A	0	1654	0	0	None Detected	No	
Asbestos	S0022 ABC	Floor All Vinyl Sheet Flooring Pink Geometric	1060	A	0	310	0	0	None Detected	No	
Asbestos	S0023 ABC	Piping All Aircell	1600	A	40	0	0	0	Chrysotile	Yes	F
Asbestos	S0024 ABC	Ceiling All Ceiling Tiles (lay-in) 2'x4', Coarse Texture	1000	A	0	2000	0	0	None Detected	No	
Asbestos	S0025 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Grey And Brown Fleck	[2195],2111	A	0	320	0	0	None Detected	No	
Asbestos	S0026 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Teal	2260,2390	B	0	1169	0	0	None Detected	No	
Asbestos	S0027 ABC	Floor All Vinyl Floor Tile And Mastic 9"x9", Beige With Brown Fleck	2370	B	0	150	0	0	Chrysotile	Yes	NF
Asbestos	S0028 ABC	Floor All Vinyl Floor Tile And Mastic 9"x9", Green	2240,2400	B	0	1266	0	0	Chrysotile	Yes	NF
Asbestos	S0029 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Light Blue With White Fleck	[2040],2180,2270	A,C	0	5020	0	0	Chrysotile	Yes	NF
Asbestos	S0030 ABC	Structure Deck Fireproofing (fibrous)	1770,2350	D	0	5400	0	0	None Detected	No	
Asbestos	S0031 ABC	Floor All Vinyl Floor Tile And Mastic	[2090]	A,B,C	0	4812	0	0	Chrysotile	Yes	NF

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
		12"x12", Grey With Dark Grey Fleck									
Asbestos	S0032 ABC	Other All Mastic, Black Phases In Samples 09, 10, 11	[2291],39,1270,1290,1330,1331,1550,2251,2292 2293,2294,2310	C,D,E	0	5566	0	0	Chrysotile	Yes	NF
Asbestos	S0033 ABC	Other All Mastic, Black Sample 29c-b Phase	2270	C	0	1165	0	0	Chrysotile	Yes	NF
Asbestos	S0034 ABCDEFG	Ceiling, Wall, Ceiling, Wall All Plaster	2,3,4,5,9,10,11,12,13,14,15,16,17,22,23,1000 1020,1040,1060,1090,1100,1110,1114,1120,1130 1140,1150,1170,1180,1190,1200,1210,1220,1230 1240,1250,1615,1617,1630,1650,1653,1692,1693 1900,1910,1911,2010,2011,2020,2021,2022,2023 2024,2030,2031,2040,2041,2050,2060,2070,2080 2090,2100,2110,2111,2112,2130,2140,2150,2160 2170,2171,2172,2173,2174,2175,2176,2180,2190 2191,2210,2501,2541,2570,2571,2573,2900,2910 2911	A	0	54107	0	0	None Detected	No	
Asbestos	S0035 ABC	Ceiling All Mastic	4,6,7,8,9,11,12,13,14,17,29,1040,1060,1070 1080,1090,1100,1110,1114,1120,1130,1140,1150 1170,1180,1190,1200,1210,1220,1230,1240,1250 1617,1630,1691,1900,1901,1910,2010,2011,2020 2021,2022,2023,2030,2031,2040,2041,2050,2060 2110,2111,2112,2130,2140,2150,2160,2170,2171 2172,2173,2174,2175,2176,2180,2190,2910,2911	A	0	25229	0	0	None Detected	No	
Asbestos	S0036 ABCDEFG	Wall All Plaster Textured	2,16,1001,1617,1901,1910,1911,2001,2024,2173 2501,2540,2900	A	0	16070	0	0	None Detected	No	
Asbestos	S0037 A	Floor All Mastic	1120,1140,1180,1200,1220,1400,1401,1490,1611	A,B	0	4656	0	0	None Detected	No	
Asbestos	S0038 ABCDEFG	Ceiling, Wall, Ceiling, Wall All Drywall And Joint Compound	6,7,8,12,13,18,28,32,1000,1001,1040,1060,1070 1071,1072,1080,1090,1100,1180,1490,1600,1601 1611,1640,1641,1660,1680,1681,1901,2030,2031 2041,2050,2090,2100,2110,2111,2112,2130,2140 2150,2160,2170,2171,2172,2174,2175,2176,2430 2572,2910,2911	A	0	18230	0	100	None Detected	No	
Asbestos	S0039 ABC	Floor All Mastic	1040,1130,1150,1170	A	0	2328	0	0	None Detected	No	
Asbestos	S0040 ABCDEFG	Wall All Paint	13,19,20,21,22,24,25,26,27,28,29,30,31,32,1000 1490,1590,1591,1600,1601,1610,1612,1614,1615 1617,1620,1621,1640,1641,1650,1651,1652,1653 1660,1680,1681,1690,1691,1710,1711,1730,1750 2210,2410,2420,2430,2570,2571,2600,2900	A	0	44075	0	0	None Detected	No	
Asbestos	S0041 AB	Floor All Mastic	1060	A	0	310	0	0	None Detected	No	
Asbestos	S0042 ABC	Wall Door Caulking Beige	24,30	A	20	0	0	0	None Detected	No	
Asbestos	S0043 AB	Floor All Mastic	1350,1420,1481,1640,1641,1680,1681,2010,2011	A,B	0	4176	0	0	None	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
			2190						Detected		
Asbestos	S0044 AB	Floor All Mastic	2040,2180,2270	A,C	0	2948	0	0	None Detected	No	
Asbestos	S0045 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Peach With Blue And White Smears	2140,2160	A	0	1422	0	0	None Detected	No	
Asbestos	S0046 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", White With Blue And Grey Smears	2040,2060,2070,2080,2090,2100,2190,2191	A	0	5503	0	0	None Detected	No	
Asbestos	S0048 AB	Floor All Mastic	1351,1420,1480,1481,1570	B	0	2145	0	0	None Detected	No	
Asbestos	S0049 ABCDEFG	Ceiling, Wall, Ceiling, Wall All Drywall And Joint Compound	35,36,1003,1280,1300,1320,1340,1342,1350,1351,1360,1390,1401,1420,1440,1480,1481,1482,2002,2220,2281,2400,2401,2542,2580	B	0	14200	0	0	None Detected	No	
Asbestos	S0050 ABCDEFG	Wall, Structure, Wall All Paint	33,34,35,36,37,1003,1280,1300,1320,1340,1342,1350,1351,1352,1360,1390,1401,1410,1420,1430,1440,1450,1460,1470,1480,1481,1482,1570,1571,1572,1573,1618,2002,2220,2235,2240,2260,2280,2281,2320,2340,2360,2370,2390,2400,2401,2542,2580,2581,2920,2930	B	0	56500	0	0	Chrysotile	Yes	NF
Asbestos	S0051 ABCDE	Ceiling, Wall, Ceiling All Plaster	1003,1450,1482,1618,2002,2400	B	0	2000	0	0	None Detected	No	
Asbestos	S0052 AB	Ceiling, Wall All Mastic	1482,2400,2401	B	0	290	0	0	None Detected	No	
Asbestos	S0053 ABC	Floor All Mastic	2030,2031,2050,2220,2250	A,B,C	0	3989	0	0	None Detected	No	
Asbestos	S0054 ABCDEFG	Wall All Paint	38,39,1270,1290,1330,1331,2230,2250,2251,2270	C	0	14850	0	0	Chrysotile	Yes	NF
Asbestos	S0055 ABC	Ceiling All Plaster	1270	C	0	50	0	0	None Detected	No	
Asbestos	S0056 ABCDE	Ceiling, Wall All Drywall And Joint Compound	39,1330,2230,2250,2251,2270	C	0	325	0	0	None Detected	No	
Asbestos	S0057 ABCDEFG	Wall All Paint	41,42,44,45,46,48,49,50,51,1004,1770,1771,1773,1790,1791,1792,1797,2290,2291,2292,2293,2294,2310,2330,2350	D	0	22500	0	0	Chrysotile	Yes	NF
Asbestos	S0058 ABCDE	Ceiling All Plaster	40,45,46,1771,1790,1791,2310,2330	D	0	1200	0	0	Chrysotile	No	
Asbestos	S0059 ABCDE	Ceiling, Wall, Ceiling All Drywall And Joint Compound	1004,1791,1792,2350	D	0	500	0	0	None Detected	No	
Asbestos	S0060 ABC	Floor All Vinyl Floor Tile And Mastic 12"x12", Black With White Streaks	2330	D	0	829	0	0	None Detected	No	
Asbestos	S0061 ABC	Wall Window, Door Caulking Beige	53	A	0	78	0	0	None Detected	No	
Asbestos	S0062 ABC	Wall Door Caulking Grey	54	B	0	0	5	0	Chrysotile	Yes	NF
Asbestos	S0063 ABC	Wall Window Caulking Beige	54	B	0	0	40	0	Chrysotile	Yes	NF
Asbestos	S0064 ABC	Wall Expansion Joint Caulking White	54	B	0	0	10	0	Chrysotile	Yes	NF
Asbestos	S0065 ABC	Wall Expansion Joint Caulking	55	C	0	0	2	0	Chrysotile	Yes	NF

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	S0066 ABC	Wall Window, Door Caulking Beige	55	C	0	0	15	0	Chrysotile	Yes	NF
Asbestos	S0067 ABC	Wall Expansion Joint Caulking White	56	D	0	0	4	0	None Detected	No	
Asbestos	S0068 ABC	Wall Door Caulking White	56	D	0	0	5	0	Chrysotile	Yes	NF
Asbestos	S0069 ABC	Wall Window Caulking Beige	56	D	0	0	10	0	None Detected	No	
Asbestos	S0070 ABC	Wall Door, Window Caulking White	57	E	0	0	15	0	Chrysotile	Yes	NF
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in)	1510,1550,1560,1620,1770,2055,2341,2350,2570 2600	A,B,D, E	0	10350	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2'x2', Coarse Texture 01/09/07	1570,1640	A,B	0	2600	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2'x2', Fleck And Pinhole	18	A	0	175	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Dense Fissure And Pinhole	31,1001,1711,2001,2540	A	0	4000	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Fleck And Pinhole	12,31,50,51,1000,1001,1004,1005,1130,1150,1170 1190,1210,1220,1230,1250,1350,1360,1611,1614 1711,1900,1901,1910,2001,2030,2031,2040,2050 2060,2070,2080,2090,2100,2110,2111,2112,2130 2140,2150,2160,2170,2171,2172,2173,2174,2175 2176,2180,2190,2420,2540,2570,2900,2910,2911	A,B,D, E	0	24460	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Fleck And Pinhole 10/29/07	6,7,8,13,16,21,22,1070,1071,1072,1080,1100 1911,2024	A	0	2805	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Medium Fissures And Pinholes	34,37,38,1280,1290,1300,1330,1331,1350,1351 1352,1360,1390,1401,1420,1470,1480,1481,1618 2002,2235	B,C	0	20558	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Medium Fissures And Pinholes 12/06/06	10,1090,1110	A	0	1135	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Small And Medium Pinhole	1210,2030,2031,2050	A	0	2250	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Small And Medium Pinhole 01/03/98	1130,1150	A	0	1426	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Small Fleck And Pinhole	37,2002,2235	B	0	2020	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Small Fleck And Pinhole 10/29/07	1280	B	0	117	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Ceiling Tiles (lay-in) 2x4 Small Flecks And Pinholes	1290,1330,1331	C	0	519	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling All Drywall And Joint Compound	1005,1510	E	0	250	0	0	Non Asbestos	No	
Asbestos	V0000	Floor All Vinyl Floor Tile And Mastic	6,7,8,1080,1100,1110,1360,1420,1510,2030,2031 2050,2195,2220,2250,2360	A,B,C, E	0	9080	0	0	Non Asbestos	No	
Asbestos	V0000	Wall Window Caulking Silicone	2,7,8,12,40,41,43,1000,1001,1040,1060,1070	A,B,C,	0	0	661	0	Non	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
			1071,1072,1080,1100,1110,1120,1140,1150,1170 1180,1190,1200,1210,1220,1230,1240,1250,1270 1290,1330,1510,1520,1530,1540,1550,1570,1640 1771,1790,1791,1900,1910,1911,2001,2002,2010 2024,2030,2031,2040,2041,2050,2060,2070,2080 2090,2100,2110,2111,2112,2130,2140,2150,2160 2170,2171,2172,2175,2176,2180,2190,2191,2210 2220,2230,2235,2240,2250,2260,2270,2291,2292 2293,2310,2320,2330,2340,2360,2370,2390,2540 2541,2570,2573,2590,2900	D,E					Asbestos		
Asbestos	V0000	Wall All Drywall And Joint Compound	1520,1530	E	0	800	0	0	Non Asbestos	No	
Asbestos	V0000	Wall All Paint	1005	E	0	2500	0	0	Non Asbestos	No	
Paint	L0001	Wall Plaster Various Colours	2,3,4,5,9,10,11,12,13,14,15,16,17 22,23,1020,1040,1060,1070,1090,1100,1110,1114,1 120,1130,1140 1150,1170,1180,1190,1200,1210,1220,1230,1240,12 50,1615,1617,1630 1650,1653,1692,1693,1900,1901,1910,1911,2010,20 11,2020,2021,2022 2023,2024,2030,2031,2040,2041,2050,2060,2070,20 80,2090,2100,2110 2111,2112,2130,2140,2150,2160,2170,2171,2172,21 73,2174,2175,2176 2180,2190,2191,2210,2501,2541,2570,2571,2573,29 00,2910,2911	A	0	49972	0	0	Lead (Low)	Yes	-
Paint	L0002	Structure Metal Black	16,1000,1001,1900,1901,1910,1911,2001,2024,2210 ,2540	A	0	9510	0	0	Lead (Low)	Yes	-
Paint	L0003	Wall Plaster Various Colours	2,1001,1617,1901,1910,1911,2001,2024,2173,2501, 2540,2900	A	0	15920	0	0		No	-
Paint	L0004	Floor Concrete (poured) Grey	3,4,5,15,19,26,27,28,1020,1240,1590,1591,1631 1660,1730	A	0	3503	0	0	Lead (High)	Yes	-
Paint	L0005	Wall Wood White/beige	1001,2001,2540	A	0	4500	0	0		No	-
Paint	L0006	Wall Drywall And Joint Compound Various Colours	6,7,8,12,13,18,28,32,1000,1070,1071,1072,1080 1090,1100,1490,1600,1601,1610,1611,1640,1641,16 60,1680,1681,1901 2030,2031,2041,2050,2090,2100,2110,2111,2112,21 30,2140,2150,2160 2170,2171,2172,2174,2175,2176,2430,2572,2910,29 11	A	0	13890	0	100		No	-
Paint	L0007	Wall Concrete (precast) Various Colours	13,19,20,21,22,24,25,26,27,28,29,30,31 32,1000,1490,1590,1591,1600,1601,1610,1612,1614 ,1615,1617,1620 1621,1631,1640,1641,1650,1651,1652,1653,1660,16	A	0	48430	0	0	Lead (Low)	Yes	-

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
			80,1681,1690,1691 1710,1711,1730,1750,2210,2410,2420,2430,2570,2571,2600,2900								
Paint	L0008	Wall Drywall And Joint Compound Various Colours	35,36,1003,1280,1300,1320,1340,1342,1350,1351,1360,1390,1401 1420,1440,1480,1481,1482,2002,2281,2400,2401,2410,2542,2580	A,B	0	5650	0	0		No	-
Paint	L0009	Wall Concrete (precast) Various Colours	33,34,35,36,37,1003,1280,1300,1320,1340,1342,1350,1351 1352,1360,1390,1401,1410,1420,1430,1440,1450,1460,1470,1480,1481 1482,1570,1571,1572,1573,1618,2002,2220,2235,2240,2260,2280,2281 2320,2340,2360,2370,2390,2400,2401,2542,2580,2581,2920,2930	B	0	56700	0	0	Lead (Low)	Yes	-
Paint	L0010	Ceiling Plaster Various Colours	1410,1450,1482,1618,2002,2400	B	0	1400	0	0		No	-
Paint	L0011	Floor Concrete (poured) Grey	1320,1340,1342,1410,1430,2280,2281	B	0	2975	0	0		No	-
Paint	L0012	Wall Wood White	1401,1430	B	0	40	0	0		No	-
Paint	L0013	Structure Metal Various Colours	37,1350,1351,1352,1360,1410,2235,2280	B	0	8103	0	0	Lead (High)	Yes	-
Paint	L0014	Wall Concrete (precast) Various Colours	38,39,1270,1290,1330,1331,2230,2250,2251,2270	C	0	14850	0	0		No	-
Paint	L0015	Ceiling Plaster Various Colours	1270	C	0	50	0	0		No	-
Paint	L0016	Wall Drywall And Joint Compound Various Colours	39,1330,2230,2250,2251,2270	C	0	325	0	0		No	-
Paint	L0018	Wall Concrete (precast) Various Colours	41,42,44,45,46,48,49,50,51,1004,1005,1770,1771 1773,1774,1790,1791,1792,1797,2290,2291,2292,2293,2294,2310,2330 2350	D,E	0	31825	0	0	Lead (Low)	Yes	-
Paint	L0019	Ceiling Plaster Various Colours	40,45,46,1771,1790,1791,2310,2330	D	0	1200	0	0	Lead (Low)	Yes	-
Paint	L0020	Floor Concrete (poured) Grey	41,1774,2350,2352,2353,2354	D	0	595	0	0	Lead (Low)	Yes	-
Paint	L0021	Wall Drywall And Joint Compound Various Colours	1004,1005,1792,2350	D,E	0	500	0	0		No	-
Paint	L0022	Structure Metal Various Colours	48,51,2352,2353	D	0	978	0	0	Lead (High)	Yes	-
Paint	L0024	Wall Drywall And Joint Compound	1510,1520,1530	E	0	900	0	0		No	-
Paint	L0025	Floor Concrete (poured) Grey	1520,1540	E	0	4730	0	0	Lead (Low)	Yes	-
Paint	L0026	Structure Steel Various Colours	1520	E	0	0	0	100	Lead (Low)	Yes	-
Paint	L0027	Wall Metal Grey On Door	54	B	0	40	0	0	Lead (High)	Yes	-
Lead Product	V9000	Batteries In Emer. Lights	2,13,31,37,1000,1001,1003,1490,1510,1520,1530,1540,1550 1560,1590,1591,1612,1618,1621,1640,1641,1711,1770,2001,2002,2190 2235,2350,2430,2540,2541,2600	A,B,D,E	0	0	87	0	Lead Product	Yes	-
Lead Product	V9000	Bell And Spigot Fittings	41,1590,1591,1660,1792,2353,2354	A,D	0	0	0	100	Lead Product	Yes	-
PCB	P0001	Caulking Beige, Window And Door	24,30	A	20	0	0	0	-	No	-

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
PCB	P0002	Caulking Beige Window/door	53	A	0	0	0	0	-	No	-
PCB	P0003	Caulking Grey, Door	54	B	0	0	0	0	-	No	-
PCB	P0004	Caulking Beige Window/door	55	C	0	0	0	0	-	No	-
PCB	P0005	Caulking Window/door	56	D	0	0	0	0	-	No	-
PCB	P0006	Caulking White, Door	57	E	0	0	0	0	-	No	-
PCB	P0007	Caulking Expansion Joint	54,55,56	B,C,D	0	0	0	0	-	No	-
PCB	V0000	Light Ballasts	2,3,4,5,6,7,8,9,10,11,12,13,14 15,16,17,18,19,20,21,22,23,24,25,26,27 28,29,30,31,34,35,36,37,38,39,40,41,42 43,44,45,46,47,48,49,50,51,1000,1001,1003,1004 1005,1020,1040,1060,1070,1071,1072,1080,1090,1100,1110,1114,1120 1130,1140,1150,1170,1180,1190,1200,1210,1220,1230,1240,1250,1270 1280,1290,1300,1320,1330,1331,1340,1342,1343,1350,1351,1352,1360 1390,1400,1401,1410,1420,1430,1440,1450,1460,1470,1480,1481,1482 1490,1570,1571,1572,1573,1590,1591,1610,1611,1612,1614,1615,1617 1618,1620,1621,1624,1630,1631,1640,1641,1650,1651,1652,1653,1660 1680,1681,1690,1691,1692,1693,1710,1711,1730,1731,1770,1771,1773 1790,1791,1792,1797,1900,1901,1910,1911,2001,2002,2010,2011,2020 2021,2022,2023,2024,2030,2031,2040,2041,2050,2060,2070,2080,2090 2100,2110,2111,2112,2130,2140,2150,2160,2170,2171,2172,2173,2174 2175,2176,2180,2190,2191,2210,2220,2230,2235,2240,2250,2251,2260 2270,2280,2281,2290,2291,2292,2293,2294,2310,2320,2330,2340,2350 2360,2370,2390,2400,2401,2410,2420,2430,2501,2502,2541,2542,2570 2571,2572,2573,2580,2581,2590,2600,2900,2910,2911,2920,2930	A,B,C,D,E	0	0	0	100	-	No	-
PCB	V0000	Transformer	1660	A	0	0	1	0	-	No	-
Hg	V9000	Fluorescent Light Tube	2,3,4,5,6,7,8,9,10,11,12,13,14 15,16,17,18,19,20,21,22,23,24,25,26,27 28,29,30,31,34,35,36,37,38,39,40,41,42 43,44,45,46,47,48,49,50,51,1000,1001,1003,1004 1005,1020,1040,1060,1070,1071,1072,1080,1090,1100,1110,1114,1120	A,B,C,D,E	0	0	0	100	Hg	Yes	-

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
			1130,1140,1150,1170,1180,1190,1200,1210,1220,1230,1240,1250,1270 1280,1290,1300,1320,1330,1331,1340,1342,1343,1350,1351,1352,1360 1390,1400,1401,1410,1420,1430,1440,1450,1460,1470,1480,1481,1482 1490,1570,1571,1572,1573,1590,1591,1610,1611,1612,1614,1615,1617 1618,1620,1621,1624,1630,1631,1640,1641,1650,1651,1652,1653,1660 1680,1681,1690,1691,1692,1693,1710,1711,1730,1750,1770,1771,1773 1790,1791,1792,1797,1900,1901,1910,1911,2001,2002,2010,2011,2020 2021,2022,2023,2024,2030,2031,2040,2041,2050,2060,2070,2080,2090 2100,2110,2111,2112,2130,2140,2150,2160,2170,2171,2172,2173,2174 2175,2176,2180,2190,2191,2210,2220,2230,2235,2240,2250,2251,2260 2270,2280,2281,2290,2291,2292,2293,2294,2310,2320,2330,2340,2350 2360,2370,2390,2400,2401,2410,2420,2430,2501,2540,2541,2542,2570 2571,2572,2573,2580,2581,2590,2600,2900,2910,2911,2920,2930								
Hg	V9000	Pressure Gauge	2280	B	0	0	1	0	Hg	Yes	-
Hg	V0000	Thermostat	7,8,1110,1130,1140,1150,1170,1180,1190,1210,1220,1230,1250 1571,1773,1797,2010,2030,2031,2040,2041,2050,2060,2070,2080,2090 2100,2110,2111,2112,2130,2140,2150,2160,2170,2171,2172,2174,2175 2176,2180,2190	A,B,D	0	0	42	0	-	No	-

Legend:

Sample number		Units			
S####	Asbestos sample collected	SF	Square feet	NF	Non Friable material.
L####	Paint sample collected	LF	Linear feet	F	Friable material
P####	PCB sample collected	EA	Each	PF	Potentially Friable material
M####	Mould sample collected	%	Percentage		
V####	Material visually similar to numbered sample collected				
V0000	Known non Hazardous Material				
V9000	Material is visually identified as Hazardous Material				
V9500	Material is presumed to be Hazardous Material				
[Loc. No.]	Abated Material				

APPENDIX VI
HMIS All Data Report

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1 : Crawlspace at 1660

Floor: NA

Room #:

Area (sqft): 4000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Not Found	None Found														
Duct	Not Found	None Found														
Floor	All	Concrete (poured)			B	Y										
Mechanical Equipment	Not Found	None Found														
Piping	All	Fibreglass			B	Y										
Piping	All	Parging Cement	Fitting		B	Y			4(6)		EA	S0017AB	Chrysotile	25-50%	Confirmed Asbestos	F
Structure	All	Steel			B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2 : Vestibule

Floor: 1

Room #:

Area (sqft): 75

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		75			SF	V0002	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	A	Y		75			SF	V0034	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		60			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster, Textured		Paint	A	Y		60			SF	V0036	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		2			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2 : Vestibule

Floor: 1

Room #:

Area (sqft): 75

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	60		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall ¹	Plaster	60		SF	V0003	Various colours	Pb: 0.0014 %	No	
Ceiling	Plaster	75		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

1 - Textured

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2 : Vestibule

Floor: 1

Room #:

Area (sqft): 75

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2 : Vestibule

Floor: 1

Room #:

Area (sqft): 75

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2 : Vestibule

Floor: 1

Room #:

Area (sqft): 75

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #3 : Closet

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		55			SF	V0002	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #3 : Closet

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Floor	Concrete (poured)	55		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	
Ceiling	Plaster	55		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #3 : Closet

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #3 : Closet

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #4 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures and pinholes			C	Y		50			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		50			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #4 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Floor	Concrete (poured)	50		SF	L0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #4 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #4 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #5 : Storage

Floor: 1

Room #:

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	A	Y		40			SF	V0034	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #5 : Storage

Floor: 1

Room #:

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Floor	Concrete (poured)	40		SF	L0004	Grey	Pb: 0.137 %	Lead (High)	
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Ceiling	Plaster	40		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #5 : Storage

Floor: 1

Room #:

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #5 : Storage

Floor: 1

Room #:

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #6 : Files

Floor: 1

Room #: 108A

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		40(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		40			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		40			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		40			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		40			SF	V0021	[None]	N.D.	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		40			SF	V0000	Non-Asbestos		None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Drywall and joint compound		Paint	C	N		150			SF	V0038	None Detected	N.D.	None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #6 : Files

Floor: 1

Room #: 108A

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	150		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #6 : Files

Floor: 1

Room #: 108A

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #6 : Files

Floor: 1

Room #: 108A

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #7 : Office

Floor: 1

Room #: 108B

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		100			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		100			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0021	[None]	N.D.	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0000	Non-Asbestos		None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Drywall and joint compound		Paint	C	N		200			SF	V0038	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #7 : Office

Floor: 1

Room #: 108B

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	200		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #7 : Office

Floor: 1

Room #: 108B

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #7 : Office

Floor: 1

Room #: 108B

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #8 : Office

Floor: 1

Room #: 108C

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		100			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		100			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0021	[None]	N.D.	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0000	Non-Asbestos		None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Drywall and joint compound		Paint	C	N		200			SF	V0038	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #8 : Office

Floor: 1

Room #: 108C

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	200		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #8 : Office

Floor: 1

Room #: 108C

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #8 : Office

Floor: 1

Room #: 108C

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #9 : Men's Washroom

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		55(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		55			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #9 : Men's Washroom

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #9 : Men's Washroom

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #9 : Men's Washroom

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #10 : Women's Washroom

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes 12/06/06			C	Y		55			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #10 : Women's Washroom

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #10 : Women's Washroom

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #10 : Women's Washroom

Floor: 1

Room #:

Area (sqft): 55

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #11 : Vestibule
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 100

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		200			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #11 : Vestibule
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 100

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	200		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board
Location: #11 : Vestibule
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 100

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #11 : Vestibule
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 100

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #12 : Office

Floor: 1

Room #: 109A

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		150			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	D	N		150			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		150			SF	V0035	None Detected	N.D.	None	
Floor	All	Vinyl Floor Tile and Mastic			A	Y		150			SF	V0018	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Drywall and joint compound		Paint	C	N		50			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #12 : Office

Floor: 1

Room #: 109A

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	50		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #12 : Office

Floor: 1

Room #: 109A

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #12 : Office

Floor: 1

Room #: 109A

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #13 : Corridor

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		150			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	D	N		150			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		150			SF	V0035	None Detected	N.D.	None	
Floor	All	Vinyl Floor Tile and Mastic			A	Y		150			SF	V0018	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		50			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	C	N		50			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	
Wall	All	Paint			A	Y		300			SF	S0040A	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #13 : Corridor

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	50		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Concrete (precast)	300		SF	L0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #13 : Corridor

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #13 : Corridor

Floor: 1

Room #:

Area (sqft): 150

2023-07-28

Quantities shown above are based on visual approximations only and may be subject to variation. Copyright Pinchin Ltd. 2023

Page 18 of 415.

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #13 : Corridor

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #14 : Women's Washroom
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 40

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		40(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		40			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #14 : Women's Washroom
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 40

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board
Location: #14 : Women's Washroom
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 40

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #14 : Women's Washroom
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 40

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #15 : Storage

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		50			SF	V0020	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #15 : Storage

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Floor	Concrete (poured)	50		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #15 : Storage

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #15 : Storage

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #16 : Vestibule

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		30			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		30			SF	V0000	Non-Asbestos		None	
Ceiling	All	Plaster		Paint	C	Y		75			SF	V0002	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel		Paint	C	N										
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster, Textured		Paint	A	Y		150			SF	V0036	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #16 : Vestibule

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Structure	Metal	60		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #16 : Vestibule

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #16 : Vestibule

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #17 : Washroom

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		50			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #17 : Washroom

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #17 : Washroom

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #17 : Washroom

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #18 : Vestibule

Floor: 1

Room #:

Area (sqft): 175

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2'x2', fleck and pinhole			C	Y		175			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Wood			A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		25			SF	V0038	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #18 : Vestibule

Floor: 1

Room #:

Area (sqft): 175

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	25		SF	L0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #18 : Vestibule

Floor: 1

Room #:

Area (sqft): 175

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #18 : Vestibule

Floor: 1

Room #:

Area (sqft): 175

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #19 : Meter Room

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Plastic	C	Y										
Piping	All	Not Insulated			A	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #19 : Meter Room

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Structure	Concrete (poured)	60		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Floor	Concrete (poured)	60		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #19 : Meter Room

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #19 : Meter Room

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #20 : Vestibule

Floor: 1

Room #: 171

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #20 : Vestibule

Floor: 1

Room #: 171

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #20 : Vestibule

Floor: 1

Room #: 171

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #20 : Vestibule

Floor: 1

Room #: 171

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #21 : Washroom

Floor: 1

Room #: 171C

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		48			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #21 : Washroom

Floor: 1

Room #: 171C

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #21 : Washroom

Floor: 1

Room #: 171C

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #21 : Washroom

Floor: 1

Room #: 171C

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #22 : Shower

Floor: 1

Room #: 171A

Area (sqft): 70

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		48			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Plaster		Paint	A	Y		50			SF	V0034	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #22 : Shower

Floor: 1

Room #: 171A

Area (sqft): 70

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Wall	Plaster	50		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #22 : Shower

Floor: 1

Room #: 171A

Area (sqft): 70

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #22 : Shower

Floor: 1

Room #: 171A

Area (sqft): 70

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #23 : Washroom

Floor: 1

Room #: 169C

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	A	Y		40			SF	V0034	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			B	Y		40			SF					
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		125			SF	V0034	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #23 : Washroom

Floor: 1

Room #: 169C

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Plaster	125		SF	V0001	Various colours		Pb: 0.0598 %	Lead (Low)
Ceiling	Plaster	40		SF	V0001	Various colours		Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #23 : Washroom

Floor: 1

Room #: 169C

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #23 : Washroom

Floor: 1

Room #: 169C

Area (sqft): 40

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #24 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		100			SF	V0020	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		100			SF	V0040	None Detected	N.D.	None	
Wall	Door	Caulking, Beige			A	Y		10			LF	S0042AB	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #24 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	100		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #24 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #24 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No
Caulking	10	LF	P0001	Beige, door	<5 mg/kg	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #25 : Vestibule

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Concrete (poured)		Paint	C	Y		150			SF					
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		400			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #25 : Vestibule

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (poured)	400		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Ceiling	Concrete (poured)	150		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #25 : Vestibule

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #25 : Vestibule

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #26 : Storage
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 162B
Last Re-Assessment: 2022-08-31
Area (sqft): 175

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			A	Y										
Floor	All	Concrete (poured)			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Plastic	C	Y										
Piping	All	Not Insulated			A	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #26 : Storage
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 162B
Last Re-Assessment: 2022-08-31
Area (sqft): 175

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	450		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Structure	Concrete (poured)	175		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Floor	Concrete (poured)	175		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board
Location: #26 : Storage
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 162B
Last Re-Assessment: 2022-08-31
Area (sqft): 175

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #26 : Storage
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 162B
Last Re-Assessment: 2022-08-31
Area (sqft): 175

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #27 : Storage

Floor: 1

Room #: 162D

Area (sqft): 175

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			A	Y										
Floor	All	Concrete (poured)			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Plastic	C	Y										
Piping	All	Not Insulated			A	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #27 : Storage

Floor: 1

Room #: 162D

Area (sqft): 175

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	450		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Structure	Concrete (poured)	175		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Floor	Concrete (poured)	175		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #27 : Storage

Floor: 1

Room #: 162D

Area (sqft): 175

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #27 : Storage

Floor: 1

Room #: 162D

Area (sqft): 175

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #28 : Elevator Machine Room
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 161G
Last Re-Assessment: 2022-08-31

Area (sqft): 40

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		100			SF	V0038	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	A	Y		40			SF					
Mechanical Equipment	Hoisting Mechanism	Not Insulated			A	Y										
Piping	All	Fibreglass			C	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #28 : Elevator Machine Room
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 161G
Last Re-Assessment: 2022-08-31

Area (sqft): 40

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Ceiling	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Floor	Concrete (poured)	40		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board
Location: #28 : Elevator Machine Room
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 161G
Last Re-Assessment: 2022-08-31

Area (sqft): 40

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #28 : Elevator Machine Room
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 161G
Last Re-Assessment: 2022-08-31

Area (sqft): 40

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #29 : Washroom

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		60(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		60			SF	V0035	None Detected	N.D.	None	
Duct	Not Found	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	Not Found	None Found														
Piping	All	Fibreglass			C	Y										
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall		Concrete (precast)			A	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #29 : Washroom

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #29 : Washroom

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #29 : Washroom

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #30 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		100			SF	V0020	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		100			SF	V0040	None Detected	N.D.	None	
Wall	Door	Caulking, Beige			A	Y		10			LF	S0042C	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #30 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	100		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #30 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #30 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No
Caulking	10	LF	V0001	Beige, door	<5 mg/kg	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #31 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		250			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		250			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 dense fissure and pinhole			C	Y		500			SF	V0000	Non-Asbestos		None	
Duct	Not Found	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	Y										
Wall	All	Paint			A	Y		2500			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #31 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	2500		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #31 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	2	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #31 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

2023-07-28

Quantities shown above are based on visual approximations only and may be subject to variation. Copyright Pinchin Ltd. 2023

Page 39 of 415.

ALL DATA REPORT

Location: #31 : Corridor
Survey Date: 2022-08-22

Floor: 1

School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 1000

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #32 : Custodian Washroom

Floor: 1

Room #: 160B

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	A	Y		40			SF	V0038	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			C	Y		40			SF	V0018	None Detected	N.D.	None	
Mechanical Equipment		None Found														
Piping	All	Fibreglass			C	N										
Structure	Deck	Steel			C	N										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		150			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #32 : Custodian Washroom

Floor: 1

Room #: 160B

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	150		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Ceiling	Drywall and joint compound	40		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Concrete (precast)	150		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #33 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		50			SF	V0015	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y		50			SF					
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #33 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Masonry	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #34 : Corridor
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 150

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		150			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #34 : Corridor
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 150

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #34 : Corridor
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 150

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #34 : Corridor
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 150

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #35 : Washroom

Floor: 2

Room #: 239A

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		50			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		50			SF	V0049	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible															
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			B	Y										
Wall	All	Paint			A	Y		150(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #35 : Washroom

Floor: 2

Room #: 239A

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Ceiling	Drywall and joint compound	50		SF	V0008	Various colours	Pb: <0.0005 %	No	
Wall	Concrete (precast)	150		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #35 : Washroom

Floor: 2

Room #: 239A

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #35 : Washroom

Floor: 2

Room #: 239A

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #36 : Washroom

Floor: 2

Room #: 237A

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		50			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		50			SF	V0049	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible															
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			B	Y										
Wall	All	Paint			A	Y		150(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #36 : Washroom

Floor: 2

Room #: 237A

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Ceiling	Drywall and joint compound	50		SF	V0008	Various colours		Pb: <0.0005 %	No
Wall	Concrete (precast)	150		SF	V0009	Various colours		Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #36 : Washroom

Floor: 2

Room #: 237A

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #36 : Washroom

Floor: 2

Room #: 237A

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #37 : Stairwell

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		190			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small fleck and pinhole			C	Y		10			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	N										
Wall	All	Masonry			A	Y										
Wall	All	Paint			A	Y		1000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #37 : Stairwell

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Structure	Metal	200		SF	V0013	Various colours	Pb: 0.191 %	Lead (High)	
Wall	Masonry	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #37 : Stairwell

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #37 : Stairwell

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #37 : Stairwell

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #38 : Storage
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 131A
Last Re-Assessment: 2022-08-31

Area (sqft): 100

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		300			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100(7)			SF	V0010	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Paint			A	Y		250(7)			SF	S0054D	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #38 : Storage
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 131A
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	250		SF	V0014	Various colours	Pb: 0.0014 %	No	

Client: Upper Canada District School Board
Location: #38 : Storage
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 131A
Last Re-Assessment: 2022-08-31

Area (sqft): 100

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #38 : Storage
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 131A
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #39 : Server Room

Floor: 2

Room #: 225A

Area (sqft): 75

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		75(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			B	Y		75(7)			SF	V0011	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Mechanical Equipment	All	None Found														
Other	All	Mastic, Black			C	N		271(7)			SF	V0032	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		75			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	C	Y		75			SF	S0056E	None Detected	N.D.	None	
Wall	All	Paint			A	Y		250(7)			SF	V0054	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #39 : Server Room

Floor: 2

Room #: 225A

Area (sqft): 75

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	250		SF	V0014	Various colours	Pb: 0.0014 %	No
Wall	Drywall and joint compound	75		SF	L0016	Various colours	Pb: <0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #39 : Server Room

Floor: 2

Room #: 225A

Area (sqft): 75

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #39 : Server Room

Floor: 2

Room #: 225A

Area (sqft): 75

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #40 : Girl's Shower

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		200			SF	S0058A	Chrysotile	<0.5%	None	
Duct	All	None Found														
Floor	All	Ceramic Tiles			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Ceramic Tiles			A	Y										
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #40 : Girl's Shower

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description			Hazard
Ceiling	Plaster	200		SF	L0019	Various colours			Pb: 0.0115 % Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #40 : Girl's Shower

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #40 : Girl's Shower

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #41 : Mechanical Room

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	A	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			A	Y										
Mechanical Equipment	Heating Water Tank	Not Insulated			A	Y										
Piping	All	Fibreglass		Plastic	C	Y										
Piping	All	Not Insulated			A	Y										
Structure	All	Concrete (poured)		Paint	C	Y		150			SF					
Wall	All	Concrete (poured)		Paint	A	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #41 : Mechanical Room

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Structure	Concrete (poured)	150		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Floor	Concrete (poured)	150		SF	L0020	Grey	Pb: 0.0229 %	Lead (Low)	
Wall	Concrete (poured)	300		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #41 : Mechanical Room

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Bell And Spigot Fittings	100	%	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #41 : Mechanical Room

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #41 : Mechanical Room

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #42 : Vestibule
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 177G
Last Re-Assessment: 2022-08-31

Area (sqft): 50

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		75(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #42 : Vestibule
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 177G
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description			Hazard
Wall	Concrete (precast)	75		SF	V0018	Various colours			Pb: 0.0113 % Lead (Low)

Client: Upper Canada District School Board
Location: #42 : Vestibule
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 177G
Last Re-Assessment: 2022-08-31

Area (sqft): 50

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #42 : Vestibule
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 177G
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PCB						
Component	Quantity	Unit	Sample	Sample Description		PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #43 : Washroom

Floor: 1

Room #: 177H

Area (sqft): 100

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Ceramic Tiles			A	Y										
Wall	Window	Caulking, Silicone			C	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #43 : Washroom

Floor: 1

Room #: 177H

Area (sqft): 100

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #43 : Washroom

Floor: 1

Room #: 177H

Area (sqft): 100

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #44 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	All	Steel			C	Y										
Wall	All	Masonry		Paint	A	Y										
Wall	All	Paint			A	Y		100(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #44 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	75		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #44 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #44 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #45 : Washroom

Floor: 1

Room #:

Area (sqft): 80

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		80			SF	V0058	Chrysotile	<0.5%	None	
Duct	All	Not Insulated			C	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			C	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		100(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #45 : Washroom

Floor: 1

Room #:

Area (sqft): 80

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Concrete (precast)	100		SF	V0018	Various colours		Pb: 0.0113 %	Lead (Low)
Ceiling	Plaster	80		SF	V0019	Various colours		Pb: 0.0115 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #45 : Washroom

Floor: 1

Room #:

Area (sqft): 80

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #45 : Washroom

Floor: 1

Room #:

Area (sqft): 80

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #46 : Washroom

Floor: 1

Room #: 179F

Area (sqft): 120

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		120			SF	V0058	Chrysotile	<0.5%	None	
Duct	All	Not Insulated			C	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			C	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		100(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #46 : Washroom

Floor: 1

Room #: 179F

Area (sqft): 120

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Concrete (precast)	100		SF	V0018	Various colours		Pb: 0.0113 %	Lead (Low)
Ceiling	Plaster	120		SF	V0019	Various colours		Pb: 0.0115 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #46 : Washroom

Floor: 1

Room #: 179F

Area (sqft): 120

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #46 : Washroom

Floor: 1

Room #: 179F

Area (sqft): 120

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #47 : Washroom

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		60(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	Y										
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			C	Y										
Structure	Not Accessible	None Found														
Wall	All	Ceramic Tiles			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #47 : Washroom

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #47 : Washroom

Floor: 1

Room #:

Area (sqft): 60

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #48 : Stairwell

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct	All	Not Insulated			C	N										
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Foil Face	C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		1000(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #48 : Stairwell

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1000		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Wall	Masonry	100		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Structure	Metal	200		SF	V0022	Various colours	Pb: 0.269 %	Lead (High)	
Structure	Concrete (poured)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #48 : Stairwell

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #48 : Stairwell

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #49 : Storage

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		75(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #49 : Storage

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Concrete (precast)	75		SF	V0018	Various colours		Pb: 0.0113 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #49 : Storage

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #49 : Storage

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #50 : Corridor

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		100			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Masonry		Paint	B	Y										
Wall	All	Paint			A	Y		400(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #50 : Corridor

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	400		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Wall	Masonry	100		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #50 : Corridor

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #50 : Corridor

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #51 : Corridor
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 700

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		100			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Masonry		Paint	B	Y										
Wall	All	Paint			A	Y		1000(7)			SF	S0057E	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #51 : Corridor
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 700

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1000		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Wall	Masonry	100		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Structure	Metal	700		SF	L0022	Various colours	Pb: 0.269 %	Lead (High)	
Structure	Concrete (poured)	700		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #51 : Corridor
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 700

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #51 : Corridor
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 700

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #53 : Exterior Phase A

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Piping	Rain Water Leader	Not Insulated			A	Y										
Structure	Canopy	Concrete (poured)			C	Y										
Wall	All	Concrete (poured)			A	Y										
Wall	All	Masonry			A	Y										
Wall	Door	Caulking, Beige			A	Y		16			SF	S0061B	None Detected	N.D.	None	
Wall	Window	Caulking, Beige			A	Y		62			SF	S0061AC	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #53 : Exterior Phase A

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Caulking			P0002	Beige window/door	5 mg/kg	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #54 : Exterior Phase B

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Piping	Rain Water Leader	Not Insulated			A	Y										
Structure	Canopy	Metal			C	Y										
Wall	All	Concrete (poured)			A	Y										
Wall	All	Masonry			A	Y										
Wall	All	Metal			A	Y										
Wall	Door	Caulking, Grey			A	Y		5(7)			EA	S0062ABC	Chrysotile	5-10%	Confirmed Asbestos	NF
Wall	Expansion Joint	Caulking, White			A	Y		10(7)			EA	S0064ABC	Chrysotile	10-25%	Confirmed Asbestos	NF
Wall	Window	Caulking, Beige			A	Y		40(7)			EA	S0063ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #54 : Exterior Phase B

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Metal	40		SF	L0027	Grey on door	Pb: 1.15 %	Lead (High)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #54 : Exterior Phase B

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Caulking			P0003	Window/door	<5 mg/kg	No
Caulking		EA	P0007	Expansion joint	5 mg/kg	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #55 : Exterior Phase C

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Structure	Canopy	Metal			C	Y										
Wall	All	Concrete (poured)			A	Y										
Wall	All	Masonry			A	Y										
Wall	All	Metal			A	Y										
Wall	Door	Caulking, Beige			A	Y		2(7)			EA	S0066B	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Expansion Joint	Caulking, Grey			A	Y		2(7)			EA	S0065ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Beige			A	Y		13(7)			EA	S0066AC	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #55 : Exterior Phase C

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Caulking		EA	P0004	Beige window/door	<5 mg/kg	No
Caulking		EA	V0007	Expansion joint	5 mg/kg	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #56 : Exterior Phase D

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Structure	Canopy	Metal			C	Y										
Wall	All	Concrete (poured)			A	Y										
Wall	All	Masonry			A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Metal			A	Y										
Wall	Door	Caulking, White			A	Y		5(7)			EA	S0068ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Expansion Joint	Caulking, White			A	Y		4			EA	S0067ABC	None Detected	N.D.	None	
Wall	Window	Caulking, Beige			A	Y		10			EA	S0069ABC	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #56 : Exterior Phase D

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Caulking		EA	P0005	Window/door	<5 mg/kg	No
Caulking		EA	V0007	Expansion joint	5 mg/kg	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #57 : Exterior Phase E

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Structure	Canopy	Metal			C	Y										
Wall	All	Concrete (poured)			A	Y										
Wall	All	Masonry			A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Metal			A	Y										
Wall	Door	Caulking, White			A	Y		3(7)			EA	S0070ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, White			A	Y		12(7)			EA	V0070	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #57 : Exterior Phase E

Floor: 1

Room #:

Area (sqft): 0

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Caulking		Kg	P0006	White, door	<5 mg/kg	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1000 : Corridor

Floor: 1

Room #: 100

Area (sqft): 2000

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x2 coarse texture			C	Y		2000			SF	S0024ABC	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		1000			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Plaster		Paint	A	Y		2000			SF	S0034D	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	N										
Piping	All	Not Insulated			A	Y										
Structure	Beam Deck Joist	Steel		Paint	C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Masonry			A	Y										
Wall	All	Paint			A	Y		800			SF	V0040	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		30			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1000 : Corridor

Floor: 1

Room #: 100

Area (sqft): 2000

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Concrete (precast)	800		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Structure	Metal	2000		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1000 : Corridor

Floor: 1

Room #: 100

Area (sqft): 2000

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	6	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #1000 : Corridor
Survey Date: 2022-08-23

Floor: 1

School
Room #: 100
Last Re-Assessment: 2022-08-31

Area (sqft): 2000

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High
School

Location: #1000 : Corridor
Survey Date: 2022-08-23

Floor: 1

Room #: 100
Last Re-Assessment: 2022-08-31

Area (sqft): 2000

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1001 : Corridor

Floor: 1

Room #: 1001

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		1000			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 dense fissure and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		300			SF	S0038F	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound			C	Y		300			SF	V0006	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y		3000			SF					
Mechanical Equipment	All	None Found														
Structure	Deck	Steel		Paint	C	N										
Wall	All	Drywall and joint compound			A	Y		10			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound			C	N		50			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster, Textured		Paint	A	Y		5000			SF	S0036B	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		3			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1001 : Corridor

Floor: 1

Room #: 1001

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall ¹	Plaster	5000		SF	L0003	Various colours		Pb: 0.0014 %	No
Structure	Metal	3000		SF	L0002	Black		Pb: 0.0784 %	Lead (Low)
Wall	Wood	1500		SF	L0005	White/beige		Pb: 0.0032 %	No

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1001 : Corridor

Floor: 1

Room #: 1001

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	2	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #1001 : Corridor
Survey Date: 2022-08-19

Floor: 1

Room #: 1001
Last Re-Assessment: 2022-08-31

Area (sqft): 3000

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1001 : Corridor
Survey Date: 2022-08-19

Floor: 1

Room #: 1001
Last Re-Assessment: 2022-08-31

Area (sqft): 3000

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1002 : Corridor

Floor: 1

Room #:

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in)			C	Y										
Ceiling		Drywall and joint compound			C	Y		50			SF	V0006	None Detected	N.D.	None	
Duct		Fibreglass		Foil Face	C	N										
Duct		Fibreglass			C	N										
Duct		Not Insulated			C	N										
Duct		Not Insulated			C	N										
Floor		Terrazzo			A	Y										
Mechanical Equipment	Not Found	None Found														
Structure	Deck	Steel														
Wall		Drywall and joint compound			A	Y		10			SF	V0006	None Detected	N.D.	None	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1003 : Corridor

Floor: 1

Room #:

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound			C	Y		50			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	C	N		3000			SF	S0049C	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Foil Face	C	N										
Structure	Deck	Steel														
Wall	All	Drywall and joint compound		Paint	A	Y		300			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		7000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	All	Plastic		Paint	A	Y		300			SF	S0051C	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1003 : Corridor

Floor: 1

Room #:

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Concrete (precast)	7000		SF	V0009	Various colours		Pb: 0.0121 %	Lead (Low)
Wall	Drywall and joint compound	300		SF	V0008	Various colours		Pb: <0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1003 : Corridor

Floor: 1

Room #:

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	6	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1003 : Corridor

Floor: 1

Room #:

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1003 : Corridor

Floor: 1

Room #:

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1004 : Corridor

Floor: 1

Room #:

Area (sqft): 2000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		1000			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	C	Y		100			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound			A	Y		150			SF	S0059A	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Foil Face	C	N										
Structure	Deck	Steel														
Wall	All	Paint			A	Y		2500(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1004 : Corridor

Floor: 1

Room #:

Area (sqft): 2000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2500		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Ceiling	Drywall and joint compound	150		SF	V0021	Various colours	Pb: <0.0005 %	No	
Wall	Masonry	2500		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1004 : Corridor

Floor: 1

Room #:

Area (sqft): 2000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1004 : Corridor

Floor: 1

Room #:

Area (sqft): 2000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1005 : Corridor

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		1000			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	C	Y		100			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound			A	Y		150			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Foil Face	C	N										
Structure	Deck	Steel														
Wall	All	Paint			A	Y		2500			SF	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1005 : Corridor

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	2500		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)
Ceiling	Drywall and joint compound	150		SF	V0021	Various colours	Pb: <0.0005 %	No
Wall	Masonry	2500		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1005 : Corridor

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1005 : Corridor

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1006 : Corridor

Floor: 1

Room #: 1006

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in)			C	Y										
Ceiling		Drywall and joint compound			C	Y		50			SF	V0006	None Detected	N.D.	None	
Duct	Not Found	None Found														
Floor		Terrazzo			A	Y										
Mechanical Equipment	Not Found	None Found														
Piping		Fibreglass		Foil Face	C	N										
Structure	Deck	Steel														
Wall		Drywall and joint compound			A	Y		10			SF	V0006	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1020 : Mechanical Room

Floor: 1

Room #: 102

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		200(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1020 : Mechanical Room

Floor: 1

Room #: 102

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT											
System	Item	Good	Poor	Unit	Sample	Sample Description				Amount	Hazard
Wall	Plaster	150		SF	V0001	Various colours				Pb: 0.0598 %	Lead (Low)
Floor	Concrete (poured)	200		SF	V0004	Grey				Pb: 0.137 %	Lead (High)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #1020 : Mechanical Room
Survey Date: 2022-08-22

Floor: 1

Room #: 102
Last Re-Assessment: 2022-08-31

Area (sqft): 200

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1020 : Mechanical Room
Survey Date: 2022-08-22

Floor: 1

Room #: 102
Last Re-Assessment: 2022-08-31

Area (sqft): 200

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1040 : Health Room

Floor: 1

Room #: 104

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures and pinholes			C	Y		150			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	D	N		150			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		150			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Floor	All	Vinyl Sheet Flooring			A	Y		150(7)			SF	V0019	Chrysotile	10-25%	Confirmed Asbestos	PF
Floor	All	Mastic		Vinyl Sheet Flooring	D	N		150			SF	S0039B	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		600			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1040 : Health Room

Floor: 1

Room #: 104

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	600		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1040 : Health Room

Floor: 1

Room #: 104

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #1040 : Health Room
Survey Date: 2022-08-19

Floor: 1

Room #: 104
Last Re-Assessment: 2022-08-31

Area (sqft): 150

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1051 : Stair C

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in)			A	Y		100								
Ceiling	All	Plaster			A	Y		100			SF	S0002A	None Detected	N.D.	None	
Duct	Not Found	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	Not Found	None Found														
Piping	Not Found	None Found														
Structure	All	Steel			C	N										
Wall		Masonry			A	Y										
Wall	All	Concrete (poured)			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1060 : Copy

Floor: 1

Room #: 106

Area (sqft): 310

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		310(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures and pinholes			C	Y		310			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	D	N		310			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		310			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Floor	All	Vinyl Sheet Flooring, Pink geometric			A	Y		310			SF	S0022ABC	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Sheet Flooring	D	N		310			SF	S0041AB	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		600			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1060 : Copy

Floor: 1

Room #: 106

Area (sqft): 310

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	600		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1060 : Copy

Floor: 1

Room #: 106

Area (sqft): 310

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1060 : Copy

Floor: 1

Room #: 106

Area (sqft): 310

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1070 : Office Reception

Floor: 1

Room #: 107

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		300(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		300			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		300			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	D	N		300			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		300			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Canvas	C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, white with grey and teal flecks			C	Y		300			SF	S0018A	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Drywall and joint compound		Paint	A	Y		500			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	C	N		500			SF	V0038	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1070 : Office Reception

Floor: 1

Room #: 107

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	500		SF	V0006	Various colours	Pb: 0.0005 %	No
Wall	Plaster	700		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1070 : Office Reception

Floor: 1

Room #: 107

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1070 : Office Reception

Floor: 1

Room #: 107

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1071 : Principal Office

Floor: 1

Room #: 107

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		100			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		100			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Ceiling Tiles (lay-in)	D	N		100			SF	V0038	None Detected	N.D.	None	
Duct	All	Fibreglass		Canvas	C	N										
Floor	All	Vinyl Floor Tile and Mastic			C	Y		100			SF	V0018	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	A	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	C	N		250			SF	V0038	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1071 : Principal Office

Floor: 1

Room #: 107

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	250		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1071 : Principal Office

Floor: 1

Room #: 107

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1071 : Principal Office

Floor: 1

Room #: 107

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1072 : Office

Floor: 1

Room #: 107E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		200			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	D	N		200			SF	V0038	None Detected	N.D.	None	
Duct	All	Fibreglass		Canvas	C	N										
Floor	All	Vinyl Floor Tile and Mastic			C	Y		300			SF	S0018	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	C	N		500			SF	V0038	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1072 : Office

Floor: 1

Room #: 107E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	500		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1072 : Office

Floor: 1

Room #: 107E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1072 : Office

Floor: 1

Room #: 107E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1080 : Student Services

Floor: 1

Room #: 108

Area (sqft): 600

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling tiles (glue-on)			C			600()			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		600(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		600			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		600			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		600			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		600			SF	V0021	[None]	N.D.	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		600			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Drywall and joint compound		Paint	C	N		1500			SF	V0038	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1080 : Student Services

Floor: 1

Room #: 108

Area (sqft): 600

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	1500		SF	L0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1080 : Student Services

Floor: 1

Room #: 108

Area (sqft): 600

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #1080 : Student Services
Survey Date: 2022-08-22

Floor: 1

Room #: 108
Last Re-Assessment: 2022-08-31

Area (sqft): 600

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1090 : Office

Floor: 1

Room #: 109

Area (sqft): 356

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		356(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes 12/06/06			C	Y		356			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	D	N		356			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		356			SF	V0035	None Detected	N.D.	None	
Floor	All	Vinyl Floor Tile and Mastic			A	Y		356			SF	V0018	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Drywall and joint compound		Paint	A	Y		200			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	C	N		500			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		700			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1090 : Office

Floor: 1

Room #: 109

Area (sqft): 356

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	500		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Plaster	700		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1090 : Office

Floor: 1

Room #: 109

Area (sqft): 356

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1090 : Office

Floor: 1

Room #: 109

Area (sqft): 356

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1100 : Classroom

Floor: 1

Room #: 110

Area (sqft): 814

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		814(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		814			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		814			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		814			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, pink with dark pink flecks			A	Y		814			SF	S0021ABC	[None]	N.D.	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		814			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Drywall and joint compound		Paint	C	N		400			SF	S0038B	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1100 : Classroom

Floor: 1

Room #: 110

Area (sqft): 814

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Plaster	1500		SF	V0001	Various colours		Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	L0006	Various colours		Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1100 : Classroom

Floor: 1

Room #: 110

Area (sqft): 814

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1100 : Classroom

Floor: 1

Room #: 110

Area (sqft): 814

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1110 : Staff Room

Floor: 1

Room #: 111

Area (sqft): 724

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		724(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes 12/06/06			C	Y		724			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		724			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		724			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Wood			A	Y										
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1110 : Staff Room

Floor: 1

Room #: 111

Area (sqft): 724

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1110 : Staff Room

Floor: 1

Room #: 111

Area (sqft): 724

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #1110 : Staff Room
Survey Date: 2022-08-19

Floor: 1

School
Room #: 111
Last Re-Assessment: 2022-08-31

Area (sqft): 724

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1114 : Vestibule

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1114 : Vestibule

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	200		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1114 : Vestibule

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1114 : Vestibule

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1120 : Office

Floor: 1

Room #: 112

Area (sqft): 267

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		267(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures and pinholes			C	Y		267			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		267			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		267			SF	V0007	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with light and dark grey flecks			A	Y		267			SF	V0013	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		267			SF	V0037	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1120 : Office

Floor: 1

Room #: 112

Area (sqft): 267

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1120 : Office

Floor: 1

Room #: 112

Area (sqft): 267

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #1120 : Office
Survey Date: 2022-08-19

Floor: 1

Room #: 112
Last Re-Assessment: 2022-08-31

Area (sqft): 267

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1130 : Classroom

Floor: 1

Room #: 113

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small and medium pinhole 01/03/98			C	Y		700			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		26			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Sheet Flooring, Beige geometric			A	Y		726(7)			SF	S0019A	Chrysotile	10-25%	Confirmed Asbestos	PF
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic			D	N		726			SF	V0039	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1130 : Classroom

Floor: 1

Room #: 113

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1130 : Classroom

Floor: 1

Room #: 113

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board**Site:** 1000 Edward Street North, Prescott, ON**Building Name:** South Grenville District High School**Location:** #1130 : Classroom**Floor:** 1**Room #:** 113**Area (sqft):** 726**Survey Date:** 2022-08-19**Last Re-Assessment:** 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1140 : Classroom

Floor: 1

Room #: 114

Area (sqft): 805

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		805(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures and pinholes			C	Y		805			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		805			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, blue with white flecks			A	Y		805			SF	S0007BC	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with light and dark grey flecks			A	Y		805			SF	V0013	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		805			SF	V0037	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1140 : Classroom

Floor: 1

Room #: 114

Area (sqft): 805

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1140 : Classroom

Floor: 1

Room #: 114

Area (sqft): 805

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #1140 : Classroom
Survey Date: 2022-08-22

Floor: 1

School
Room #: 114
Last Re-Assessment: 2022-08-31

Area (sqft): 805

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1150 : Classroom

Floor: 1

Room #: 115

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		700(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		26			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small and medium pinhole 01/03/98			C	Y		726			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Sheet Flooring, Beige geometric			A	Y		726(7)			SF	S0019B	Chrysotile	10-25%	Confirmed Asbestos	PF
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic			D	N		726			SF	S0039C	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		1500			SF	S0034B	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1150 : Classroom

Floor: 1

Room #: 115

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	1500		SF	L0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1150 : Classroom

Floor: 1

Room #: 115

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1150 : Classroom

Floor: 1

Room #: 115

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1170 : Classroom

Floor: 1

Room #: 117

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		726			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Sheet Flooring, Beige geometric			A	Y		726(7)			SF	S0019C	Chrysotile	10-25%	Confirmed Asbestos	PF
Floor	All	Mastic			D	N		726			SF	S0039A	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1170 : Classroom

Floor: 1

Room #: 117

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1170 : Classroom

Floor: 1

Room #: 117

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1170 : Classroom

Floor: 1

Room #: 117

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1180 : Classroom

Floor: 1

Room #: 118

Area (sqft): 820

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		820(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures and pinholes			C	Y		820			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound			C	N		820			SF	S0038A	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		820			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with light and dark grey flecks			A	Y		820			SF	V0013	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		820			SF	V0037	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1180 : Classroom

Floor: 1

Room #: 118

Area (sqft): 820

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1180 : Classroom

Floor: 1

Room #: 118

Area (sqft): 820

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #1180 : Classroom
Survey Date: 2022-08-19**Floor: 1****School**
Room #: 118
Last Re-Assessment: 2022-08-31**Area (sqft): 820**

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1190 : Classroom

Floor: 1

Room #: 119

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		726			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			A	Y		726			SF	V0005	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 beige with brown fleck			A	Y		726			SF	V0012	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1190 : Classroom

Floor: 1

Room #: 119

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1190 : Classroom

Floor: 1

Room #: 119

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #1190 : Classroom
Survey Date: 2022-08-19

Floor: 1

School
Room #: 119
Last Re-Assessment: 2022-08-31

Area (sqft): 726

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1200 : Work Room

Floor: 1

Room #: 120

Area (sqft): 259

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		259(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures and pinholes			C	Y		800			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		259			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with light and dark grey flecks			A	Y		259			SF	V0013	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		259			SF	V0037	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1200 : Work Room

Floor: 1

Room #: 120

Area (sqft): 259

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1200 : Work Room

Floor: 1

Room #: 120

Area (sqft): 259

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1200 : Work Room

Floor: 1

Room #: 120

Area (sqft): 259

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1210 : Classroom

Floor: 1

Room #: 121

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small and medium pinhole			C	Y		400			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		326			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	S0035B	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			A	Y		726			SF	V0005	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 beige with brown fleck			A	Y		726			SF	V0012	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1210 : Classroom

Floor: 1

Room #: 121

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description			Hazard
Wall	Plaster	1500		SF	V0001	Various colours			Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1210 : Classroom

Floor: 1

Room #: 121

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1210 : Classroom

Floor: 1

Room #: 121

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1220 : Classroom

Floor: 1

Room #: 122

Area (sqft): 820

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		820(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures and pinholes			C	Y		800			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		20			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		820			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with light and dark grey flecks			A	Y		820			SF	V0013	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		820			SF	V0037	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1220 : Classroom

Floor: 1

Room #: 122

Area (sqft): 820

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1220 : Classroom

Floor: 1

Room #: 122

Area (sqft): 820

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1220 : Classroom

Floor: 1

Room #: 122

Area (sqft): 820

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1230 : Classroom

Floor: 1

Room #: 123

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		726			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 12x12 beige with brown fleck			A	Y		726			SF	V0012	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	N										
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1230 : Classroom

Floor: 1

Room #: 123

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	1500		SF	L0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1230 : Classroom

Floor: 1

Room #: 123

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1230 : Classroom

Floor: 1

Room #: 123

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1240 : Mechanical Room
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 124
Last Re-Assessment: 2022-08-31
Area (sqft): 238

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		238(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		238			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			A	Y		1			EA					
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		500			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board
Location: #1240 : Mechanical Room
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 124
Last Re-Assessment: 2022-08-31
Area (sqft): 238

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Floor	Concrete (poured)	238		SF	L0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board
Location: #1240 : Mechanical Room
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 124
Last Re-Assessment: 2022-08-31
Area (sqft): 238

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1240 : Mechanical Room
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 124
Last Re-Assessment: 2022-08-31
Area (sqft): 238

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1250 : Classroom

Floor: 1

Room #: 125

Area (sqft): 720

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		720(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		720			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		720			SF	S0035A	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			A	Y		720			SF	V0005	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 beige with brown fleck			A	Y		720			SF	V0012	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	N										
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	S0034A	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1250 : Classroom

Floor: 1

Room #: 125

Area (sqft): 720

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	1500		SF	L0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1250 : Classroom

Floor: 1

Room #: 125

Area (sqft): 720

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #1250 : Classroom
Survey Date: 2022-08-19

Floor: 1

Room #: 125
Last Re-Assessment: 2022-08-31

Area (sqft): 720

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1270 : Staff Room

Floor: 1

Room #: 127

Area (sqft): 761

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		761(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Plaster		Paint	C	Y		50			SF	S0055ABC	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 12x12, beige with white and dark brown fleck			B	Y		761(7)			SF	S0011A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Other	All	Mastic, Black			C	N		761(7)			SF	S0032A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		1200(7)			SF	S0054A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1270 : Staff Room

Floor: 1

Room #: 127

Area (sqft): 761

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Ceiling	Plaster	50		SF	L0015	Various colours	Pb: 0.0025 %	No	
Wall	Concrete (precast)	1200		SF	L0014	Various colours	Pb: 0.0014 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1270 : Staff Room

Floor: 1

Room #: 127

Area (sqft): 761

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1270 : Staff Room

Floor: 1

Room #: 127

Area (sqft): 761

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1280 : Classroom

Floor: 1

Room #: 128

Area (sqft): 1117

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		1117(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		1117			SF	V0015	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1117			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small fleck and pinhole 10/29/07			C	Y		117			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		1117			SF	V0012	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		20			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		20			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		800(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1280 : Classroom

Floor: 1

Room #: 128

Area (sqft): 1117

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	20		SF	V0008	Various colours	Pb: <0.0005 %	No
Wall	Concrete (precast)	800		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1280 : Classroom

Floor: 1

Room #: 128

Area (sqft): 1117

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1280 : Classroom

Floor: 1

Room #: 128

Area (sqft): 1117

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1290 : Classroom

Floor: 1

Room #: 129

Area (sqft): 1290

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		1290(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in)			C	Y		500								
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small flecks and pinholes			C	Y		290			SF	V0000	Non-Asbestos		None	
Floor	All	Vinyl Floor Tile and Mastic, 12x12, white with teal fleck			A	Y		1290(7)			SF	S0010BC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Ceramic Tiles			A	Y										
Other	All	Mastic, Black			C	Y		1290(7)			SF	S0032B	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Structure	Not Accessible	None Found														
Wall	All	Paint			A	Y		1200(7)			SF	S0054B	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1290 : Classroom

Floor: 1

Room #: 129

Area (sqft): 1290

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1200		SF	V0014	Various colours	Pb: 0.0014 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1290 : Classroom

Floor: 1

Room #: 129

Area (sqft): 1290

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1290 : Classroom

Floor: 1

Room #: 129

Area (sqft): 1290

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1300 : Classroom

Floor: 1

Room #: 130

Area (sqft): 1111

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		1111(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		1111			SF	V0015	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1111			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		1111			SF	V0012	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		20			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		20			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		800(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1300 : Classroom

Floor: 1

Room #: 130

Area (sqft): 1111

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	20		SF	V0008	Various colours	Pb: <0.0005 %	No
Wall	Concrete (precast)	800		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1300 : Classroom

Floor: 1

Room #: 130

Area (sqft): 1111

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1300 : Classroom

Floor: 1

Room #: 130

Area (sqft): 1111

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1320 : Storage

Floor: 1

Room #: 132

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		200			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		200			SF	V0049	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	B	Y										
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Paint			A	Y		450(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1320 : Storage

Floor: 1

Room #: 132

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	450		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Floor	Concrete (poured)	200		SF	V0011	Grey	Pb: 0.0051 %	No	
Ceiling	Drywall and joint compound	200		SF	V0008	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1320 : Storage

Floor: 1

Room #: 132

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1320 : Storage

Floor: 1

Room #: 132

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1330 : Classroom

Floor: 1

Room #: 133

Area (sqft): 1210

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		1210(7)			SF	S0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small flecks and pinholes			C	Y		210			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			C	N		250			SF	V0006	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, white with teal fleck			A	Y		1210(7)			SF	S0010A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Other	All	Mastic, Black			A	Y		1210(7)			SF	S0032C	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	A	Y		100			%	S0006C	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		25			SF	S0056A	None Detected	N.D.	None	
Wall	All	Paint			A	Y		3000(7)			SF	S0054C	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1330 : Classroom

Floor: 1

Room #: 133

Area (sqft): 1210

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description			Hazard
Wall	Concrete (precast)	3000		SF	V0014	Various colours			No
Wall	Drywall and joint compound	25		SF	L0016	Various colours			No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1330 : Classroom

Floor: 1

Room #: 133

Area (sqft): 1210

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1330 : Classroom

Floor: 1

Room #: 133

Area (sqft): 1210

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1331 : Prep Room

Floor: 1

Room #: 133

Area (sqft): 319

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		319(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		300			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small flecks and pinholes			C	Y		19			SF	V0000	Non-Asbestos		None	
Floor	All	Vinyl Floor Tile and Mastic			B	Y		319(7)			SF	V0010	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Other	All	Mastic, Black			C	N		319(7)			SF	V0032	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Structure	Not Accessible	None Found														
Wall	All	Paint			A	Y		1200(7)			SF	V0054	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1331 : Prep Room

Floor: 1

Room #: 133

Area (sqft): 319

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	1200		SF	V0014	Various colours	Pb: 0.0014 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1331 : Prep Room

Floor: 1

Room #: 133

Area (sqft): 319

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1331 : Prep Room

Floor: 1

Room #: 133

Area (sqft): 319

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1332 : Stair D

Floor: 1

Room #:

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster			C	Y		200			SF	S0002	None Detected	N.D.	None	
Duct	Not Found	None Found														
Floor		Terrazzo			A	Y										
Mechanical Equipment	Not Found	None Found														
Piping	Not Found	None Found														
Structure	Not Accessible	None Found														
Wall		Concrete (precast)			A	Y										
Wall		Masonry			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1340 : Storage/Mech

Floor: 1

Room #: 134

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		200			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		200			SF	S0049D	None Detected	N.D.	None	
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	B	Y										
Piping	All	Fibreglass		Plastic	C	Y										
Structure	Not Accessible	None Found														
Wall	All	Paint			A	Y		450(7)			SF	S0050D	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1340 : Storage/Mech

Floor: 1

Room #: 134

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	450		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Floor	Concrete (poured)	200		SF	V0011	Grey	Pb: 0.0051 %	No	
Ceiling	Drywall and joint compound	200		SF	V0008	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1340 : Storage/Mech

Floor: 1

Room #: 134

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1340 : Storage/Mech

Floor: 1

Room #: 134

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1342 : CUST

Floor: 1

Room #: 134B

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		100			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		100			SF	V0049	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	B	Y										
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Paint			A	Y		450(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1342 : CUST

Floor: 1

Room #: 134B

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	450		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Floor	Concrete (poured)	100		SF	V0011	Grey	Pb: 0.0051 %	No	
Ceiling	Drywall and joint compound	100		SF	V0008	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1342 : CUST

Floor: 1

Room #: 134B

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1342 : CUST

Floor: 1

Room #: 134B

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1343 : Womans W/C

Floor: 1

Room #: 134C

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		300(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	All	None Found														
Wall	All	Ceramic Tiles			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1343 : Womans W/C

Floor: 1

Room #: 134C

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1343 : Womans W/C

Floor: 1

Room #: 134C

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1350 : Chemical Lab

Floor: 1

Room #: 135

Area (sqft): 1628

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1528			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 12x12, grey with light grey flecks			A	Y		1628			SF	S0005A	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		1628			SF	V0043	None Detected	N.D.	None	
Piping	All	Fibreglass			C	N										
Structure	All	Steel		Paint	C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		1500			SF	S0006AB	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	S0049B	None Detected	N.D.	None	
Wall	All	Paint			A	Y		1000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1350 : Chemical Lab

Floor: 1

Room #: 135

Area (sqft): 1628

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	400		SF	V0008	Various colours	Pb: <0.0005 %	No
Wall	Concrete (precast)	1000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)
Structure	Metal	1628		SF	V0013	Various colours	Pb: 0.191 %	Lead (High)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1350 : Chemical Lab

Floor: 1

Room #: 135

Area (sqft): 1628

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1350 : Chemical Lab

Floor: 1

Room #: 135

Area (sqft): 1628

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1351 : Chemical Office

Floor: 1

Room #: 135A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1528			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 12x12, blue with white flecks			B	Y		200			SF	S0007A	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		200			SF	S0048B	None Detected	N.D.	None	
Piping	All	Fibreglass			C	N										
Piping	Rain Water Leader	Fibreglass			C	N										
Structure	Deck	Steel		Paint	C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		1500			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		150			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		350(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1351 : Chemical Office

Floor: 1

Room #: 135A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	150		SF	V0008	Various colours	Pb: <0.0005 %	No
Wall	Concrete (precast)	350		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)
Structure	Metal	200		SF	V0013	Various colours	Pb: 0.191 %	Lead (High)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1351 : Chemical Office

Floor: 1

Room #: 135A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1351 : Chemical Office

Floor: 1

Room #: 135A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1352 : Chemical Storage

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1528			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, white with blue flecks			B	Y		150			SF	S0008A	[None]	N.D.	[Abated]	
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	N										
Structure	Deck	Steel		Paint	C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		350(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1352 : Chemical Storage

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Concrete (precast)	350		SF	V0009	Various colours		Pb: 0.0121 %	Lead (Low)
Structure	Metal	150		SF	V0013	Various colours		Pb: 0.191 %	Lead (High)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1352 : Chemical Storage

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1352 : Chemical Storage

Floor: 1

Room #:

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1360 : Physics

Floor: 1

Room #: 136

Area (sqft): 1500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1528			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		40			SF	V0049	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All				A	Y		1500			SF	V0008	[None]	N.D.	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		1500			SF	V0000	Non-Asbestos		None	
Piping	All	Fibreglass		Foil Face	C	N										
Structure	All	Steel		Paint	C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	S0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		1000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1360 : Physics

Floor: 1

Room #: 136

Area (sqft): 1500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Structure	Metal	1500		SF	V0013	Various colours	Pb: 0.191 %	Lead (High)	
Wall	Drywall and joint compound	400		SF	V0008	Various colours	Pb: <0.0005 %	No	
Ceiling	Drywall and joint compound	40		SF	V0008	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1360 : Physics

Floor: 1

Room #: 136

Area (sqft): 1500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1360 : Physics

Floor: 1

Room #: 136

Area (sqft): 1500

2023-07-28

Quantities shown above are based on visual approximations only and may be subject to variation. Copyright Pinchin Ltd. 2023

Page 152 of 415.

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1390 : Exercise Room

Floor: 1

Room #: 139

Area (sqft): 2643

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		2643			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		200			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		150			SF	V0049	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Duct	All	Not Insulated														
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Foil Face	C	N										
Piping	All	None Found														
Structure	Deck	Steel			C	N										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		3000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1390 : Exercise Room

Floor: 1

Room #: 139

Area (sqft): 2643

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Ceiling	Drywall and joint compound	150		SF	V0008	Various colours	Pb: <0.0005 %	No	
Wall	Concrete (precast)	3000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1390 : Exercise Room

Floor: 1

Room #: 139

Area (sqft): 2643

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1390 : Exercise Room

Floor: 1

Room #: 139

Area (sqft): 2643

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1400 : Computer Class

Floor: 1

Room #: 140

Area (sqft): 1185

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		1185(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 12x12, white with light and dark grey flecks			A	Y		1185			SF	S0013ABC	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		1185			SF	S0037A	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Wood			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1400 : Computer Class

Floor: 1

Room #: 140

Area (sqft): 1185

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1400 : Computer Class

Floor: 1

Room #: 140

Area (sqft): 1185

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1401 : Office

Floor: 1

Room #: 1401

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		200(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		200			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0013	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		200			SF	V0037	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Wood			A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		200(7)			SF	S0050C	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1401 : Office

Floor: 1

Room #: 1401

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	400		SF	V0008	Various colours	Pb: <0.0005 %	No	
Wall	Concrete (precast)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Wall	Wood	15		SF	V0012	White	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1401 : Office

Floor: 1

Room #: 1401

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #1401 : Office
Survey Date: 2022-08-23

Floor: 1

School
Room #: 1401
Last Re-Assessment: 2022-08-31

Area (sqft): 200

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1410 : Woodworking Shop
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 141
Area (sqft): 4000
Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster			C	Y		200			SF	S0002C	None Detected	N.D.	None	
Duct	All	Fibreglass		Canvas	C	Y										
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			C	Y		1			EA					
Mechanical Equipment	Not Found	None Found														
Piping	All	Fibreglass		Plastic	C	Y										
Piping	Rain Water Leader	Fibreglass			C	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Structure	All	Paint			A	Y		2000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		4500(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #1410 : Woodworking Shop
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 141
Area (sqft): 4000
Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	4500		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Floor	Concrete (poured)	2000		SF	V0011	Grey	Pb: 0.0051 %	No	
Structure	Concrete (poured)	2000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Structure	Metal	4000		SF	L0013	Various colours	Pb: 0.191 %	Lead (High)	
Ceiling	Plaster	150		SF	V0010	Various colours	Pb: 0.0050 %	No	

Client: Upper Canada District School Board
Location: #1410 : Woodworking Shop
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 141
Area (sqft): 4000
Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1410 : Woodworking Shop

Floor: 1

Room #: 141

Area (sqft): 4000

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1420 : Classroom

Floor: 1

Room #: 142

Area (sqft): 1137

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		1137			SF	V0015	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		1137			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor		Vinyl Floor Tile and Mastic			A	Y		1137			SF	V0005	None Detected	N.D.	None	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		150			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		1137			SF	V0048	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N						V0043	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		800(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Includes 142A

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1420 : Classroom

Floor: 1

Room #: 142

Area (sqft): 1137

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	400		SF	V0008	Various colours	Pb: <0.0005 %	No	
Wall	Concrete (precast)	800		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Includes 142A

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1420 : Classroom

Floor: 1

Room #: 142

Area (sqft): 1137

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

Includes 142A
1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1420 : Classroom

Floor: 1

Room #: 142

Area (sqft): 1137

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

Includes 142A

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1430 : Custodian

Floor: 1

Room #: 143

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	A	Y										
Mechanical Equipment	Not Found	None Found														
Piping	All	Fibreglass			C	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Structure	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	All	Wood		Paint	A	Y										
Wall	All	Paint			A	Y		450(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1430 : Custodian

Floor: 1

Room #: 143

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	450		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Floor	Concrete (poured)	200		SF	L0011	Grey	Pb: 0.0051 %	No	
Structure	Concrete (poured)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Wall	Wood	25		SF	L0012	White	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1430 : Custodian

Floor: 1

Room #: 143

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1430 : Custodian

Floor: 1

Room #: 143

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1440 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 150

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 9x9, grey with white streaks			B	Y		150(7)			SF	S0014A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #1440 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 150

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	400		SF	V0008	Various colours	Pb: <0.0005 %	No
Wall	Concrete (precast)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board
Location: #1440 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 150

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1440 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 150

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1450 : Autoshop

Floor: 1

Room #: 145

Area (sqft): 4204

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster			C	Y		200			SF	S0002B	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	A	Y		150			SF	S0051A	None Detected	N.D.	None	
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)			C	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			C	Y		1			EA					
Mechanical Equipment	Hoisting Mechanism	Not Insulated			A	Y										
Mechanical Equipment	Unit Heater	Not Insulated			C	Y		2			EA					
Piping	All	Parging Cement			C	Y		2(7)			EA	V0017	Chrysotile	25-50%	Confirmed Asbestos	F
Piping	Hot Water Heating	Fibreglass		Plastic	C	Y										
Structure	Deck	Steel			D	Y										
Wall	All	Paint			A	Y		4500(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1450 : Autoshop

Floor: 1

Room #: 145

Area (sqft): 4204

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	4500		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Ceiling	Plaster	150		SF	L0010	Various colours	Pb: 0.0050 %	No	
Ceiling	Plaster	150		SF	V0010	Various colours	Pb: 0.0050 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1450 : Autoshop

Floor: 1

Room #: 145

Area (sqft): 4204

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #1450 : Autoshop
Survey Date: 2022-08-23

Floor: 1

Room #: 145
Last Re-Assessment: 2022-08-31

Area (sqft): 4204

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1460 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 146
Last Re-Assessment: 2022-08-31

Area (sqft): 100

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #1460 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 146
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description			Hazard
Wall	Concrete (precast)	200		SF	V0009	Various colours			Pb: 0.0121 % Lead (Low)

Client: Upper Canada District School Board
Location: #1460 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 146
Last Re-Assessment: 2022-08-31

Area (sqft): 100

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1460 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 146
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PCB						
Component	Quantity	Unit	Sample	Sample Description		PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1470 : Cust

Floor: 1

Room #: 147

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		50			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Mechanical Equipment	Not Found	None Found														
Piping	All	Not Insulated			C	N										
Structure	Deck	Steel			C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		100(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1470 : Cust

Floor: 1

Room #: 147

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	100		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1470 : Cust

Floor: 1

Room #: 147

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1470 : Cust

Floor: 1

Room #: 147

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1480 : Office

Floor: 1

Room #: 148

Area (sqft): 608

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on), 1x1, large and medium uniform holes		Ceiling Tiles (lay-in)	C	N		608			SF	S0015B	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		608			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			A	Y		608			SF	V0007	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		608			SF	S0048A	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	S0049A	None Detected	N.D.	None	
Wall	All	Paint			A	Y		200(7)			SF	S0050A	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1480 : Office

Floor: 1

Room #: 148

Area (sqft): 608

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	400		SF	L0008	Various colours	Pb: <0.0005 %	No	
Wall	Concrete (precast)	200		SF	L0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1480 : Office

Floor: 1

Room #: 148

Area (sqft): 608

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #1480 : Office
Survey Date: 2022-08-19

Floor: 1

Room #: 148
Last Re-Assessment: 2022-08-31

Area (sqft): 608

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1481 : Office/Lunchroom

Floor: 1

Room #: 148D

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		200			SF	V0015	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		200			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100			SF	V0005	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100			SF	V0007	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		200			SF	V0048	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N						V0048	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		100			SF	V0043	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		100			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1481 : Office/Lunchroom

Floor: 1

Room #: 148D

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	400		SF	V0008	Various colours	Pb: <0.0005 %	No	
Wall	Concrete (precast)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1481 : Office/Lunchroom

Floor: 1

Room #: 148D

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1481 : Office/Lunchroom

Floor: 1

Room #: 148D

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1482 : Woodworking Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 148
Last Re-Assessment: 2022-08-31

Area (sqft): 50

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on), 1x1, large and medium uniform holes			C	Y		50			SF	S0015A	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	B	Y		20			SF	V0002	None Detected	N.D.	None	
Ceiling	All	Plaster		Ceiling tiles (glue-on)	A	Y		50			SF	V0051	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		50			SF	S0052AB	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 12"x12", light green			B	Y		50(7)			SF	S0016ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Vinyl Floor Tile and Mastic			A	Y		608			SF	V0007	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceiling tiles (glue-on)			C	Y		20			SF	V0015	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	B	Y		100			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		200(7)			SF	S0050B	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	All	Mastic		Ceiling tiles (glue-on)	D	N		20			SF	V0052	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1482 : Woodworking Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 148
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	400		SF	V0008	Various colours	Pb: <0.0005 %	No
Wall	Concrete (precast)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)
Ceiling	Plaster	50		SF	V0010	Various colours	Pb: 0.0050 %	No

Client: Upper Canada District School Board
Location: #1482 : Woodworking Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 148
Last Re-Assessment: 2022-08-31

Area (sqft): 50

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1482 : Woodworking Storage

Floor: 1

Room #: 148

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1490 : Resource Room

Floor: 1

Room #: 149

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		200			SF	V0020	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		200			SF	V0013	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		200			SF	V0037	None Detected	N.D.	None	
Mechanical Equipment	Not Found	None Found														
Piping	Not Found	None Found														
Structure	Deck	Steel			C	N										
Wall	All	Drywall and joint compound		Paint	A	Y		75			SF	S0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Wall	All	Paint			A	Y		300			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1490 : Resource Room

Floor: 1

Room #: 149

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1490 : Resource Room

Floor: 1

Room #: 149

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1490 : Resource Room

Floor: 1

Room #: 149

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1490 : Resource Room

Floor: 1

Room #: 149

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1510 : Training

Floor: 1

Room #: 151

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in)			C	Y		500			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound			A	Y		100			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	Y										
Floor	All	Wood			A	Y										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, white with blue flecks			A	Y		400			SF	S0008BC	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			A	Y										
Structure	All	Steel		Paint	C	N										
Structure	Deck	Concrete (poured)		Paint	C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1510 : Training

Floor: 1

Room #: 151

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Structure	Concrete (poured)	300		SF	V0023	Various colours		No	
Ceiling	Drywall and joint compound	100		SF	V0024		Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1510 : Training

Floor: 1

Room #: 151

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1520 : Storage Room

Floor: 1

Room #: 152

Area (sqft): 2730

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	A	Y										
Floor	All	Wood			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			C	Y										
Piping	All	Fibreglass		Foil Face	C	Y										
Structure	All	Steel		Paint	C	Y										
Structure	Deck	Concrete (poured)		Paint	C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound			A	Y		400			SF	V0000	Non-Asbestos		None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1520 : Storage Room

Floor: 1

Room #: 152

Area (sqft): 2730

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Structure	Concrete (poured)	300		SF	V0023	Various colours		No	
Wall	Drywall and joint compound	400		SF	V0024		Pb: <0.0005 %	No	
Floor	Concrete (poured)	2730		SF	L0025	Grey	Pb: 0.0417 %	Lead (Low)	
Structure	Steel	100		%	L0026	Various colours	Pb: 0.0445 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1520 : Storage Room

Floor: 1

Room #: 152

Area (sqft): 2730

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1530 : Storage

Floor: 1

Room #: 153

Area (sqft): 1808

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Wood			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			C	Y										
Piping	All	Fibreglass		Foil Face	C	Y										
Structure	All	Steel		Paint	C	Y										
Structure	Deck	Concrete (poured)		Paint	C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound			A	Y		400			SF	V0000	Non-Asbestos		None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1530 : Storage

Floor: 1

Room #: 153

Area (sqft): 1808

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Structure	Concrete (poured)	300		SF	V0023	Various colours		No
Wall	Drywall and joint compound	400		SF	L0024		Pb: <0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1530 : Storage

Floor: 1

Room #: 153

Area (sqft): 1808

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1540 : Welding

Floor: 1

Room #: 154

Area (sqft): 2000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	A	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			C	Y										
Mechanical Equipment	Unit Heater	Not Insulated			C	Y										
Piping	All	Fibreglass		Foil Face	C	Y										
Structure	All	Steel		Paint	C	Y										
Structure	Deck	Concrete (poured)		Paint	C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1540 : Welding

Floor: 1

Room #: 154

Area (sqft): 2000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Floor	Concrete (poured)	2000		SF	V0025	Grey		Pb: 0.0417 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1540 : Welding

Floor: 1

Room #: 154

Area (sqft): 2000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1550 : Storage

Floor: 1

Room #: 155

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in)			C	Y		200			SF	V0000	Non-Asbestos		None	
Duct		Fibreglass		Foil Face	C	N										
Duct		Not Insulated			C	N										
Duct	All	Not Insulated			C	Y										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, beige with brown fleck			B	Y		200(7)			SF	S0009ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Mechanical Equipment	Not Found	None Found														
Other	All	Mastic, Black			B	Y		200(7)			SF	V0032	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	Not Found	None Found														
Structure		Steel			C	N										
Structure	Deck	Concrete (poured)		Paint	C	Y										
Wall		Concrete (precast)			B	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1550 : Storage

Floor: 1

Room #: 155

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Structure	Concrete (poured)	300		SF	V0023	Various colours		No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1550 : Storage

Floor: 1

Room #: 155

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1560 : Classroom

Floor: 1

Room #: 156

Area (sqft): 250

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in)			C	Y		250			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	Y										
Floor	All	Wood			A	Y										
Floor	All	Terrazzo			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure		Steel			C	N										
Structure	All	Steel		Paint	C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Concrete (precast)		Paint	A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1560 : Classroom

Floor: 1

Room #: 156

Area (sqft): 250

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1570 : Staff Room

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on), 1x1, large and medium uniform pinholes		Ceiling Tiles (lay-in)	C	N		100(7)			SF	S0004ABC	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2'x2', coarse texture 01/09/07			C	Y		100			SF	V0000	Non-Asbestos		None	
Floor	All	Vinyl Floor Tile and Mastic, 9x9, grey with white and black streaks			A	Y		100(7)			SF	S0003ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Mastic		Vinyl Floor Tile	D	N						V0048	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		2			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1570 : Staff Room

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1570 : Staff Room

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1570 : Staff Room

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1571 : W/C

Floor: 1

Room #: 157A

Area (sqft): 20

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			B	Y		20(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		50(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1571 : W/C

Floor: 1

Room #: 157A

Area (sqft): 20

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Concrete (precast)	50		SF	V0009	Various colours		Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1571 : W/C

Floor: 1

Room #: 157A

Area (sqft): 20

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1571 : W/C

Floor: 1

Room #: 157A

Area (sqft): 20

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1572 : Closet

Floor: 1

Room #: 157B

Area (sqft): 20

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound			B	Y		20			SF	V				
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		50(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1572 : Closet

Floor: 1

Room #: 157B

Area (sqft): 20

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	50		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1572 : Closet

Floor: 1

Room #: 157B

Area (sqft): 20

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1572 : Closet

Floor: 1

Room #: 157B

Area (sqft): 20

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1573 : Washroom

Floor: 1

Room #: 157C

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			B	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		150(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1573 : Washroom

Floor: 1

Room #: 157C

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	150		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1573 : Washroom

Floor: 1

Room #: 157C

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1573 : Washroom

Floor: 1

Room #: 157C

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1590 : Boiler Room

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Not Found	None Found														
Duct	All	Fibreglass		Canvas	B	N										
Duct	All	Not Insulated			B	N										
Floor	All	Concrete (poured)		Paint	B	Y										
Piping	All	Fibreglass		Plastic	B	Y										
Piping	Domestic Hot Water	Fibreglass		Plastic	B	Y										
Piping	Hot Water Heating	Fibreglass		Plastic	B	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Structure	Deck	Steel			B	Y										
Structure	Fireproofing	Fireproofing (Fibrous)			C	Y		600			SF	S0001BC	None Detected	N.D.	None	
Wall	All	Masonry		Paint	A	Y										
Wall	All	Paint			A	Y		2000			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1590 : Boiler Room

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2000		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Floor	Concrete (poured)	600		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	
Structure	Concrete (poured)	600		SF	V0004	Various colours	Pb: 0.137 %	Lead (High)	
Wall	Masonry	500		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1590 : Boiler Room

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Bell And Spigot Fittings	100	%	V9000	Yes
Batteries In Emer. Lights	2	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1590 : Boiler Room

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1590 : Boiler Room

Floor: 1

Room #:

Area (sqft): 600

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1591 : Mechanical Room

Floor: 1

Room #: 159A

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Not Found	None Found														
Duct	All	Not Insulated			B	N										
Duct	Not Found	None Found														
Floor	All	Concrete (poured)		Paint	B	Y										
Piping	All	Fibreglass		Plastic	C	Y										
Piping	All	Fibreglass		Plastic	B	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Structure	All	Fireproofing (Fibrous)			B	Y		300			SF					
Structure	Deck	Steel			C	Y										
Structure	Fireproofing	Fireproofing (Fibrous)			C	Y		300		10	SF	S0001A	None Detected	N.D.	None	
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Masonry		Paint	A	Y										
Wall	All	Paint			A	Y		2000			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1591 : Mechanical Room

Floor: 1

Room #: 159A

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2000		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Floor	Concrete (poured)	300		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	
Structure	Concrete (poured)	300		SF	V0004	Various colours	Pb: 0.137 %	Lead (High)	
Wall	Masonry	500		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1591 : Mechanical Room

Floor: 1

Room #: 159A

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Bell And Spigot Fittings	100	%	V9000	Yes
Batteries In Emer. Lights	2	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1591 : Mechanical Room

Floor: 1

Room #: 159A

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1591 : Mechanical Room

Floor: 1

Room #: 159A

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1600 : Cust Office

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		1000			SF	V0020	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, white with grey and teal flecks			C	Y		1000			SF	S0018BC	None Detected	N.D.	None	
Mechanical Equipment		None Found														
Piping	All	Fibreglass			C	N										
Piping	All	Parging Cement			C	N		1(7)			EA	S0017D	Chrysotile	25-50%	Confirmed Asbestos	F
Piping	All	Aircell		Paper	C	N		40(7)			LF	S0023ABC	Chrysotile	25-50%	Confirmed Asbestos	F
Structure	Deck	Steel			C	N										
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Paint			A	Y		400			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1600 : Cust Office

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No
Wall	Concrete (precast)	400		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1601 : Office

Floor: 1

Room #: 1601

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		100			SF	V0020	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100			SF	V0018	None Detected	N.D.	None	
Mechanical Equipment		None Found														
Piping	All	Fibreglass		Plastic	B	Y										
Structure	Deck	Steel			C	N										
Structure	Deck	Steel			C	N										
Wall	All	Drywall and joint compound		Paint	B	Y		50			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Paint			A	Y		400			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1601 : Office

Floor: 1

Room #: 1601

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No
Wall	Concrete (precast)	400		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1610 : Women's W/C

Floor: 1

Room #: 161

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		150			SF	V0006	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y		150			SF					
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		375			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1610 : Women's W/C

Floor: 1

Room #: 161

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Ceiling	Drywall and joint compound	150		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Concrete (precast)	375		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1610 : Women's W/C

Floor: 1

Room #: 161

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1610 : Women's W/C

Floor: 1

Room #: 161

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1611 : Handicap w/c

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0013	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		100			SF	V0037	None Detected	N.D.	None	
Piping	All	Fibreglass			C	N										
Piping	All	Not Insulated			C	N										
Structure	Deck	Steel			C	N										
Wall	All	Drywall and joint compound		Paint	A	Y		250			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		250			SF	S0038D	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1611 : Handicap w/c

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	250		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1611 : Handicap w/c

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1611 : Handicap w/c

Floor: 1

Room #:

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1612 : Receiving

Floor: 1

Room #: 161B

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Not Found	None Found														
Duct	Not Found	None Found														
Floor	All	Concrete (poured)			B	Y										
Mechanical Equipment	Unit Heater	Not Insulated			C	Y										
Piping	All	Fibreglass		Foil Face	B	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Masonry			B	Y										
Wall	All	Paint			A	Y		375			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1612 : Receiving

Floor: 1

Room #: 161B

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	375		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1612 : Receiving

Floor: 1

Room #: 161B

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1612 : Receiving

Floor: 1

Room #: 161B

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1612 : Receiving

Floor: 1

Room #: 161B

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

2023-07-28

Quantities shown above are based on visual approximations only and may be subject to variation. Copyright Pinchin Ltd. 2023

Page 198 of 415.

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1614 : Mens W/C
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 161
Last Re-Assessment: 2022-08-31

Area (sqft): 50

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		50			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Foil Face	C	N										
Structure	Deck	Steel			C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		125			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1614 : Mens W/C
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 161
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	125		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1614 : Mens W/C
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 161
Last Re-Assessment: 2022-08-31

Area (sqft): 50

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1614 : Mens W/C
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 161
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1615 : Change Room

Floor: 1

Room #: 161E

Area (sqft): 400

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		400			SF	V0034	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y		400			SF					
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Plaster		Paint	A	Y		400			SF	S0002D	None Detected	N.D.	None	
Wall	All	Plaster		Paint	C	Y		35			SF	V0034	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		1000			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1615 : Change Room

Floor: 1

Room #: 161E

Area (sqft): 400

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Ceiling	Plaster	100		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Plaster	35		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Concrete (precast)	1000		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1615 : Change Room

Floor: 1

Room #: 161E

Area (sqft): 400

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1615 : Change Room

Floor: 1

Room #: 161E

Area (sqft): 400

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1617 : Stair

Floor: 1

Room #: Stair B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Metal			C	Y										
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	Not Found	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	Not Found	None Found														
Piping	Not Found	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall ¹	All	Plaster		Paint	A	Y		150			SF	V0036	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	
Wall	All	Paint			A	Y		1000			SF	V0040	None Detected	N.D.	None	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1617 : Stair

Floor: 1

Room #: Stair B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	150		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Plaster	150		SF	V0003	Various colours	Pb: 0.0014 %	No	
Wall	Concrete (precast)	1000		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1617 : Stair

Floor: 1

Room #: Stair B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1617 : Stair

Floor: 1

Room #: Stair B

Area (sqft): 100

2023-07-28

Quantities shown above are based on visual approximations only and may be subject to variation. Copyright Pinchin Ltd. 2023

Page 203 of 415.

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1618 : Stair E

Floor: 1

Room #:

Area (sqft): 250

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		250			SF	V0000	Non-Asbestos		None	
Ceiling	All	Plaster		Paint	C	Y		100			%	V0002	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	A	Y		150			SF	V0051	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Paint			A	Y		700(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1618 : Stair E

Floor: 1

Room #:

Area (sqft): 250

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Concrete (precast)	700		SF	V0009	Various colours		Pb: 0.0121 %	Lead (Low)
Ceiling	Plaster	150		SF	V0010	Various colours		Pb: 0.0050 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1618 : Stair E

Floor: 1

Room #:

Area (sqft): 250

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1618 : Stair E

Floor: 1

Room #:

Area (sqft): 250

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1618 : Stair E

Floor: 1

Room #:

Area (sqft): 250

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1620 : Gym A & B

Floor: 1

Room #: 162

Area (sqft): 3500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling ¹	All	Ceiling Tiles (lay-in)			D	Y		3500			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Wood			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Masonry			A	Y										
Wall	All	Paint			A	Y		15000			SF	V0040	None Detected	N.D.	None	

1 - Wicker

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1620 : Gym A & B

Floor: 1

Room #: 162

Area (sqft): 3500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	15000		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1620 : Gym A & B

Floor: 1

Room #: 162

Area (sqft): 3500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1620 : Gym A & B

Floor: 1

Room #: 162

Area (sqft): 3500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1621 : Stage

Floor: 1

Room #: 1621

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Wood			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	Y										
Wall	All	Masonry		Paint	A	Y										
Wall	All	Paint			A	Y		5000			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1621 : Stage

Floor: 1

Room #: 1621

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	5000		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Wall	Masonry	2000		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1621 : Stage

Floor: 1

Room #: 1621

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	2	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1621 : Stage

Floor: 1

Room #: 1621

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1621 : Stage

Floor: 1

Room #: 1621

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

2023-07-28

Quantities shown above are based on visual approximations only and may be subject to variation. Copyright Pinchin Ltd. 2023

Page 208 of 415.

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1624 : Under Stage

Floor: 1

Room #: 162D

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS - NO ACCESS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Not Found	None Found														
Duct		Not Insulated			B	Y										
Duct	All	Fibreglass		Foil Face	B	Y										
Floor	All	Concrete (poured)			B	Y										
Other	Tank	Not Insulated			B	Y										
Piping	All	Fibreglass		Plastic	B	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (poured)			B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1624 : Under Stage

Floor: 1

Room #: 162D

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS - NO ACCESS				
Component	Quantity	Unit	Sample	Hazard

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1624 : Under Stage

Floor: 1

Room #: 162D

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY - NO ACCESS				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1624 : Under Stage

Floor: 1

Room #: 162D

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB - NO ACCESS						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1624 : Under Stage

Floor: 1

Room #: 162D

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ODS - NO ACCESS					
Component	Type	Quantity	Unit	Sample	Hazard

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1624 : Under Stage

Floor: 1

Room #: 162D

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MOULD - NO ACCESS									
System	Material	Visible	Quantity	Unit	Sample Type	Sample No	Sample Description		Mould

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1624 : Under Stage

Floor: 1

Room #: 162D

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

TANK - NO ACCESS									
------------------	--	--	--	--	--	--	--	--	--

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1630 : Storage/WC

Floor: 1

Room #: 163

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	B	Y		150			SF	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		150			SF	V0034	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1630 : Storage/WC

Floor: 1

Room #: 163

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Plaster	150		SF	V0001	Various colours		Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1630 : Storage/WC

Floor: 1

Room #: 163

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1630 : Storage/WC

Floor: 1

Room #: 163

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1631 : Storage Under Stairs
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 163A
Area (sqft): 20
Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			A	Y										
Piping	All	Not Insulated			A	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										

Client: Upper Canada District School Board
Location: #1631 : Storage Under Stairs
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 163A
Area (sqft): 20
Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	25		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Structure	Concrete (poured)	20		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Floor	Concrete (poured)	20		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board
Location: #1631 : Storage Under Stairs
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 163A
Area (sqft): 20
Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1631 : Storage Under Stairs
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 163A
Area (sqft): 20
Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1640 : Library

Floor: 1

Room #: 164

Area (sqft): 2500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2'x2', coarse texture 01/09/07			C	Y		2500			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		200			SF	V0038	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		2000			SF	V0013	None Detected	N.D.	None	
Floor	All	Vinyl Floor Tile and Mastic			A	Y		500			SF	V0005	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		500			SF	S0043A	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	N										
Piping	All	Not Insulated			A	Y										
Structure	All	Steel														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Masonry			A	Y										
Wall	All	Paint			A	Y		300			SF	S0040C	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		30			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1640 : Library

Floor: 1

Room #: 164

Area (sqft): 2500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No	
Ceiling	Drywall and joint compound	250		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Concrete (precast)	300		SF	L0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1640 : Library

Floor: 1

Room #: 164

Area (sqft): 2500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	6	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #1640 : Library
Survey Date: 2022-08-19

Floor: 1

School
Room #: 164
Last Re-Assessment: 2022-08-31

Area (sqft): 2500

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High
School

Location: #1640 : Library
Survey Date: 2022-08-19

Floor: 1

Room #: 164
Last Re-Assessment: 2022-08-31

Area (sqft): 2500

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1641 : Office @ Library
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 164A
Last Re-Assessment: 2022-08-31

Area (sqft): 200

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		200			SF	V0020	None Detected	N.D.	None	
Duct	All	Fibreglass		Paper	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		200			SF	V0005	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		200			SF	V0043	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			B	N										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Wall	All	Paint			A	Y		300			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1641 : Office @ Library
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 164A
Last Re-Assessment: 2022-08-31

Area (sqft): 200

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1641 : Office @ Library
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 164A
Last Re-Assessment: 2022-08-31

Area (sqft): 200

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board
Location: #1641 : Office @ Library
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 164A
Last Re-Assessment: 2022-08-31

Area (sqft): 200

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1641 : Office @ Library

Floor: 1

Room #: 164A

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1650 : Change Room

Floor: 1

Room #: 165

Area (sqft): 1097

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		1097			SF	V0002	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	A	Y		1097			SF	V0034	None Detected	N.D.	None	
Duct	All	Not Insulated			C	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		1200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1650 : Change Room

Floor: 1

Room #: 165

Area (sqft): 1097

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Ceiling	Plaster	1097		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1650 : Change Room

Floor: 1

Room #: 165

Area (sqft): 1097

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1650 : Change Room

Floor: 1

Room #: 165

Area (sqft): 1097

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1651 : Change in Storage

Floor: 1

Room #: 165

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Not Found	None Found														
Duct	All	Not Insulated			C	Y										
Duct	Not Found	None Found														
Floor	All	Concrete (poured)		Paint	B	Y		50			SF					
Mechanical Equipment	All	None Found														
Mechanical Equipment	Not Found	None Found														
Piping	All	Fibreglass		Plastic	C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		300			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1651 : Change in Storage

Floor: 1

Room #: 165

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1651 : Change in Storage

Floor: 1

Room #: 165

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1651 : Change in Storage

Floor: 1

Room #: 165

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1652 : Change Room Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 1652
Last Re-Assessment: 2022-08-31

Area (sqft): 50

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Not Found	None Found														
Duct	All	Not Insulated			C	Y										
Duct	Not Found	None Found														
Floor	All	Concrete (poured)		Paint	B	Y		50			SF					
Mechanical Equipment	All	None Found														
Mechanical Equipment	Not Found	None Found														
Piping	All	Fibreglass		Plastic	C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		300			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1652 : Change Room Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 1652
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1652 : Change Room Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 1652
Last Re-Assessment: 2022-08-31

Area (sqft): 50

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1652 : Change Room Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 1652
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1653 : Shower
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 200

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		100			SF	V0002	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	A	Y		200			SF	V0034	None Detected	N.D.	None	
Duct	All	Not Insulated			C	Y										
Duct	Not Found	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	Unit Heater	Not Insulated			C	Y										
Piping	Not Found	None Found														
Structure	Not Accessible	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		300			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1653 : Shower
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 200

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Ceiling	Plaster	200		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1653 : Shower
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 200

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1653 : Shower
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 200

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1654 : Corridor

Floor: 1

Room #:

Area (sqft): 500

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in)			C	Y										
Ceiling		Ceiling Tiles (lay-in)			C	Y										
Duct		Not Insulated			C	N										
Floor		Terrazzo			A	Y										
Piping		Fibreglass			C	N										
Structure	Deck	Steel			C	N										
Wall		Concrete (precast)			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1660 : Mechanical Room

Floor: 1

Room #: 166

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		50			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		200			SF	V0038	None Detected	N.D.	None	
Duct	All	Fibreglass		Canvas	B	N										
Duct	All	Not Insulated			B	N										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			B	Y		1			EA					
Piping	All	Fibreglass		Plastic	B	Y										
Structure	All	Concrete (poured)		Paint	C	Y										
Wall		Concrete (precast)			B	Y										
Wall	All	Ceiling tiles (glue-on)			B	Y		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Wall	All	Drywall and joint compound		Paint	B	Y		100			SF	V0006	None Detected	N.D.	None	
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1660 : Mechanical Room

Floor: 1

Room #: 166

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)
Floor	Concrete (poured)	200		SF	V0004	Grey	Pb: 0.137 %	Lead (High)
Structure	Concrete (poured)	200		SF	V0004	Various colours	Pb: 0.137 %	Lead (High)
Ceiling	Drywall and joint compound	200		SF	V0006	Various colours	Pb: 0.0005 %	No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1660 : Mechanical Room
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 166
Last Re-Assessment: 2022-08-31
Area (sqft): 200

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Bell And Spigot Fittings	100	%	V9000	Yes

Client: Upper Canada District School Board
Location: #1660 : Mechanical Room
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 166
Last Re-Assessment: 2022-08-31
Area (sqft): 200

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1660 : Mechanical Room
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 166
Last Re-Assessment: 2022-08-31
Area (sqft): 200

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No
Transformer	1	EA	V0000			No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1680 : Seminar 1

Floor: 1

Room #: 168

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		100			SF	V0020	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0005	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		100			SF	V0043	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	All	Steel			C	N										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Wall	All	Paint			A	Y		300			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1680 : Seminar 1

Floor: 1

Room #: 168

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1680 : Seminar 1

Floor: 1

Room #: 168

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1680 : Seminar 1

Floor: 1

Room #: 168

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1681 : Seminar 2

Floor: 1

Room #: 168A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		200			SF	V0020	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		200			SF	V0005	None Detected	N.D.	None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		200			SF	V0043	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	All	Steel			C	N										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Wall	All	Paint			A	Y		300			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1681 : Seminar 2

Floor: 1

Room #: 168A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No	
Wall	Concrete (precast)	300		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1681 : Seminar 2

Floor: 1

Room #: 168A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1681 : Seminar 2

Floor: 1

Room #: 168A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1690 : Girls Changeroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 169
Last Re-Assessment: 2022-08-31
Area (sqft): 500

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		1200			SF	S0040B	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1690 : Girls Changeroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 169
Last Re-Assessment: 2022-08-31
Area (sqft): 500

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1200		SF	L0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1690 : Girls Changeroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 169
Last Re-Assessment: 2022-08-31
Area (sqft): 500

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1690 : Girls Changeroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 169
Last Re-Assessment: 2022-08-31
Area (sqft): 500

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1691 : Girls W/C

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		50			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			C	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		150			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1691 : Girls W/C

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	150		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1691 : Girls W/C

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1691 : Girls W/C

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1692 : Girls Shower

Floor: 1

Room #: 1692

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		200			SF	S0002E	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	C	Y		200			SF	V0034	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Plastic	C	Y										
Structure	Not Accessible	None Found														
Wall	All	Ceramic Tiles			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1692 : Girls Shower

Floor: 1

Room #: 1692

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Ceiling	Plaster	200		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1692 : Girls Shower

Floor: 1

Room #: 1692

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1692 : Girls Shower

Floor: 1

Room #: 1692

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1693 : Office
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 169B
Last Re-Assessment: 2022-08-31
Area (sqft): 150

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Deck	Steel			C	N										
Structure	Deck	Steel			C	Y										
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	C	Y		350			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		350			SF	S0034C	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1693 : Office
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 169B
Last Re-Assessment: 2022-08-31
Area (sqft): 150

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	350		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Plaster	350		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1693 : Office
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 169B
Last Re-Assessment: 2022-08-31
Area (sqft): 150

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1693 : Office
Survey Date: 2022-08-22

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 169B
Last Re-Assessment: 2022-08-31
Area (sqft): 150

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1710 : Office

Floor: 1

Room #: 171

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Plastic	C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		700			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1710 : Office

Floor: 1

Room #: 171

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1710 : Office

Floor: 1

Room #: 171

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1710 : Office

Floor: 1

Room #: 171

Area (sqft): 200

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1711 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		250			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		250			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 dense fissure and pinhole			C	Y		500			SF	V0000	Non-Asbestos		None	
Duct	Not Found	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Mechanical Equipment	Not Found	None Found														
Piping	Not Found	None Found														
Structure	All	Steel			C	N										
Structure	Deck	Steel			C	Y										
Wall	All	Paint			A	Y		2500			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1711 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	2500		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1711 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	2	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1711 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1711 : Corridor

Floor: 1

Room #:

Area (sqft): 1000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1730 : Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 173
Last Re-Assessment: 2022-08-31
Area (sqft): 200

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1730 : Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 173
Last Re-Assessment: 2022-08-31
Area (sqft): 200

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Floor	Concrete (poured)	200		SF	V0004	Grey	Pb: 0.137 %	Lead (High)	

Client: Upper Canada District School Board
Location: #1730 : Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 173
Last Re-Assessment: 2022-08-31
Area (sqft): 200

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1730 : Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 173
Last Re-Assessment: 2022-08-31
Area (sqft): 200

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1750 : Electrical Room
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 175
Area (sqft): 100
Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	None Found														
Floor	All	Concrete (poured)			B	Y										
Mechanical Equipment	Electrical Equipment	Not Insulated		Metal	A	Y										
Piping	All	None Found														
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		250			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #1750 : Electrical Room
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 175
Area (sqft): 100
Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	250		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1750 : Electrical Room
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 175
Area (sqft): 100
Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #1750 : Electrical Room
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 175
Area (sqft): 100
Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1770 : Gym C

Floor: 1

Room #: 177

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling ¹	All	Ceiling Tiles (lay-in)			D	Y		5000			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Rubber			A	Y		5000			SF					
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Fireproofing (Fibrous)		Ceiling Tiles (lay-in)	C	N		5000			SF	V0030	None Detected	N.D.	None	
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		9000(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

1 - Wicker

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1770 : Gym C

Floor: 1

Room #: 177

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	9000		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1770 : Gym C

Floor: 1

Room #: 177

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1770 : Gym C

Floor: 1

Room #: 177

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

ALL DATA REPORT

Client: Upper Canada District School Board**Site:** 1000 Edward Street North, Prescott, ON**Building Name:** South Grenville District High School**Location:** #1770 : Gym C**Floor:** 1**Room #:** 177**Area (sqft):** 5000**Survey Date:** 2022-08-19**Last Re-Assessment:** 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1771 : Girls Changeroom

Floor: 1

Room #: 177

Area (sqft): 400

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		200			SF	S0058D	Chrysotile	<0.5%	None	
Duct	All	Not Insulated			C	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	Y										
Piping	All	Parging Cement			C	Y		10(7)			EA	S0017C	Chrysotile	25-50%	Confirmed Asbestos	F
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		800(7)			SF	S0057A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1771 : Girls Changeroom

Floor: 1

Room #: 177

Area (sqft): 400

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	800		SF	L0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Ceiling	Plaster	200		SF	V0019	Various colours	Pb: 0.0115 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1771 : Girls Changeroom

Floor: 1

Room #: 177

Area (sqft): 400

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1771 : Girls Changeroom

Floor: 1

Room #: 177

Area (sqft): 400

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1772 : Gym C Storage

Floor: 1

Room #: 1772

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		300(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1773 : Storage

Floor: 1

Room #: 177H

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		150(7)			SF	S0057D	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	All	Paint			A	Y		100(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1773 : Storage

Floor: 1

Room #: 177H

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	150		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Wall	Concrete (precast)	100		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1773 : Storage

Floor: 1

Room #: 177H

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	
Fluorescent Light Tube ²	100	%	V9000	Yes

1 - T8

2 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1773 : Storage

Floor: 1

Room #: 177H

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1774 : Under Bleachers

Floor: 1

Room #: 1774

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			B	Y										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1774 : Under Bleachers

Floor: 1

Room #: 1774

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Floor	Concrete (poured)	200		SF	V0020	Grey	Pb: 0.0229 %	Lead (Low)	
Wall	Concrete (precast)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1790 : Boy's Changeroom

Floor: 1

Room #: 179

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		400			SF	S0058BC	Chrysotile	<0.5%	None	
Duct	All	Not Insulated			C	Y										
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	Unit Heater	Not Insulated			C	Y										
Piping	All	Fibreglass			C	Y										
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		800(7)			SF	S0057B	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1790 : Boy's Changeroom

Floor: 1

Room #: 179

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	800		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Ceiling	Plaster	400		SF	V0019	Various colours	Pb: 0.0115 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1790 : Boy's Changeroom

Floor: 1

Room #: 179

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1790 : Boy's Changeroom

Floor: 1

Room #: 179

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1791 : Storage

Floor: 1

Room #: 179A

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		50			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound			A	Y		50			SF	V0059	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	C	Y		150			SF	V0002	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	C	Y		150			SF	V0058	Chrysotile	<0.5%	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound			A	Y		50			SF	S0059B	None Detected	N.D.	None	
Wall	All	Paint			A	Y		250(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1791 : Storage

Floor: 1

Room #: 179A

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	250		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Ceiling	Plaster	150		SF	V0019	Various colours	Pb: 0.0115 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1791 : Storage

Floor: 1

Room #: 179A

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1791 : Storage

Floor: 1

Room #: 179A

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1792 : Storage

Floor: 1

Room #: 179B

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		50			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound			A	Y		50			SF	V0059	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound			A	Y		100			SF	S0059D	None Detected	N.D.	None	
Wall	All	Paint			A	Y		250(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1792 : Storage

Floor: 1

Room #: 179B

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	250		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Wall	Drywall and joint compound	100		SF	L0021	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1792 : Storage

Floor: 1

Room #: 179B

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Bell And Spigot Fittings	100	%	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1792 : Storage

Floor: 1

Room #: 179B

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1792 : Storage

Floor: 1

Room #: 179B

Area (sqft): 50

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1797 : Office
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 179G
Last Re-Assessment: 2022-08-31
Area (sqft): 150

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		150(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	All	Paint			A	Y		200(7)			SF	S0057C	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #1797 : Office
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 179G
Last Re-Assessment: 2022-08-31
Area (sqft): 150

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	150		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Wall	Concrete (precast)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1797 : Office
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 179G
Last Re-Assessment: 2022-08-31
Area (sqft): 150

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	
Fluorescent Light Tube ²	100	%	V9000	Yes

1 - T8
2 - T8

Client: Upper Canada District School Board
Location: #1797 : Office
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #: 179G
Last Re-Assessment: 2022-08-31
Area (sqft): 150

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #1900 : Mens Washroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 300

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		300(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		150			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		150			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		300			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		750			SF	V0034	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			A	Y										
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board
Location: #1900 : Mens Washroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 300

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	750		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Structure	Metal	300		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #1900 : Mens Washroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 1

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 300

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #1900 : Mens Washroom
Survey Date: 2022-08-19

Floor: 1

School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 300

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1901 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		50			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		50			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			C	N										
Structure	Deck	Steel		Paint	C	N										
Wall	All	Drywall and joint compound		Paint	A	Y		25			SF	S0038C	None Detected	N.D.	None	
Wall ¹	All	Plaster		Paint	A	Y		60			SF	S0036C	None Detected	N.D.	None	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1901 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	60		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Structure	Metal	50		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)
Wall	Plaster	60		SF	V0003	Various colours	Pb: 0.0014 %	No
Wall	Drywall and joint compound	25		SF	L0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1901 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1901 : Vestibule

Floor: 1

Room #:

Area (sqft): 50

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1910 : Washroom

Floor: 1

Room #: 191

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		200(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		100			SF	S0020ABC	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		200			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	N										
Piping	All	Not Insulated			C	N										
Structure	Deck	Steel		Paint	C	N										
Wall	All	Plaster		Paint	A	Y		350			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster, Textured		Paint	A	Y		350			SF	S0036A	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			A	Y										
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1910 : Washroom

Floor: 1

Room #: 191

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	350		SF	L0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Structure	Metal	200		SF	L0002	Black	Pb: 0.0784 %	Lead (Low)	
Wall ¹	Plaster	350		SF	V0003	Various colours	Pb: 0.0014 %	No	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1910 : Washroom

Floor: 1

Room #: 191

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1910 : Washroom

Floor: 1

Room #: 191

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1911 : Stairwell I

Floor: 1

Room #: Stair I

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		25			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		75			SF	V0000	Non-Asbestos		None	
Ceiling	All	Plaster		Paint	C	Y		75			SF	V0002	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	All	Steel		Paint	C	N										
Structure	Deck	Concrete (poured)			C	N										
Wall	All	Plaster		Paint	A	Y		250			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster, Textured		Paint	A	Y		60			SF	S0036D	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1911 : Stairwell I

Floor: 1

Room #: Stair I

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	250		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall ¹	Plaster	60		SF	V0003	Various colours	Pb: 0.0014 %	No	
Structure	Metal	100		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1911 : Stairwell I

Floor: 1

Room #: Stair I

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #1911 : Stairwell I

Floor: 1

Room #: Stair I

Area (sqft): 100

Survey Date: 2022-08-22

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2001 : Corridor

Floor: 2

Room #: 2

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		1000			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 dense fissure and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y		3000			SF					
Mechanical Equipment	All	None Found														
Structure	Deck	Steel		Paint	C	N										
Wall	All	Plaster, Textured		Paint	A	Y		5000			SF	S0036EF	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		3			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2001 : Corridor

Floor: 2

Room #: 2

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall ¹	Plaster	5000		SF	V0003	Various colours	Pb: 0.0014 %	No	
Structure	Metal	3000		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)	
Wall	Wood	1500		SF	V0005	White/beige	Pb: 0.0032 %	No	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2001 : Corridor

Floor: 2

Room #: 2

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2001 : Corridor

Floor: 2

Room #: 2

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2001 : Corridor

Floor: 2

Room #: 2

Area (sqft): 3000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2002 : Corridor

Floor: 2

Room #:

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		3000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small fleck and pinhole			C	Y		2000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	C	Y		100			%	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	C	N		5000				S0049EG	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	C	Y		600			SF	S0051D	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Structure	Deck	Steel			C	N										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	C	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0049	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		600			SF	S0051E	None Detected	N.D.	None	
Wall	All	Paint			A	Y		9000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		3			EA	V0000	Non-Asbestos		None	
Wall	Window	Caulking, Silicone			A	Y		25			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2002 : Corridor

Floor: 2

Room #:

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	400		SF	V0008	Various colours	Pb: <0.0005 %	No	
Wall	Concrete (precast)	9000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Wall	Plaster	600		SF	V0010	Various colours	Pb: 0.0050 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2002 : Corridor

Floor: 2

Room #:

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	6	EA	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2002 : Corridor

Floor: 2

Room #:

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2002 : Corridor

Floor: 2

Room #:

Area (sqft): 5000

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2010 : Classroom

Floor: 2

Room #: 201

Area (sqft): 1098

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling tiles (glue-on)			C	Y		1098(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)			C	N		1098(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling Tiles (lay-in)	D	N		1098			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		1098			SF	V0005	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		1098			SF	V0043	None Detected	N.D.	None	
Mechanical Equipment	Heating Water Tank	Not Insulated		Metal	A	Y		1			EA					
Piping		None Found														
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			A	Y										
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2010 : Classroom

Floor: 2

Room #: 201

Area (sqft): 1098

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2010 : Classroom

Floor: 2

Room #: 201

Area (sqft): 1098

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #2010 : Classroom
Survey Date: 2022-08-19

Floor: 2

Room #: 201
Last Re-Assessment: 2022-08-31

Area (sqft): 1098

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2011 : Storage

Floor: 2

Room #: 201A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling Tiles (lay-in)	D	N		50			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		50			SF	V0043	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping		None Found														
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2011 : Storage

Floor: 2

Room #: 201A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2011 : Storage

Floor: 2

Room #: 201A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2011 : Storage

Floor: 2

Room #: 201A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2020 : Vestibule

Floor: 2

Room #: 202

Area (sqft): 150

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		150			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			B	Y										
Piping	All	Not Insulated			A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		50		10	%	V0006	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		50			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2020 : Vestibule

Floor: 2

Room #: 202

Area (sqft): 150

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description			Hazard
Wall	Plaster	100		SF	V0001	Various colours			Pb: 0.0598 % Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2020 : Vestibule

Floor: 2

Room #: 202

Area (sqft): 150

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2020 : Vestibule

Floor: 2

Room #: 202

Area (sqft): 150

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2021 : Washroom

Floor: 2

Room #: 202A

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		40(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		40			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Wall	All	Plaster		Paint	A	Y		100			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2021 : Washroom

Floor: 2

Room #: 202A

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	100		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2021 : Washroom

Floor: 2

Room #: 202A

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2021 : Washroom

Floor: 2

Room #: 202A

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2022 : Washroom

Floor: 2

Room #: 202B

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		40(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		40			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Wall	All	Plaster		Paint	A	Y		100			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2022 : Washroom

Floor: 2

Room #: 202B

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	100		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2022 : Washroom

Floor: 2

Room #: 202B

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2022 : Washroom

Floor: 2

Room #: 202B

Area (sqft): 40

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2023 : Custodian
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 202C
Last Re-Assessment: 2022-08-31

Area (sqft): 50

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Wood			C	Y										
Ceiling	All	Ceiling tiles (glue-on)			C	N		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		50			SF	V0035	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Wall	All	Wood			A	Y										
Wall	All	Plaster		Paint	A	Y		100			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #2023 : Custodian
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 202C
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	100		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Wood	75		SF	V	White/beige		No	

Client: Upper Canada District School Board
Location: #2023 : Custodian
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 202C
Last Re-Assessment: 2022-08-31

Area (sqft): 50

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2023 : Custodian
Survey Date: 2022-08-23

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 202C
Last Re-Assessment: 2022-08-31

Area (sqft): 50

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2024 : Stairwell A

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		200			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole 10/29/07			C	Y		200			SF	V0000	Non-Asbestos		None	
Ceiling	All	Plaster		Paint	C	Y		75			SF	V0002	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y		200			SF					
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass			C	N										
Piping	All	None Found														
Structure	Deck	Steel		Paint	C	N										
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster, Textured		Paint	A	Y		60			SF	S0036G	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2024 : Stairwell A

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall ¹	Plaster	60		SF	V0003	Various colours	Pb: 0.0014 %	No	
Structure	Metal	200		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2024 : Stairwell A

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2024 : Stairwell A

Floor: 2

Room #:

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2030 : Art Class

Floor: 2

Room #: 203

Area (sqft): 1123

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	Y		1123(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		18			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small and medium pinhole			C	Y		900			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		1123			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		1123			SF	V0000	Non-Asbestos		None	
Floor	All	Vinyl Floor Tile and Mastic			A	Y		1123			SF	V0031	[None]	0.5-5%	[Abated]	
Floor	All	Mastic		Vinyl Floor Tile	D	N		1123			SF	V0053	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2030 : Art Class

Floor: 2

Room #: 203

Area (sqft): 1123

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2030 : Art Class

Floor: 2

Room #: 203

Area (sqft): 1123

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2030 : Art Class

Floor: 2

Room #: 203

Area (sqft): 1123

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2031 : Storage

Floor: 2

Room #: 203A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		50			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small and medium pinhole			C	Y		50			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0000	Non-Asbestos		None	
Floor	All	Vinyl Floor Tile and Mastic			A	Y		100			SF	V0031	[None]	0.5-5%	[Abated]	
Floor	All	Mastic		Vinyl Floor Tile	D	N		100			SF	V0053	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		50			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		75			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2031 : Storage

Floor: 2

Room #: 203A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	75		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	50		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2031 : Storage

Floor: 2

Room #: 203A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2031 : Storage

Floor: 2

Room #: 203A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2040 : Classroom

Floor: 2

Room #: 204

Area (sqft): 1056

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	Y		1056(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		1056			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		1056			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		1056			SF	V0029	[None]	5-10%	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with blue and grey smears			A	Y		1056			SF	V0046	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		1056			SF	V0044	None Detected	N.D.	None	
Piping		None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2040 : Classroom

Floor: 2

Room #: 204

Area (sqft): 1056

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2040 : Classroom

Floor: 2

Room #: 204

Area (sqft): 1056

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #2040 : Classroom
Survey Date: 2022-08-19

Floor: 2

School
Room #: 204
Last Re-Assessment: 2022-08-31

Area (sqft): 1056

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2041 : Closet

Floor: 2

Room #: 204A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Drywall and joint compound		Paint	C	Y		100			%	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		50			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	Kiln	Not Insulated			A	Y		1			EA					
Piping	All	Not Insulated			A	Y										
Structure	Deck	Steel			C	N										
Wall	All	Drywall and joint compound		Paint	B	Y		50		10	%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		200			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		50			%	S0002G	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		2			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2041 : Closet

Floor: 2

Room #: 204A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	200		SF	V0006	Various colours	Pb: 0.0005 %	No
Ceiling	Drywall and joint compound	50		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2041 : Closet

Floor: 2

Room #: 204A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #2041 : Closet
Survey Date: 2022-08-23

Floor: 2

Room #: 204A
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2050 : Classroom

Floor: 2

Room #: 205

Area (sqft): 918

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	Y		918(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		918(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		18			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small and medium pinhole			C	Y		900			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		918			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		918			SF	V0031	[None]	0.5-5%	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		918			SF	V0000	Non-Asbestos		None	
Floor	All	Mastic		Vinyl Floor Tile	D	N		918			SF	V0053	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2050 : Classroom

Floor: 2

Room #: 205

Area (sqft): 918

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #2050 : Classroom
Survey Date: 2022-08-19

Floor: 2

Room #: 205
Last Re-Assessment: 2022-08-31

Area (sqft): 918

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2050 : Classroom
Survey Date: 2022-08-19

Floor: 2

Room #: 205
Last Re-Assessment: 2022-08-31

Area (sqft): 918

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2055 : Stairs C

Floor: 2

Room #: Stair C

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in)			C	Y		100			SF	V0000	Non-Asbestos		None	
Duct		None Found														
Floor		Terrazzo			A	Y										
Mechanical Equipment		None Found														
Piping		None Found														
Structure	Deck	Steel														
Wall		Concrete (precast)			A	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2060 : Classroom

Floor: 2

Room #: 206

Area (sqft): 723

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	Y		723(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		723			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		723			SF	S0035C	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with blue and grey smears			A	Y		723			SF	V0046	None Detected	N.D.	None	
Floor	All	Vinyl Sheet Flooring			A	Y		723			SF	V0019	[None]	10-25%	[Abated]	
Floor	All	Terrazzo			A	Y										
Piping		None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	S0034F	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2060 : Classroom

Floor: 2

Room #: 206

Area (sqft): 723

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2060 : Classroom

Floor: 2

Room #: 206

Area (sqft): 723

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2060 : Classroom

Floor: 2

Room #: 206

Area (sqft): 723

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2070 : Classroom

Floor: 2

Room #: 207

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726			SF	V0004	[None]	0.5-5%	[Abated]	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		726			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100			SF	V0025	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with blue and grey smears			A	Y		726			SF	V0046	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping		None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2070 : Classroom

Floor: 2

Room #: 207

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2070 : Classroom

Floor: 2

Room #: 207

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2070 : Classroom

Floor: 2

Room #: 207

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2080 : Classroom

Floor: 2

Room #: 208

Area (sqft): 974

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		974			SF	V0004	[None]	0.5-5%	[Abated]	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		974			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		974			SF	V0029	[None]	5-10%	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with blue and grey smears			A	Y		974			SF	S0046C	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping		None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2080 : Classroom

Floor: 2

Room #: 208

Area (sqft): 974

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2080 : Classroom

Floor: 2

Room #: 208

Area (sqft): 974

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2080 : Classroom

Floor: 2

Room #: 208

Area (sqft): 974

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2090 : Classroom

Floor: 2

Room #: 209

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		726			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		726			SF	S0031	[None]	0.5-5%	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with blue and grey smears			A	Y		726			SF	S0046A	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Deck	Steel			A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2090 : Classroom

Floor: 2

Room #: 209

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2090 : Classroom

Floor: 2

Room #: 209

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2090 : Classroom

Floor: 2

Room #: 209

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2100 : Classroom

Floor: 2

Room #: 210

Area (sqft): 898

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		898			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100			SF	V0025	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with blue and grey smears			A	Y		898			SF	S0046B	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Deck	Steel			A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2100 : Classroom

Floor: 2

Room #: 210

Area (sqft): 898

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2100 : Classroom

Floor: 2

Room #: 210

Area (sqft): 898

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2100 : Classroom

Floor: 2

Room #: 210

Area (sqft): 898

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2110 : Classroom

Floor: 2

Room #: 211

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		726			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		726			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2110 : Classroom

Floor: 2

Room #: 211

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2110 : Classroom

Floor: 2

Room #: 211

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2110 : Classroom

Floor: 2

Room #: 211

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2111 : Storage

Floor: 2

Room #: 211A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100			SF	V0025	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2111 : Storage

Floor: 2

Room #: 211A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2111 : Storage

Floor: 2

Room #: 211A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #2111 : Storage
Survey Date: 2022-08-19

Floor: 2

School
Room #: 211A
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2112 : Storage

Floor: 2

Room #: 211B

Area (sqft): 60

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		60(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		60			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		60			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		60			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2112 : Storage

Floor: 2

Room #: 211B

Area (sqft): 60

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	100		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2112 : Storage

Floor: 2

Room #: 211B

Area (sqft): 60

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2112 : Storage

Floor: 2

Room #: 211B

Area (sqft): 60

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2130 : Office

Floor: 2

Room #: 213

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		726			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		726			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2130 : Office

Floor: 2

Room #: 213

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2130 : Office

Floor: 2

Room #: 213

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2130 : Office

Floor: 2

Room #: 213

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2140 : Classroom

Floor: 2

Room #: 214

Area (sqft): 728

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		728(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		728			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		728			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12 peach with blue and white smears			A	Y		728			SF	S0045C	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2140 : Classroom

Floor: 2

Room #: 214

Area (sqft): 728

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2140 : Classroom

Floor: 2

Room #: 214

Area (sqft): 728

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2140 : Classroom

Floor: 2

Room #: 214

Area (sqft): 728

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2150 : Office

Floor: 2

Room #: 215

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		726(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		726			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		726			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		726			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		2			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2150 : Office

Floor: 2

Room #: 215

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2150 : Office

Floor: 2

Room #: 215

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2150 : Office

Floor: 2

Room #: 215

Area (sqft): 726

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2160 : Classroom

Floor: 2

Room #: 216

Area (sqft): 694

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		694(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		694			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		694			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12 peach with blue and white smears			A	Y		694			SF	S0045AB	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	S0034E	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2160 : Classroom

Floor: 2

Room #: 216

Area (sqft): 694

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	400		SF	L0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2160 : Classroom

Floor: 2

Room #: 216

Area (sqft): 694

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2160 : Classroom

Floor: 2

Room #: 216

Area (sqft): 694

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2170 : Vacant Office

Floor: 2

Room #: 217

Area (sqft): 720

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		720(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		720			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		720			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		720			SF					
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	S0006G	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		2			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2170 : Vacant Office

Floor: 2

Room #: 217

Area (sqft): 720

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2170 : Vacant Office

Floor: 2

Room #: 217

Area (sqft): 720

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #2170 : Vacant Office
Survey Date: 2022-08-19

Floor: 2

School
Room #: 217
Last Re-Assessment: 2022-08-31

Area (sqft): 720

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2171 : Office

Floor: 2

Room #: 217A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		200(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		200(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		200			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		200			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		200			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		150			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		3			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2171 : Office

Floor: 2

Room #: 217A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	150		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2171 : Office

Floor: 2

Room #: 217A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2171 : Office

Floor: 2

Room #: 217A

Area (sqft): 200

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2172 : Office

Floor: 2

Room #: 217B

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		80(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		80(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		80			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		80			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		80			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		150			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		3			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2172 : Office

Floor: 2

Room #: 217B

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	150		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2172 : Office

Floor: 2

Room #: 217B

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2172 : Office

Floor: 2

Room #: 217B

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2173 : Vestibule

Floor: 2

Room #:

Area (sqft): 50

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		50			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		50			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	N/A														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		200			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster, Textured		Paint	A	Y		60			SF	V0036	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2173 : Vestibule

Floor: 2

Room #:

Area (sqft): 50

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	200		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall ¹	Plaster	60		SF	V0003	Various colours	Pb: 0.0014 %	No	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2173 : Vestibule

Floor: 2

Room #:

Area (sqft): 50

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2173 : Vestibule

Floor: 2

Room #:

Area (sqft): 50

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2174 : Storage

Floor: 2

Room #: 215B

Area (sqft): 180

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		180(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		180(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		180			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		180			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		180			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2174 : Storage

Floor: 2

Room #: 215B

Area (sqft): 180

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2174 : Storage

Floor: 2

Room #: 215B

Area (sqft): 180

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #2174 : Storage
Survey Date: 2022-08-23**Floor: 2****Room #: 215B**
Last Re-Assessment: 2022-08-31**Area (sqft): 180**

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2175 : Office

Floor: 2

Room #: 215A

Area (sqft): 150

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		150			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		150			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		150			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		400			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		2			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2175 : Office

Floor: 2

Room #: 215A

Area (sqft): 150

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Drywall and joint compound	400		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2175 : Office

Floor: 2

Room #: 215A

Area (sqft): 150

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #2175 : Office
Survey Date: 2022-08-23

Floor: 2

School
Room #: 215A
Last Re-Assessment: 2022-08-31

Area (sqft): 150

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2176 : Office

Floor: 2

Room #: 213A

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	N		80(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		80(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		80			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		80			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Carpet			B	Y		80			SF					
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		150			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		3			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2176 : Office

Floor: 2

Room #: 213A

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	150		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2176 : Office

Floor: 2

Room #: 213A

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2176 : Office

Floor: 2

Room #: 213A

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2180 : Classroom

Floor: 2

Room #: 218

Area (sqft): 727

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Paint	C	N		727(7)			%	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		727			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		727			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Duct	All	Not Insulated			C	N										
Floor		Vinyl Floor Tile and Mastic			A	Y		727(7)			SF	V0029	Chrysotile	5-10%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		727			SF	S0044A	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	C	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		1500			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2180 : Classroom

Floor: 2

Room #: 218

Area (sqft): 727

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	1500		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2180 : Classroom

Floor: 2

Room #: 218

Area (sqft): 727

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2180 : Classroom

Floor: 2

Room #: 218

Area (sqft): 727

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2190 : Music Room

Floor: 2

Room #: 219

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		300(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		300			SF	V0000	Non-Asbestos		None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		300			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Duct	All	Fibreglass			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, grey with light grey flecks			A	Y		300			SF	S0005BC	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with blue and grey smears			A	Y		300			SF	V0046	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		300			SF	S0043B	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Wall	All	Plaster		Paint	A	Y		400			SF	S0034G	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2190 : Music Room

Floor: 2

Room #: 219

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2190 : Music Room

Floor: 2

Room #: 219

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2190 : Music Room

Floor: 2

Room #: 219

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Thermostat	1	EA	V0000	

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2190 : Music Room

Floor: 2

Room #: 219

Area (sqft): 300

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2191 : Music Storage

Floor: 2

Room #: 219A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct		Not Insulated			C	Y										
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		300			SF	S0005	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 white with blue and grey smears			A	Y		100			SF	V0046	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Mechanical Equipment	Not Found	None Found														
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2191 : Music Storage

Floor: 2

Room #: 219A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2191 : Music Storage

Floor: 2

Room #: 219A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2191 : Music Storage

Floor: 2

Room #: 219A

Area (sqft): 100

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2195 : Elevator

Floor: 2

Room #: Elev

Area (sqft): 20

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Metal			B	Y										
Duct		None Found														
Floor		Vinyl Floor Tile and Mastic			B	Y		20			SF	V0000	Non-Asbestos		None	
Floor	All	Vinyl Floor Tile and Mastic, 12"x12", grey and brown fleck			A	Y		20			SF	S0025ABC	[None]	N.D.	[Abated]	
Mechanical Equipment		None Found														
Piping		None Found														
Structure	Not Accessible	N/A														
Wall		Metal			B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2210 : Staff Room

Floor: 2

Room #: 221

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		200(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	N										
Wall		Plaster			B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Wood			B	Y										
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	All	Paint			A	Y		125			SF	S0040D	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2210 : Staff Room

Floor: 2

Room #: 221

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Concrete (precast)	125		SF	L0007	Various colours	Pb: 0.0832 %	Lead (Low)
Structure	Metal	200		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2210 : Staff Room

Floor: 2

Room #: 221

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2210 : Staff Room

Floor: 2

Room #: 221

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2220 : Classroom

Floor: 2

Room #: 222

Area (sqft): 750

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		750(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	C	Y		750			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Ceiling tiles (glue-on)	D	N		750			SF	V0049	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		750			SF	V0031	[None]	0.5-5%	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		750			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			B	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		750			SF	S0053ABC	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2220 : Classroom

Floor: 2

Room #: 222

Area (sqft): 750

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2220 : Classroom

Floor: 2

Room #: 222

Area (sqft): 750

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2220 : Classroom

Floor: 2

Room #: 222

Area (sqft): 750

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2230 : Classroom

Floor: 2

Room #: 223

Area (sqft): 1195

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		1195(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Plaster		Paint	C	Y		50			SF	S0056C	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		1195			SF	V0012	None Detected	N.D.	None	
Floor	All	Vinyl Floor Tile and Mastic, 12"x12", grey with dark grey fleck			A	Y		1195			SF	S0031ABC	[None]	0.5-5%	[Abated]	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2500(7)			SF	S0054F	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2230 : Classroom

Floor: 2

Room #: 223

Area (sqft): 1195

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	2500		SF	L0014	Various colours	Pb: 0.0014 %	No
Ceiling	Drywall and joint compound	50		SF	V0016	Various colours	Pb: <0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2230 : Classroom

Floor: 2

Room #: 223

Area (sqft): 1195

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2230 : Classroom

Floor: 2

Room #: 223

Area (sqft): 1195

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2235 : Stairs E

Floor: 2

Room #: Stairs E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 medium fissures and pinholes			C	Y		190			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 small fleck and pinhole			C	Y		10			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Steel			C	N										
Wall	All	Paint			A	Y		1000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		3			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2235 : Stairs E

Floor: 2

Room #: Stairs E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Structure	Metal	200		SF	V0013	Various colours	Pb: 0.191 %	Lead (High)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2235 : Stairs E

Floor: 2

Room #: Stairs E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2235 : Stairs E

Floor: 2

Room #: Stairs E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2235 : Stairs E

Floor: 2

Room #: Stairs E

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2240 : Classroom

Floor: 2

Room #: 224

Area (sqft): 740

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		740(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		740(7)			SF	S0028	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2240 : Classroom

Floor: 2

Room #: 224

Area (sqft): 740

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	2000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2240 : Classroom

Floor: 2

Room #: 224

Area (sqft): 740

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2240 : Classroom

Floor: 2

Room #: 224

Area (sqft): 740

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2250 : Classroom

Floor: 2

Room #: 225

Area (sqft): 1098

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		1098(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Drywall and joint compound		Paint	C	Y		50			SF	S0056B	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		1098			SF	V0029	[None]	5-10%	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		1098			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		1098			SF	V0053	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2500(7)			SF	S0054E	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2250 : Classroom

Floor: 2

Room #: 225

Area (sqft): 1098

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2500		SF	V0014	Various colours	Pb: 0.0014 %	No	
Ceiling	Drywall and joint compound	50		SF	V0016	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2250 : Classroom

Floor: 2

Room #: 225

Area (sqft): 1098

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

ALL DATA REPORT

Location: #2250 : Classroom
Survey Date: 2022-08-19

Floor: 2

Room #: 225
Last Re-Assessment: 2022-08-31

Area (sqft): 1098

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2251 : Storage

Floor: 2

Room #:

Area (sqft): 271

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		271(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, beige with white and dark brown fleck			B	Y		271(7)			SF	S0011C	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Mechanical Equipment	All	None Found														
Other	All	Mastic, Black			C	N		271(7)			SF	V0032	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		75			SF	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	C	Y		75			SF	V0056	None Detected	N.D.	None	
Wall	All	Paint			A	Y		250(7)			SF	V0054	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2251 : Storage

Floor: 2

Room #:

Area (sqft): 271

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	250		SF	V0014	Various colours	Pb: 0.0014 %	No	
Wall	Drywall and joint compound	75		SF	V0016	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2251 : Storage

Floor: 2

Room #:

Area (sqft): 271

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2251 : Storage

Floor: 2

Room #:

Area (sqft): 271

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2260 : Classroom

Floor: 2

Room #: 226

Area (sqft): 1019

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		1019(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12 teal			A	Y		1019			SF	S0026BC	None Detected	N.D.	None	
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2260 : Classroom

Floor: 2

Room #: 226

Area (sqft): 1019

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2260 : Classroom

Floor: 2

Room #: 226

Area (sqft): 1019

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2260 : Classroom

Floor: 2

Room #: 226

Area (sqft): 1019

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2270 : Classroom

Floor: 2

Room #: 227

Area (sqft): 1165

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		50			SF	S0056D	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12"x12", light blue with white fleck			A	Y		1165(7)			SF	S0029ABC	Chrysotile	5-10%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Floor	All	Mastic		Vinyl Floor Tile	D	N		1165			SF	S0044B	None Detected	N.D.	None	
Mechanical Equipment	All	None Found														
Other	All	Mastic, Black			C	N		1165(7)			SF	S0033ABC	Chrysotile	5-10%	Confirmed Asbestos	NF
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2500(7)			SF	S0054G	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2270 : Classroom

Floor: 2

Room #: 227

Area (sqft): 1165

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2500		SF	V0014	Various colours	Pb: 0.0014 %	No	
Ceiling	Drywall and joint compound	50		SF	V0016	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2270 : Classroom

Floor: 2

Room #: 227

Area (sqft): 1165

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2270 : Classroom

Floor: 2

Room #: 227

Area (sqft): 1165

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2280 : Fan Room

Floor: 2

Room #: 228

Area (sqft): 225

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated		Metal	A	Y		2			EA					
Mechanical Equipment	Tank	Not Insulated			C	Y										
Piping	Hot Water Heating	Fibreglass		Plastic	C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Paint			A	Y		500(7)			SF	S0050F	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2280 : Fan Room

Floor: 2

Room #: 228

Area (sqft): 225

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Structure	Concrete (poured)	225		SF	V0011	Grey	Pb: 0.0051 %	No	
Structure	Metal	225		SF	V0013	Various colours	Pb: 0.191 %	Lead (High)	
Wall	Concrete (precast)	500		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2280 : Fan Room

Floor: 2

Room #: 228

Area (sqft): 225

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes
Pressure Gauge	1	EA	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2280 : Fan Room

Floor: 2

Room #: 228

Area (sqft): 225

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2281 : Storage

Floor: 2

Room #: 228A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y		100			%	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		50			SF	V0049	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	A	Y		50			SF					
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		100(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2281 : Storage

Floor: 2

Room #: 228A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	100		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Ceiling	Drywall and joint compound	50		SF	V0008	Various colours	Pb: <0.0005 %	No	
Floor	Concrete (poured)	50		SF	L0011	Grey	Pb: 0.0051 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2281 : Storage

Floor: 2

Room #: 228A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2281 : Storage

Floor: 2

Room #: 228A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2290 : Vestibule

Floor: 2

Room #:

Area (sqft): 80

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		80(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2290 : Vestibule

Floor: 2

Room #:

Area (sqft): 80

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2290 : Vestibule

Floor: 2

Room #:

Area (sqft): 80

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2290 : Vestibule

Floor: 2

Room #:

Area (sqft): 80

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2291 : Office

Floor: 2

Room #: 229A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100(7)			SF	V0011	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Other	All				C	N		100			SF	V0032	[None]	0.5-5%	[Abated]	
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Masonry		Paint	B	Y										
Wall	All	Paint			A	Y		400(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2291 : Office

Floor: 2

Room #: 229A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Wall	Masonry	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2291 : Office

Floor: 2

Room #: 229A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2291 : Office

Floor: 2

Room #: 229A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2292 : Office

Floor: 2

Room #: 229B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 12x12, beige with white and dark brown fleck			B	Y		100(7)			SF	S0011B	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Other	All	Mastic, Black			C	N		100(7)			SF	V0032	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2292 : Office

Floor: 2

Room #: 229B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2292 : Office

Floor: 2

Room #: 229B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2292 : Office

Floor: 2

Room #: 229B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2293 : Office

Floor: 2

Room #: 229C

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100(7)			SF	V0011	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Other	All				C	N		100()			SF	V0032	Chrysotile	0.5-5%	Confirmed Asbestos	
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Masonry		Paint	B	Y										
Wall	All	Paint			A	Y		400(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2293 : Office

Floor: 2

Room #: 229C

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Wall	Masonry	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2293 : Office

Floor: 2

Room #: 229C

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2293 : Office

Floor: 2

Room #: 229C

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2294 : Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 229D
Last Re-Assessment: 2022-08-31

Area (sqft): 100

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			B	Y		100(7)			SF	V0011	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Other	All	Mastic, Black			C	N		100(7)			SF	V0032	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #2294 : Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 229D
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #2294 : Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 229D
Last Re-Assessment: 2022-08-31

Area (sqft): 100

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2294 : Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 229D
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2310 : Classroom

Floor: 2

Room #: 231

Area (sqft): 844

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		844(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Plaster		Paint	C	Y		25			SF	V0058	Chrysotile	<0.5%	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			B	Y		844(7)			SF	V0011	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Other	All	Mastic, Black			C	N		844(7)			SF	V0032	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Paint			A	Y		1800(7)			SF	V0057	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2310 : Classroom

Floor: 2

Room #: 231

Area (sqft): 844

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	1800		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)
Ceiling	Plaster	25		SF	V0019	Various colours	Pb: 0.0115 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2310 : Classroom

Floor: 2

Room #: 231

Area (sqft): 844

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2310 : Classroom

Floor: 2

Room #: 231

Area (sqft): 844

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2320 : Classroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 232
Last Re-Assessment: 2022-08-31

Area (sqft): 761

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		761(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			A	Y		761(7)			SF	V0014	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2000(7)			SF	S0050G	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board
Location: #2320 : Classroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 232
Last Re-Assessment: 2022-08-31

Area (sqft): 761

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #2320 : Classroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 232
Last Re-Assessment: 2022-08-31

Area (sqft): 761

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2320 : Classroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 232
Last Re-Assessment: 2022-08-31

Area (sqft): 761

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2330 : Drama Class

Floor: 2

Room #: 233

Area (sqft): 829

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		25			SF	S0058E	Chrysotile	<0.5%	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic			B	Y		829			SF	V0005	[None]	N.D.	[Abated]	
Floor	All	Vinyl Floor Tile and Mastic, 12x12 black with white streaks			A	Y		829			SF	S0060ABC	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		1800(7)			SF	S0057G	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			C	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2330 : Drama Class

Floor: 2

Room #: 233

Area (sqft): 829

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	1800		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)	
Ceiling	Plaster	25		SF	V0019	Various colours	Pb: 0.0115 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2330 : Drama Class

Floor: 2

Room #: 233

Area (sqft): 829

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2330 : Drama Class

Floor: 2

Room #: 233

Area (sqft): 829

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2340 : Classroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 234
Last Re-Assessment: 2022-08-31

Area (sqft): 966

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		966(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 9x9, grey with white streaks			A	Y		966(7)			SF	S0014C	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board
Location: #2340 : Classroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 234
Last Re-Assessment: 2022-08-31

Area (sqft): 966

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	2000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #2340 : Classroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 234
Last Re-Assessment: 2022-08-31

Area (sqft): 966

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2340 : Classroom
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 234
Last Re-Assessment: 2022-08-31

Area (sqft): 966

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2341 : 234 Closet

Floor: 2

Room #: 234

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in)			C	Y		100			SF	V0000	Non-Asbestos		None	
Duct		None Found														
Floor		Terrazzo			B	Y										
Mechanical Equipment		None Found														
Piping		None Found														
Structure		Steel			C	N										
Wall		Wood			B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2350 : Weight Room

Floor: 2

Room #: 235

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling ¹	All	Ceiling Tiles (lay-in)			C	Y		200			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	C	Y		100				V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound			A	Y		100			SF	S0059CE	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Concrete (poured)		Paint	A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Deck	Fireproofing (Fibrous)		Ceiling Tiles (lay-in)	C	N		400			SF	S0030ABC	None Detected	N.D.	None	
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		250(7)			SF	S0057F	Chrysotile	0.5-5%	Confirmed Asbestos	NF

1 - Wicker

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2350 : Weight Room

Floor: 2

Room #: 235

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Floor	Concrete (poured)	125		SF	V0020	Grey	Pb: 0.0229 %	Lead (Low)
Wall	Concrete (precast)	250		SF	V0018	Various colours	Pb: 0.0113 %	Lead (Low)
Ceiling	Drywall and joint compound	100		SF	V0021	Various colours	Pb: <0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2350 : Weight Room

Floor: 2

Room #: 235

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	2	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2350 : Weight Room

Floor: 2

Room #: 235

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2350 : Weight Room

Floor: 2

Room #: 235

Area (sqft): 400

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2352 : Fan Room

Floor: 2

Room #: 235B

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	Air Handling Unit	Not Insulated			A	Y										
Piping	All	Fibreglass		Canvas	A	Y										
Piping	All	Fibreglass		Plastic	A	Y										
Piping	Rain Water Leader	Fibreglass		Foil Face	C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)			B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2352 : Fan Room

Floor: 2

Room #: 235B

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Floor	Concrete (poured)	50		SF	V0020	Grey	Pb: 0.0229 %	Lead (Low)	
Structure	Metal	50		SF	V0022	Red	Pb: 0.269 %	Lead (High)	

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2353 : Fan Room

Floor: 2

Room #: 235C

Area (sqft): 20

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Canvas	A	Y										
Piping	All	Fibreglass		Plastic	A	Y										
Piping	Rain Water Leader	Fibreglass		Foil Face	C	Y										
Structure	Deck	Steel			C	Y										
Wall	All	Concrete (precast)			B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2353 : Fan Room

Floor: 2

Room #: 235C

Area (sqft): 20

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Floor	Concrete (poured)	20		SF	V0020	Grey	Pb: 0.0229 %	Lead (Low)	
Structure	Metal	28		SF	L0022	Various colours	Pb: 0.269 %	Lead (High)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2353 : Fan Room

Floor: 2

Room #: 235C

Area (sqft): 20

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Bell And Spigot Fittings	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2354 : Fan Room

Floor: 2

Room #: 235D

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	None Found														
Duct	All	Not Insulated			C	Y										
Floor	All	Concrete (poured)		Paint	B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Fibreglass		Canvas	A	Y										
Piping	All	Fibreglass		Plastic	A	Y										
Piping	Rain Water Leader	Fibreglass		Foil Face	C	Y										
Structure	All	Concrete (poured)			C	Y										
Wall	All	Concrete (precast)			B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2354 : Fan Room

Floor: 2

Room #: 235D

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Floor	Concrete (poured)	50		SF	V0020	Grey	Pb: 0.0229 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2354 : Fan Room

Floor: 2

Room #: 235D

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Bell And Spigot Fittings	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2360 : Staff Room/Kitchen
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 236
Last Re-Assessment: 2022-08-31
Area (sqft): 943

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		943(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic, 12x12, beige with brown fleck			A	Y		943			SF	S0012ABC	[None]	N.D.	[Abated]	
Floor ¹	All	Vinyl Floor Tile and Mastic			A	Y		943			SF	V0000	Non-Asbestos		None	
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		2000(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

1 - Installed post 2012

Client: Upper Canada District School Board
Location: #2360 : Staff Room/Kitchen
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 236
Last Re-Assessment: 2022-08-31
Area (sqft): 943

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	2000		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board
Location: #2360 : Staff Room/Kitchen
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 236
Last Re-Assessment: 2022-08-31
Area (sqft): 943

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2360 : Staff Room/Kitchen
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 236
Last Re-Assessment: 2022-08-31
Area (sqft): 943

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2370 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 237
Last Re-Assessment: 2022-08-31
Area (sqft): 150

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 9x9 beige with brown fleck			B	Y		150(7)			SF	S0027ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		350(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		2			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board
Location: #2370 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 237
Last Re-Assessment: 2022-08-31
Area (sqft): 150

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	350		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #2370 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 237
Last Re-Assessment: 2022-08-31
Area (sqft): 150

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2370 : Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 237
Last Re-Assessment: 2022-08-31
Area (sqft): 150

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2390 : Office

Floor: 2

Room #: 239

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		150(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 12x12 teal			B	Y		150			SF	S0026A	None Detected	N.D.	None	
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		350(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	Window	Caulking, Silicone			A	Y		2			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2390 : Office

Floor: 2

Room #: 239

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	350		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2390 : Office

Floor: 2

Room #: 239

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2390 : Office

Floor: 2

Room #: 239

Area (sqft): 150

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2400 : Storage

Floor: 2

Room #: 240

Area (sqft): 526

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		526(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Plaster		Paint	C	Y		150			SF	V0002	None Detected	N.D.	None	
Ceiling	All	Plaster		Paint	C	Y		150			SF	S0051B	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 9"x9", green			B	Y		526(7)			SF	S0028ABC	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceiling tiles (glue-on)			B	Y		150			SF	V0015	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		100			SF	V0049	None Detected	N.D.	None	
Wall	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	All	Mastic		Ceiling tiles (glue-on)	D	N		150			SF	V0052	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2400 : Storage

Floor: 2

Room #: 240

Area (sqft): 526

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Ceiling	Plaster	150		SF	L0010	Various colours	Pb: 0.0050 %	No
Wall	Drywall and joint compound	100		SF	V0008	Various colours	Pb: <0.0005 %	No
Wall	Concrete (precast)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2400 : Storage

Floor: 2

Room #: 240

Area (sqft): 526

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2400 : Storage

Floor: 2

Room #: 240

Area (sqft): 526

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2401 : Storage Roof-Hatch

Floor: 2

Room #: 240A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		45			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		45			SF	V0049	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		50			SF	V0052	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Concrete (poured)			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceiling tiles (glue-on), 1x1, large and medium uniform holes			B	Y		20			SF	S0015C	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	S0006F	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		200			SF	S0049F	None Detected	N.D.	None	
Wall	All	Paint			A	Y		100(7)			SF	S0050E	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall	All	Mastic		Ceiling tiles (glue-on)	D	N		20			SF	V0052	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2401 : Storage Roof-Hatch

Floor: 2

Room #: 240A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Drywall and joint compound	200		SF	V0008	Various colours	Pb: <0.0005 %	No	
Wall	Concrete (precast)	100		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	
Ceiling	Drywall and joint compound	45		SF	V0008	Various colours	Pb: <0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2401 : Storage Roof-Hatch

Floor: 2

Room #: 240A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2401 : Storage Roof-Hatch

Floor: 2

Room #: 240A

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2410 : Kitchen Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 241
Last Re-Assessment: 2022-08-31

Area (sqft): 1249

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling tiles (glue-on)			C	Y		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	S0006E	None Detected	N.D.	None	
Wall	All	Paint			A	Y		75			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #2410 : Kitchen Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 241
Last Re-Assessment: 2022-08-31

Area (sqft): 1249

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	75		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)
Wall	Drywall and joint compound	200		SF	V0008	Various colours	Pb: <0.0005 %	No

Client: Upper Canada District School Board
Location: #2410 : Kitchen Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 241
Last Re-Assessment: 2022-08-31

Area (sqft): 1249

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2410 : Kitchen Office
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 241
Last Re-Assessment: 2022-08-31

Area (sqft): 1249

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2420 : Classroom

Floor: 2

Room #: 242

Area (sqft): 1208

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		1208(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		1208			SF	V0000	Non-Asbestos		None	
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			C	Y		1208			SF	V0018	None Detected	N.D.	None	
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	N/A														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		750			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2420 : Classroom

Floor: 2

Room #: 242

Area (sqft): 1208

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	750		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2420 : Classroom

Floor: 2

Room #: 242

Area (sqft): 1208

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2420 : Classroom

Floor: 2

Room #: 242

Area (sqft): 1208

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2430 : Kitchen
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 241
Last Re-Assessment: 2022-08-31
Area (sqft): 800

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct	All	Fibreglass		Plastic	C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Deck	Steel			C	N										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Drywall and joint compound		Paint	B	Y		100			%	S0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	C	Y		100			%	S0038G	None Detected	N.D.	None	
Wall	All	Paint			A	Y		75			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #2430 : Kitchen
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 241
Last Re-Assessment: 2022-08-31
Area (sqft): 800

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	75		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)
Wall	Drywall and joint compound	100		%	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board
Location: #2430 : Kitchen
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 241
Last Re-Assessment: 2022-08-31
Area (sqft): 800

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board
Location: #2430 : Kitchen
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 241
Last Re-Assessment: 2022-08-31
Area (sqft): 800

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

ALL DATA REPORT

Location: #2430 : Kitchen
Survey Date: 2022-08-19

Floor: 2

School
Room #: 241
Last Re-Assessment: 2022-08-31

Area (sqft): 800

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2501 : Cust

Floor: 2

Room #: 250A

Area (sqft): 25

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		25(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	A	Y		60			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster, Textured		Paint	A	Y		60			SF	V0036	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2501 : Cust

Floor: 2

Room #: 250A

Area (sqft): 25

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	60		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall ¹	Plaster	60		SF	V0003	Various colours	Pb: 0.0014 %	No	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2501 : Cust

Floor: 2

Room #: 250A

Area (sqft): 25

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2501 : Cust

Floor: 2

Room #: 250A

Area (sqft): 25

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2540 : Lobby

Floor: 2

Room #: 254

Area (sqft): 400

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling Tiles (lay-in), 2x4 wide fissures with pinholes			C	Y		1000			SF	V0020	None Detected	N.D.	None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 dense fissure and pinhole			C	Y		1000			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y		400			SF					
Mechanical Equipment	All	None Found														
Structure	Deck	Steel		Paint	C	N										
Wall	All	Plaster, Textured		Paint	A	Y		5000			SF	V0036	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		3			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2540 : Lobby

Floor: 2

Room #: 254

Area (sqft): 400

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall ¹	Plaster	5000		SF	V0003	Various colours	Pb: 0.0014 %	No	
Structure	Metal	400		SF	V0002	Black	Pb: 0.0784 %	Lead (Low)	
Wall	Wood	1500		SF	V0005	White/beige	Pb: 0.0032 %	No	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2540 : Lobby

Floor: 2

Room #: 254

Area (sqft): 400

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	4	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2540 : Lobby

Floor: 2

Room #: 254

Area (sqft): 400

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2540 : Lobby

Floor: 2

Room #: 254

Area (sqft): 400

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2541 : Cafeteria

Floor: 2

Room #: 254A

Area (sqft): 4800

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		4800(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y		4800			SF					
Mechanical Equipment	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Drywall and joint compound		Paint	A	Y		100			%	S0006D	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		5000			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		22			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2541 : Cafeteria

Floor: 2

Room #: 254A

Area (sqft): 4800

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	5000		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2541 : Cafeteria

Floor: 2

Room #: 254A

Area (sqft): 4800

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	2	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2541 : Cafeteria

Floor: 2

Room #: 254A

Area (sqft): 4800

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2541 : Cafeteria

Floor: 2

Room #: 254A

Area (sqft): 4800

2023-07-28

Quantities shown above are based on visual approximations only and may be subject to variation. Copyright Pinchin Ltd. 2023

Page 391 of 415.

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2542 : Cust

Floor: 2

Room #: 254B

Area (sqft): 125

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		125			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		125			SF	V0049	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		100(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2542 : Cust

Floor: 2

Room #: 254B

Area (sqft): 125

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description		Amount	Hazard
Wall	Concrete (precast)	100		SF	V0009	Various colours		Pb: 0.0121 %	Lead (Low)
Ceiling	Drywall and joint compound	125		SF	V0008	Various colours		Pb: <0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2542 : Cust

Floor: 2

Room #: 254B

Area (sqft): 125

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2542 : Cust

Floor: 2

Room #: 254B

Area (sqft): 125

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2570 : Kitchen

Floor: 2

Room #: 257

Area (sqft): 500

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	B	Y		500(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling ¹	All	Ceiling Tiles (lay-in)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		500			SF	V0000	Non-Asbestos		None	
Ceiling	All	Plaster		Paint	C	N		300			SF	V0002	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			A	Y										
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Plaster		Paint	B	Y		100			%	S0002F	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			B	Y										
Wall	All	Paint			A	Y		75			SF	V0040	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

1 - Fibreglass

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2570 : Kitchen

Floor: 2

Room #: 257

Area (sqft): 500

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Concrete (precast)	75		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2570 : Kitchen

Floor: 2

Room #: 257

Area (sqft): 500

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2570 : Kitchen

Floor: 2

Room #: 257

Area (sqft): 500

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2571 : Kitchen Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 100

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Plaster		Paint	C	Y		100			SF	V0002	None Detected	N.D.	None	
Duct	All	Fibreglass			C	N										
Wall	All	Concrete (precast)		Paint	B	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			B	Y										
Wall	All	Paint			A	Y		75			SF	V0040	None Detected	N.D.	None	

Client: Upper Canada District School Board
Location: #2571 : Kitchen Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 100

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Concrete (precast)	75		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #2571 : Kitchen Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 100

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2571 : Kitchen Storage
Survey Date: 2022-08-19

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #:
Last Re-Assessment: 2022-08-31
Area (sqft): 100

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2572 : Storage

Floor: 2

Room #: 257B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		100			%	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	N/A														
Wall	All	Ceramic Tiles			B	Y										

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2572 : Storage

Floor: 2

Room #: 257B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2572 : Storage

Floor: 2

Room #: 257B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2572 : Storage

Floor: 2

Room #: 257B

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB					
Component	Quantity	Unit	Sample	Sample Description	Amount
Light Ballasts	100	%	V0000	T8	No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2573 : Storage

Floor: 2

Room #: 257C

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		50(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct		None Found														
Duct	All	Not Insulated			C	N										
Floor	All	Vinyl Floor Tile and Mastic			B	Y		50(7)			SF	V0014	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor	All	Terrazzo			A	Y										
Mechanical Equipment		None Found														
Mechanical Equipment	All	None Found														
Piping		None Found														
Structure	Not Accessible	None Found														
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			SF	V0034	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		22			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2573 : Storage

Floor: 2

Room #: 257C

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	100		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2573 : Storage

Floor: 2

Room #: 257C

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2573 : Storage

Floor: 2

Room #: 257C

Area (sqft): 80

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2580 : Washroom

Floor: 2

Room #: 258

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Drywall and joint compound		Paint	C	Y		50			SF	V0006	None Detected	N.D.	None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		50			SF	V0049	None Detected	N.D.	None	
Duct	All	None Found														
Floor	All	Vinyl Floor Tile and Mastic, 9x9, grey with white streaks			A	Y		50			SF	S0014B	[None]	0.5-5%	[Abated]	
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible															
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			B	Y										
Wall	All	Paint			A	Y		150(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2580 : Washroom

Floor: 2

Room #: 258

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Ceiling	Drywall and joint compound	50		SF	V0008	Various colours	Pb: <0.0005 %	No
Wall	Concrete (precast)	150		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2580 : Washroom

Floor: 2

Room #: 258

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2580 : Washroom

Floor: 2

Room #: 258

Area (sqft): 50

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board
Location: #2581 : Classroom Storage
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 242B
Last Re-Assessment: 2022-08-31

Area (sqft): 100

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor		Vinyl Floor Tile and Mastic			B	Y		100(7)			SF	S0014	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		200(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board
Location: #2581 : Classroom Storage
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 242B
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Concrete (precast)	200		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)	

Client: Upper Canada District School Board
Location: #2581 : Classroom Storage
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 242B
Last Re-Assessment: 2022-08-31

Area (sqft): 100

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board
Location: #2581 : Classroom Storage
Survey Date: 2022-08-24

Site: 1000 Edward Street North, Prescott, ON
Floor: 2

Building Name: South Grenville District High School
Room #: 242B
Last Re-Assessment: 2022-08-31

Area (sqft): 100

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2590 : Office

Floor: 2

Room #: 259

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	None Found														
Floor	All	Terrazzo			B	Y										
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Masonry			B	Y										
Wall	Window	Caulking, Silicone			C	Y		4			EA	V0000	Non-Asbestos		None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2590 : Office

Floor: 2

Room #: 259

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2590 : Office

Floor: 2

Room #: 259

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2600 : Bleachers

Floor: 2

Room #:

Area (sqft): 500

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling ¹	All	Ceiling Tiles (lay-in)			D	Y		500			SF	V0000	Non-Asbestos		None	
Duct	All	None Found														
Floor	All	Concrete (poured)			A	Y										
Floor	All	Terrazzo			B	Y		500			SF					
Mechanical Equipment	All	None Found														
Piping	All	None Found														
Structure	Not Accessible	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Paint			A	Y		400			SF	S0040EF	None Detected	N.D.	None	

1 - Wicker

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2600 : Bleachers

Floor: 2

Room #:

Area (sqft): 500

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (poured)	400		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2600 : Bleachers

Floor: 2

Room #:

Area (sqft): 500

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

PB PRODUCTS				
Component	Quantity	Unit	Sample	Hazard
Batteries In Emer. Lights	1	EA	V9000	Yes

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2600 : Bleachers

Floor: 2

Room #:

Area (sqft): 500

Survey Date: 2022-08-23

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High

ALL DATA REPORT

Location: #2600 : Bleachers
Survey Date: 2022-08-23

Floor: 2

School
Room #:
Last Re-Assessment: 2022-08-31

Area (sqft): 500

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2900 : Girls W/C

Floor: 2

Room #: 290

Area (sqft): 320

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	Y		300(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		320			SF	V0000	Non-Asbestos		None	
Duct	All	Fibreglass			C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	B	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		400			SF	V0034	None Detected	N.D.	None	
Wall ¹	All	Plaster		Paint	A	Y		60			SF	V0036	None Detected	N.D.	None	
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		75			SF	S0040G	None Detected	N.D.	None	
Wall	Window	Caulking, Silicone			A	Y		8			EA	V0000	Non-Asbestos		None	

1 - Textured

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2900 : Girls W/C

Floor: 2

Room #: 290

Area (sqft): 320

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	400		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Concrete (precast)	75		SF	V0007	Various colours	Pb: 0.0832 %	Lead (Low)	
Wall	Plaster	60		SF	V0003	Various colours	Pb: 0.0014 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2900 : Girls W/C

Floor: 2

Room #: 290

Area (sqft): 320

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2900 : Girls W/C

Floor: 2

Room #: 290

Area (sqft): 320

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2910 : Mens W/C

Floor: 2

Room #: 291

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	Fibreglass		Foil Face	C	N										
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Structure	Not Accessible	N/A														
Wall	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		200			SF	V0034	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2910 : Mens W/C

Floor: 2

Room #: 291

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT									
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard	
Wall	Plaster	200		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)	
Wall	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No	
Ceiling	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2910 : Mens W/C

Floor: 2

Room #: 291

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2910 : Mens W/C

Floor: 2

Room #: 291

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2911 : Womens W/C

Floor: 2

Room #: 291A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)		Ceiling Tiles (lay-in)	C	N		100(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling Tiles (lay-in), 2x4 fleck and pinhole			C	Y		100			SF	V0000	Non-Asbestos		None	
Ceiling	All	Drywall and joint compound		Paint	A	Y		100			SF	S0038E	None Detected	N.D.	None	
Ceiling	All	Mastic		Ceiling tiles (glue-on)	D	N		100			SF	V0035	None Detected	N.D.	None	
Duct	All	Not Insulated			C	N										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	Not Accessible	N/A														
Wall	All	Drywall and joint compound		Paint	A	Y		100			%	V0006	None Detected	N.D.	None	
Wall	All	Drywall and joint compound		Paint	A	Y		100			SF	V0038	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		100			%	V0002	None Detected	N.D.	None	
Wall	All	Plaster		Paint	A	Y		200			SF	V0034	None Detected	N.D.	None	

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2911 : Womens W/C

Floor: 2

Room #: 291A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Plaster	200		SF	V0001	Various colours	Pb: 0.0598 %	Lead (Low)
Wall	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No
Ceiling	Drywall and joint compound	100		SF	V0006	Various colours	Pb: 0.0005 %	No

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2911 : Womens W/C

Floor: 2

Room #: 291A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2911 : Womens W/C

Floor: 2

Room #: 291A

Area (sqft): 100

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2920 : Mens W/C

Floor: 2

Room #: 292

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling tiles (glue-on)			C	Y					SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Ceiling	All	Ceiling tiles (glue-on)			C	Y		200(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	Y										
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	All	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		100(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2920 : Mens W/C

Floor: 2

Room #: 292

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	100		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2920 : Mens W/C

Floor: 2

Room #: 292

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2920 : Mens W/C

Floor: 2

Room #: 292

Area (sqft): 200

Survey Date: 2022-08-24

Last Re-Assessment: 2022-08-31

PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

ALL DATA REPORT

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2930 : Girls W/C

Floor: 2

Room #: 293

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	All	Ceiling tiles (glue-on)			C	Y		200(7)			SF	V0004	Amosite	0.5-5%	Confirmed Asbestos	PF
Duct	All	Not Insulated			C	Y										
Floor	All	Ceramic Tiles			A	Y										
Floor	All	Terrazzo			A	Y										
Mechanical Equipment	All	None Found														
Piping	All	Not Insulated			A	Y										
Structure	All	None Found														
Wall	All	Concrete (precast)		Paint	A	Y										
Wall	All	Ceramic Tiles			A	Y										
Wall	All	Paint			A	Y		100(7)			SF	V0050	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2930 : Girls W/C

Floor: 2

Room #: 293

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

PAINT								
System	Item	Good	Poor	Unit	Sample	Sample Description	Amount	Hazard
Wall	Concrete (precast)	100		SF	V0009	Various colours	Pb: 0.0121 %	Lead (Low)

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2930 : Girls W/C

Floor: 2

Room #: 293

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31

MERCURY				
Component	Quantity	Unit	Sample	Hazard
Fluorescent Light Tube ¹	100	%	V9000	Yes

1 - T8

Client: Upper Canada District School Board

Site: 1000 Edward Street North, Prescott, ON

Building Name: South Grenville District High School

Location: #2930 : Girls W/C

Floor: 2

Room #: 293

Area (sqft): 200

Survey Date: 2022-08-19

Last Re-Assessment: 2022-08-31



PCB						
Component	Quantity	Unit	Sample	Sample Description	Amount	PCB
Light Ballasts	100	%	V0000	T8		No

Legend:

Sample number		Units		Other	
S####	Asbestos sample collected	SF	Square feet	A	Access
L####	Paint sample collected	LF	Linear feet	V	Visible
P####	PCB sample collected	EA	Each	AP	Air Plenum
M####	Mould sample collected	%	Percentage	F	Friable material
V####	Material is visually identified to be identical to S####	LF	Linear feet	NF	Non Friable material
V0000	Known non hazardous material			PF	Potentially Friable material
V9000	Material visually identified as a Hazardous Material			Pb	Lead
V9500	Material is presumed to be a hazardous material			Hg	Mercury
				As	Arsenic
				Cr	Chromium

Access		Condition	
A	Accessible to all building occupants	Good	No visible damage or deterioration
B	Accessible to maintenance and operations staff without a ladder	Fair	Minor, repairable damage, cracking, delamination or deterioration
C	Accessible to maintenance and operations staff with a ladder. Also rarely entered, locked areas	Poor	Irreparable damage or deterioration with exposed and missing material
D	Not normally accessible		

Visible		Air Plenum	
Y	The material is visible when standing on the floor of the room, without the removal or opening of other building components (e.g. ceiling tiles or access panels).	Yes	The material is in a return air plenum or in a direct airstream or there is evidence of air erosion (e.g. duct for heating or cooling blowing directly on or across an ACM). This field is only completed where Air Plenum consideration is required by regulation.
N	The material is not visible to view when standing on the floor of the room and requires the removal of a building component (e.g. ceilings tiles or access panels) to view and access. Includes rarely entered crawlspaces, attic spaces, etc. Observations will be limited to the extent visible from the access points.	or No	

Colour Coding	
	The material is known to contain regulated concentrations of asbestos; either by analytical results or visible identification (use of the V9000 code).
	The material is presumed to contain asbestos; based on visual appearances; typically a material known to historically contain asbestos; however, not sampled due to limited access or the destructive nature of the sampling.

Action					
(1)	Clean up of ACM Debris	(2)	Precautions for Access Which may Disturb ACM Debris	(3)	ACM removal
(4)	Precautions for Work Which may Disturb ACM in Poor Condition	(5)	Proactive ACM removal (Minimum repair required for fair condition)	(6)	ACM repair
(7)	Management program and surveillance				